
## EUROSTYLE SPANLOK® VARIABLE PAN(VP) WALL CLADDING ON PLYWOOD SUBSTRATE JAMB FLASHING FOR VERTICAL CLADDING (RECESSED WINDOW/DOOR OPTION 1)

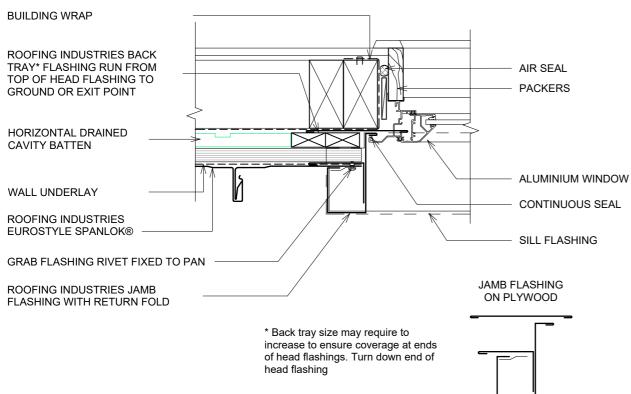

## GENERAL NOTES:

- These details are to be read with Roofing Industries SPANLOK™ Product Technical Statement and installation guide.
- These details are generally in compliance with E2/AS1 and/or the NZ Metal Roof & Wall Cladding Code of Practice and in some cases specific details by 'Roofing Industries'.
- The building designer is ultimatley responsible to ensure that details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure including cavity battens are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: www.metalroofing.org.nz or E2/AS1.
- Details are for steel based materials, other substrates may require some changes.
- All dimensions are nominal

DETAIL ANNOTATION:

9.

- REFER TO E2/AS1 FOR GENERAL WINDOW OPENING FOR WRAPPING 1 OF FRAMED OPENING PRIOR TO WINDOW INSTALLATION.
- 2. WINDOW PROFILE TO BE SELECTED TO ACHIEVE COVER SHOWN IN DFTAILS
- 3 ARCHITRAVE'S ARE SHOWN FOR CONSISTENCY ONLY. DETAIL MAY BE USED WITH REBATED LINER.
- WHERE SUPPORT BRACKETS REQUIRED BY THE WINDOW 4. MANUFACTURER TO CARRY THE FRAME AND GLAZING LOADS THEY MUST BE SUPPLIED AS AN INTEGRAL PART OF THE WINDOW MANUFACTURER'S RECOMMDENDATIONS.
- 5. LIAISE WITH WINDOW MANUFACTURER PRIOR TO INSTALLATION
- 6 SEAL HEAD FLASHING TO WINDOW IN VERY HIGH & EXTRA HIGH WIND ZONES
- 7. TREATED TIMBER CAVITY BATTENS CONTAINING CORROSIVE TREATMENTS MUST BE SEPARATED FROM METAL CLADDING 8
  - CASTELLATED BATTEN OR APPROVED DRAINED BATTEN CAN BE USED WITH THIS SYSTEM
  - FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
- ALTERNATIVELY REFER TO E2/AS1 FOR FLASHING COVER GUIDANCE 10 11 CLIPS OMITTED FOR CLARITY
- HIGH TO EXTRA HIGH WIND ZONES DOUBLE FIX UNDERFLASHING 12.
- 13 JOINERY AND JOINERY FLASHING INTERFACE IS INDICATIVE ONLY. REFER TO SELECTED JOINERY MANUFACTURER'S RECOMMENDATIONS AND DETAILS



interactive assembly

instructions available



(C) <sub>2024</sub>

Copyright detail

Detail Number: RI-ESRWVP-120B Date drawn: 03/04/2025

Scale: 1:5@ A4