
EUROSTYLE SPANLOK™ VARIABLE PAN ROOFING ON PURLINS TYPICAL APRON FLASHING (CAVITY) TYPE 1

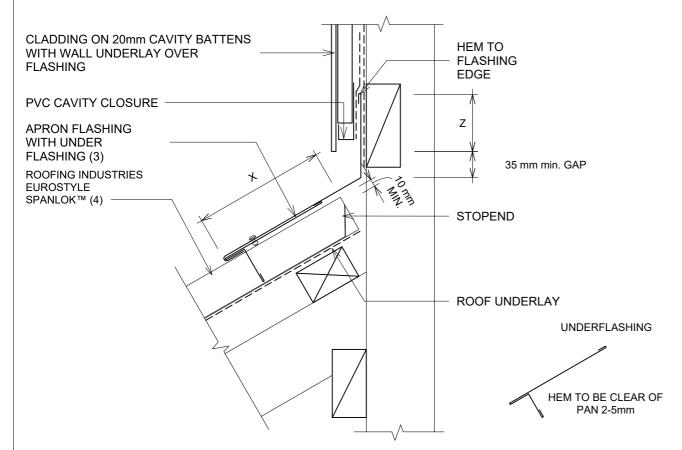

Date drawn: 20/05/2024

Scale: 1:5@ A4

WIND ZONE		MINIMUM	
		Z	Х
SITUATION 1		75mm	130mm
SITUATION 2		90mm	200mm
SITUATION 3	(5)	100mm	200mm

DETAIL ANNOTATION:

DESIGNER TO ENSURE DURABILITY OF FLASHING MATERIAL:

- SITUATION 1, 2 & 3 AS PER E2/AS1 TABLE 7
- FASTENERS TO BE COMPATABLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED.
- HIGH TO EXTRA HIGH WIND ZONE DOUBLE FIX UNDERFLASHINGS.
- CLIPS OMITTED FOR CLARITY
- ALTERNATIVELY REFER TO E2/AS1
- TYPE 1 REFERS TO PURLINS, TYPE 2 REFERS TO **PLYWOOD**

GENERAL NOTES:

- These details are to be read with Roofing Industries SPANLOK™ Product Technical Statement and installation guide.
- These details are generally in compliance with E2/AS1 and/or the NZ Metal Roof & Wall Cladding Code of Practice and in some cases specific details by 'Roofing Industries'.
- The building designer is ultimatley responsible to ensure that details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure including cavity battens are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: www.metalroofing.org.nz or E2/AS1.
- Details are for steel based materials, other substrates may require some changes.
- All dimensions are nominal



