DOMESTIC, RESIDENTIAL & NON RESIDENTIAL GLASS INFILL BALUSTRADES COVERING OCCUPANCIES A, B, C3 & E OF TABLE AS/NZS 1170.1:2002 UP TO A MAXIMUM HEIGHT OF 2000MM ABOVE THE TOP FIXING. BALUSTRADE GLASS - 10MM & 12MM TOUGHENED OR 12MM TOUGHENED LAMINATE. MAXIMUM POST CENTERS LAMINATE INTERLAYER NOT INCLUDED IN GLASS THICKNESS. WITH OR WITHOUT HANDRAIL POOL FENCING - 12MM TOUGHENED, OR 12MM TOUGHENED LAMINATE TO A MAXIMUM HEIGHT OF 2000MM ABOVE GROUND LEVEL REFER OPUS TECHNICAL INTERIOR BALUSTRADE DRAWING OB100/24 REFER OPUS TECHNICAL EXTERIOR BALUSTRADE DRAWING OB100/24 POOL FENCE MINIMUM HEIGHT OF 1200MM ABOVE G.L. PLEASE NOTE: REFER OPUS TECHNICAL DRAWING OB100/24 POOL FENCING SUBJECT TO ULS LOADS EXCEEDING 1.76KPa TO 2.1KPa POST TO BE INSTALLED AT-

COMMERCIAL AND OFFICES WITHOUT CROWDING, RETAIL RESTAURANTS & BARS COVERING OCCUPANCIES C1, C2 & D OF TABLE AS/NZS 1170.1:2002 UP TO A MAXIMUM HEIGHT OF 2000MM ABOVE THE TOP FIXING. BALUSTRADE GLASS - 15MM TOUGHENED OR MAXIMUM POST CENTERS 16MM TOUGHENED LAMINATE. WITH OR WITHOUT OPTIONAL HANDRAIL LAMINATE INTERLAYER NOT INCLUDED IN GLASS THICKNESS. REFER OPUS TECHNICAL INTERIOR BALUSTRADE DRAWING OB100/24 REFER OPUS TECHNICAL EXTERIOR BALUSTRADE DRAWING OB100/24

NOTES:

TIMBER/STEEL CALCULATIONS ARE THE RESPONSIBILITY OF OTHERS.

ALL FIXING HARDWARE TO BE GRADE 316 STAINLESS STEEL.


DURATEC POWDERCOAT OR 25 MICRON ANODISED FINISH IS RECOMMENDED FOR ALL INSTALLATIONS ESPECIALLY WITHIN COASTAL AREAS.

THIS PROPRIETARY BALUSTRADE SYSTEM HAS BEEN DESIGNED IN CONJUNCTION WITH THE GANZ BALUSTRADE DESIGN TABLE SB-3 AND COMPLIES WITH THE NEW ZEALAND BUILDING CODE CLAUSES B1 STRUCTURAL, B2 DURABILITY, F2 HAZARDOUS BUILDING MATERIALS AND F4 SAFETY FROM FALLING THIRD ADDITION, SUBJECT TO:

- ALL PRODUCTS MEETING THEIR PERFORMANCE SPECIFICATION.
- INSTALLATIONS MUST BE IN ACCORDANCE WITH THE INTENT OF THIS DRAWING AND COMPLY WITH NZS 4223.3.2016 REQUIREMENTS

THE GANZ TABLE SB-3 ALLOWS A MAXIMUM ULS OF 2.1KPa AND SLS OF 1.5KPa DESIGN WIND PRESSURE FOR THE LOCATION AND IF THE SITE DESIGN WIND PRESSURE EXCEEDS THESE. SPECIFIC DESIGN IS REQUIRED TO DETERMINE THE GLASS THICKNESS.

THE DESIGN HAS BEEN VERIFIED BY AN INDEPENDENT ENGINEERING CONSULTANT AND A PRODUCER STATEMENT PS1 DESIGN IS AVAILABLE.

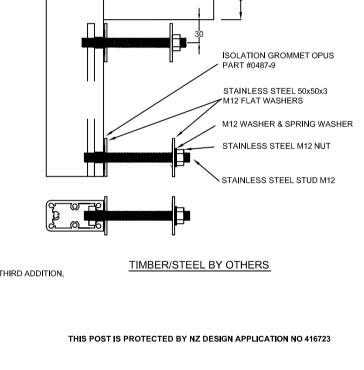

DRAWING UPDATED 19/05/16 TO INCLUDE NZS 4223.3.2016 REQUIREMENTS DRAWING UPDATED 29/11/17 TO INCLUDE GLASS TYPES

OPUSTM MANUFACTURING LTD.

11 Grasslands Place

P.O.Box 5750 Frankton, Hamilton, New Zealand

Telephone: +64 7 847 5001

Fax: +64 7 847 5003

OPUS SEMI - FRAMELESS BALUSTRADE POST OB101-C SHOWING RECOMMENDED FIXING FOR FACE FIX TIMBER/STEEL

100-150 (REFER NOTES)



1000 - 2000

REFER OCCUPANCY

GUIDE PAGE 82

OF THE OPUS TECHNICAL MANUAL DRAWING 0B100/24

OPUS MANUFACTURING LTD 2012

HANDRAIL BRACKETS AND RAILINGS

MUST COMPLY WITH NZS 4223.3.2016

OPUS PART #GHH-3 POST MOUNT

RAILING

OPUS PART #OHRT ROUND RAILING

OPUS PART #OHRT-2 RECTANGULAR

DRAWING NUMBER: OB100/4

TECHNICAL MANUAL PAGE 81C

STAINLESS 316 M8 CSK BOLT TO BE SECURED BY INSTALLER FOLLOWING

GLASS INSTALLATION ENSURING THE

IS INSTALLED.

OPUS ISOLATION SLEEVE PART#0487-9A