

EPB Plasterboard & Fibre Cement FIRE RATED SYSTEMS

www.elephantplasterboard.co.nz

EPB Plasterboard & Fibre Cement Fire Rated Systems Manual

These publications are continuously being updated and superseded. CURRENT VERSION DATED: **October 2024** It is important to check to ensure you have the latest publication. Call Free Help line 0800 353742. Liability for systems that are not designed and installed in accordance with this publication will not be accepted by Elephant Plasterboard (NZ) Limited.

Copyright

All the material in this document including text, diagrams, figures, patterns, pictures, tables and cad drawings are protected by copyright.

Cad Drawings

Pictures and CAD drawings may be downloaded and used in consented plans for generic references only. Elephant Plasterboard (NZ) Limited takes no liability in CAD drawing details shown. It is up to the designer and or builder to provide specific details and or building construction methods in each case. All pictures and CAD details are generic only.

Elephant Plasterboard (NZ) Limited Trademarks:

Elephant Plasterboard[®], Elephant Board[®], EPB Plasterboard[®]

Elephant Standard Plasterboard[®], Elephant Smartboard[®], SmartRock Plasterboard[®]

Elephant FireSmart[®], Elephant MultiSmart[®], Elephant AquaSmart[®], Elephant CeilingSmart[®] Elephant SpanSmart[®], Elephant SuperSmart[®], Elephant BraceSmart[®], Elephant NoiseSmart[®], Elephant UltraSmart[®], Elephant Standard-Plus[®], Elephant ImpactSmart[®], EPB Standard[®], EPB MultiSmart[®], EPB FireSmart[®], EPB AquaSmart[®], EPB CeilingSmart[®]

Introducing new 10mm EPB FireSmart/10mm EPB CeilingSmart®

10mm EPB FireSmart is a higher density board compared to10mm EPB Standard and provides enhance fire performance. 10mm EPB CeilingSmart is especially developed to span ceiling battens at 600mm centers providing a light weight and cost effective ceiling lining solution compared to using 10mm Standard Plasterboard at 450mm centres or 13mm Standard Plasterboard at 600mm centre. All past and future references and installations of 10mm Standard-Plus is interchangeable with 10mm EPB FireSmart and vice versa.

Elephant Plasterboard Product & System Warranty

EPB Plasterboard wall and ceiling linings are supported by Elephant Plasterboard's Quality Guarantee. This Warranty covers Elephant Plasterboard products and or systems for a minimum of 10 years from the date of the purchase. Elephant Plasterboard supplies products which are warranted to be free from defects. Any products found to be defective before or after installation will be replaced and/or repaired, provided installation has been in accordance with EPB Plasterboard's technical literature.

James Hardie fire and acoustic performance, durability and maintenance requirements of James Hardie products, components or systems do not form a part of this Elephant Plasterboard warranty.

For warranty terms & conditions on James Hardie products & components, visit www.jameshardie.co.nz.

Free Helpline 0800 353-742

Email info@elephantplasterboard.co.nz

Website www.elephantplasterboard.co.nz

Telephone (09) 818-7706

Elephant Plasterboard (NZ) Limited 14 Bancroft Crescent, Glendene, Auckland 0602 P.O. Box 21-436, Waitakere 0650 New Zealand

CONTENTS

SYSTEM SELECTOR TABLE	4-22
INTRODUCTION	24-29
Limitations and Conditions of Use	
NZBC Compliance	
Fire Resistance Ratings (FRR)	
Internal lining Surface Finish Properties	
Control of External Fire Spread	
EPB & Fibre Cement Fire Rated Walls - Timber Frame	
EPB & Fibre Cement Fire Rated Walls - Steel Frame	
Thermal Fire Batten	
Structural Steel Members in Fire Rated Walls	
Cavity Insulation	
Fire Retardant Flexible Underlay	
Rigid Air Barrier	
EPB QuickBrace System	
EPB & Fibre Cement Fire Rated Floor/Ceiling	
Product & Component Substitution	
James Hardie Cladding Options & Technical Literature	
NOMENCLATURE	30
EPB Specification Reference - Fire Wall with Fibre Cement	
EPB Specification Reference - Floor/Ceilings with Fibre Cement	
EXTERNAL TIMBER FRAME WALLS	31-60
EPB & James Hardie Linea [™] Weatherboard	
EPB & James Hardie Linea™ Oblique™ Weatherboard	
EPB & James Hardie™ Plank Weatherboard	
EPB & James Hardie Stria™ Cladding	
EPB & James Hardie Stria [™] Cladding & RAB [™] Board	
EPB & James Hardie Hardie™ Flex Sheet	
EPB & James Hardie Axon™ Panel	
EPB & James Hardie Axon™ Panel & RAB™Board	
EPB & James Hardie EasyLap™ Panel	
EPB & James Hardie EasyLap™ Panel & RAB™Board	
EPB & James Hardie ExoTec TM Facade Panel & RAB TM Board	
EPB & James Hardie RAB™ Board & a Weathertight Cladding	
EXTERNAL STEEL FRAME WALLS	61-73
EPB & RAB™ Board with Selected James Hardie Fibre Cement Cladding	
EPB & James Hardie RAB™ Board & a Weathertight Cladding	
INTERNAL TIMBER FRAME WALLS	74-76
EPB Plasterboard & James Hardie Villaboard™ Lining	
FLOOR/CEILING SYSTEMS	77-79
EPB Plasterboard & Secura™ Interior Flooring	
FLOATING FLOOR/CEILING SYSTEMS	81-83
EPB Plasterboard & Floating Secura™ Interior Flooring	
CONSTRUCTION DETAIL	84-96
DRODUCT DANCE	00
PRODUCT RANGE	98

External Fire Rated Walls - Timber Frame

System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirements	Page
EPB Plaste	rboard	& James H	lardie Lin	ea™ W	/eatherboard	
EJL1TL30	-F10	30/30/30	R2.2 glass wool	46	1 x 10mm EPB FireSmart on Internal side James Hardie Linea™ Weatherboard to External side	32
EJL1TL60	-M13	60/60/60	R2.2 glass wool	47	1 x 13mm EPB MultiSmart on Internal side James Hardie Linea™ Weatherboard to External side	33
EPB Plaste	rboard	& James H	lardie Lin	ea™ O	blique™Weatherboard	
EJOh1TL30	-F10	30/30/30	R2.2 glass wool	46	1 x 10mm EPB FireSmart on Internal side James Hardie Linea™ Oblique™ Weatherboard horizontal to External side	34
EJOv1TL30	-F10	30/30/30	R2.2 glass wool	46	1 x 10mm EPB FireSmart on Internal side James Hardie Linea™ Oblique™ Weatherboard vertical to External side	35
EJOh1TL60	-M13	60/60/60	R2.2 glass wool	47	1 x 13mm EPB MultiSmart on Internal side James Hardie Linea™ Oblique™ Weatherboard horizontal to External side	36
EJOv1TL60	-M13	60/60/60	R2.2 glass wool	47	1 x 13mm EPB MultiSmart on Internal side James Hardie Linea™ Oblique™ Weatherboard vertical to External side	37
EPB Plaste	rboard	& James H	lardie™ P	lank W	eatherboard	
EJW1TL30	-F10	30/30/30	R2.2 glass wool	45	1 x 10mm EPB FireSmart on Internal side James Hardie™ Plank Weatherboard to External side	38
EJW1TL60	-M13	60/60/60	Hardie™ Mineral	46	1 x 13mm EPB MultiSmart on Internal side James Hardie™ Plank Weatherboard to External side	39
EPB Plaste	rboard	& James H	lardie Stri	a™ Cla	idding	
EJSh1TL30	-F10	30/30/30	R2.2 glass wool	46	1 x 10mm EPB FireSmart on Internal side James Hardie Stria™ Cladding horizontal to External side	40
EJSv1TL30	-F10	30/30/30	R2.2 glass wool	46	1 x 10mm EPB FireSmart on Internal side James Hardie Stria™ Cladding vertical to External side	41
EJSh1TL60	-M13	60/60/60	R2.2 glass wool	47	1 x 13mm EPB MultiSmart on Internal side James Hardie Stria™ Cladding horizontal to External side	42
EJSv1TL60	-M13	60/60/60	R2.2 glass wool	47	1 x 13mm EPB MultiSmart on Internal side James Hardie Stria™ Cladding vertical to External side	43
EPB Plaste	rboard	& James H	lardie Stri	a™ Cla	dding & RAB [™] Board with CLD Battens	
EJRS1TL30	-F10	30/30/30	R2.2 glass wool	46	1 x 10mm EPB FireSmart on Internal side James Hardie Stria™ Cladding and RAB™ Board with CLD™ Structural Cavity Batten to External side	44
EJRS1TL60	-M13	60/60/60	Hardie™ Mineral	47	1 x 13mm EPB MultiSmart on Internal side James Hardie Stria™ Cladding and RAB™ Board with CLD™ Structural Cavity Batten to External side	45
EPB Plaste	rboard	& James H	lardie Hai	rdie™ F	lex Sheet	
EJF1TL30	-F10	30/30/30	R2.2 glass wool	42	1 x 10mm EPB FireSmart on Internal side James Hardie Hardie™ Flex Sheet to External side	46
EJF1TL60	-M13	60/60/60	Hardie™ Mineral	43	1 x 13mm EPB MultiSmart on Internal side James Hardie Hardie™ Flex Sheet to External side	47

External Fire Rated Walls - Timber Frame

System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirements	Page
EPB Plaste	erboard	& James H	lardie Axo	on™ Pa	anel	
EJA1TL30	-F10	30/30/30	R2.2 glass wool	41	1 x 10mm EPB FireSmart on Internal side James Hardie Axon™ Panel to External side	48
EJA1TL60	-M13	60/60/60	Hardie™ Mineral	42	1 x 13mm EPB MultiSmart on Internal side James Hardie Axon™ Panel to External side	49
EPB Plaste	erboard	& James H	lardie Axo	on™ Pa	anel & RAB [™] Board with CLD Battens	
EJRA1TL30	-F10	30/30/30	R2.2 glass wool	45	1 x 10mm EPB FireSmart on Internal side James Hardie Axon™ Panel and RAB™ Board with CLD™ Structural Cavity Batten to External side	50
EJRA1TL60	-M13	60/60/60	Hardie™ Mineral	46	1 x 13mm EPB MultiSmart on One side James Hardie Axon™ Panel and RAB™ Board with CLD™ Structural Cavity Batten to External side	51
EPB Plaste	erboard	& James H	lardie Eas	yLap™	Panel	
EJE1TL30	-F10	30/30/30	R2.2 glass wool	46	1 x 10mm EPB FireSmart on Internal side James Hardie EasyLap™ Panel to External side	52
EJE1TL60	-M13	60/60/60	Hardie™ Mineral	47	1 x 13mm EPB MultiSmart on Internal side James Hardie EasyLap™ Panel to External side	53
EPB Plaste	erboard	& James H	lardie Eas	yLap™	Panel & RAB [™] Board with CLD Battens	
EJRE1TL30	-F10	30/30/30	R2.2 glass wool	46	1 x 10mm EPB FireSmart on Internal side James Hardie EasyLap™ Panel and RAB™ Board with CLD™ Structural Cavity Batten to External side	54
EJRE1TL60	-M13	60/60/60	Hardie™ Mineral	47	1 x 13mm EPB MultiSmart on Internal side James Hardie EasyLap™ Panel and RAB™ Board with CLD™ Structural Cavity Batten to External side	55
EPB Plaste	erboard	& James H	lardie Exc	Тес™	Facade Panel & RAB™Board	
EJRX1TL30	-F10	30/30/30	R2.2 glass wool	47	1 x 10mm EPB FireSmart on Internal side James Hardie ExoTec™ Facade Panel and RAB™ Board with Top hat system to External side	56
EJRX1TL60	-M13	60/60/60	Hardie™ Mineral	48	1 x 13mm EPB MultiSmart on Internal side James Hardie ExoTec™ Facade Panel and RAB™ Board with Top hat system to External side	57
EPB Plaste	erboard	& James H	lardie RA	В™ Воа	ard & a Weathertight Cladding ^(See Note 1)	
EJRN1TL30	-F10	30/30/30	R2.2 glass wool	42	1 x 10mm EPB FireSmart on Internal side James Hardie RAB™ Board with a Weathertight Cladding to External side	58
EJRN1TL60	-M13	60/60/60	Hardie™ Mineral	42	1 x 13mm EPB MultiSmart on Internal side James Hardie RAB™ Board with a Weathertight Cladding to External side	59
	-F20	60/60/60	Hardie™ Mineral	46	2 x 10mm EPB FireSmart on Internal side James Hardie RAB™ Board with a Weathertight Cladding to External side	60
EJRN2TL60	-S26	60/60/60	Hardie™ Mineral	47	2 x 13mm EPB Standard on Internal side James Hardie RAB™ Board with a Weathertight Cladding to External side	60
	-M20	60/60/60	Hardie™ Mineral	47	2 x 10mm EPB MultiSmart on Internal side James Hardie RAB™ Board with a Weathertight Cladding to External side	60

Note1 : It is important to consider that the fire properties of the external cladding is in accordance with NZBC C/VM1 or C/AS documents. Refer to Table 5.1 of Section 5.4 of C/AS1 and Table 5.5 of Section 5.8.1 of C/AS2 for the information about various risk groups to identify the external fire spread safety requirement applicable to the exterior surface finishes.

Freephone 0800 353 742

External Fire Rated Walls - Steel Frame

System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirements	Page
EPB Plaste	rboard	l & RAB™ b	oard with	n Select	ted James Hardie Fibre Cement Cladding	
	-M13	30/30/30	Hardie™ Mineral	42 - 47	1 x 13mm EPB MultiSmart on Internal side James Hardie RAB™ Board with Selected James Hardie Fibre Cement cladding to External side	62
EJRH1SL30	-F16	30/30/30	Hardie™ Mineral	42 - 47	1 x 16mm EPB FireSmart on Internal side James Hardie RAB™ Board with Selected James Hardie Fibre Cement cladding to External side	62
EJRH2SL30	-F20	30/30/30	Hardie™ Mineral	47 - 53	2 x 10mm EPB FireSmart on Internal side James Hardie RAB [™] Board with Selected James Hardie Fibre Cement cladding to External side	64
EJRH2SL60	-M26	60/60/60	Hardie™ Mineral	51 - 54	2 x 13mm EPB MultiSmart on Internal side James Hardie RAB™ Board with Selected James Hardie Fibre Cement cladding to External side	66
EPB Plaste	rboard	& James H	lardie RA	В™ Воа	ard & a Weathertight Cladding ^(See Note 1)	
EJRN1SL30	-M13	30/30/30	Hardie™ Mineral	42	1 x 13mm EPB MultiSmart on Internal side James Hardie RAB™ Board with a Weathertight Cladding to External side	68
EJRINTSESU	-F16	30/30/30	Hardie™ Mineral	43	1 x 16mm EPB FireSmart on Internal side James Hardie RAB™ Board with a Weathertight Cladding to External side	68
EJRN2SL30	-F20	30/30/30	Hardie™ Mineral	47	2 x 10mm EPB FireSmart on Internal side James Hardie RAB™ Board with a Weathertight Cladding to External side	70
EJRN2SL60	-M26	60/60/60	Hardie™ Mineral	49	2 x 13mm EPB MultiSmart on Internal side James Hardie RAB™ Board with a Weathertight Cladding to External side	72

Internal Fire Rated Walls - Timber Frame


System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirements	Page		
EPB Plaste	PB Plasterboard & James Hardie Villaboard™ Lining							
EJV1TL30	-F10	30/30/30	R2.2 glass wool	42	1 x 10mm EPB FireSmart one side James Hardie Villaboard™ Lining other side	75		
EJV1TL60	-M13	60/60/60	Hardie™ Mineral	43	1 x 13mm EPB MultiSmart one side James Hardie Villaboard™ Lining other side	76		

Floor/Ceilings - Timber Frame

System	Lining	FRR	Insulation	Noise Control		Lining Requirements to underside of Frame	Page				
Number	Suffix			STC	IIC		- J				
EPB Plasterboard & James Hardie Secura™ Interior Flooring											
EJS1FC30	-M13	30/30/30	n/a	45	33	1 x 13mm EPB MultiSmart to underside of frame	78				
EJS1FC60	-F16	60/60/60	n/a	46	33	1 x 16mm EPB FireSmart to underside of frame	79				

Full Intertenancy - Floating Floor/Ceilings - Timber Frame

System Number	Lining Suffix	FRR	Insulation		oise ntrol IIC	Lining Requirements to underside of Frame	Page			
EPB Plaste	EPB Plasterboard & Floating James Hardie Secura™ Interior Flooring									
	-MS26	60/60/60	R1.8 glass wool	67	57-76	1 x 13 EPB MultiSmart And 1 x 13 EPB Standard under the battens	82			
EFJ2DFA60	-M26	60/60/60	R1.8 glass wool	68	57-77	2 x 13 EPB MultiSmart under the battens	82			

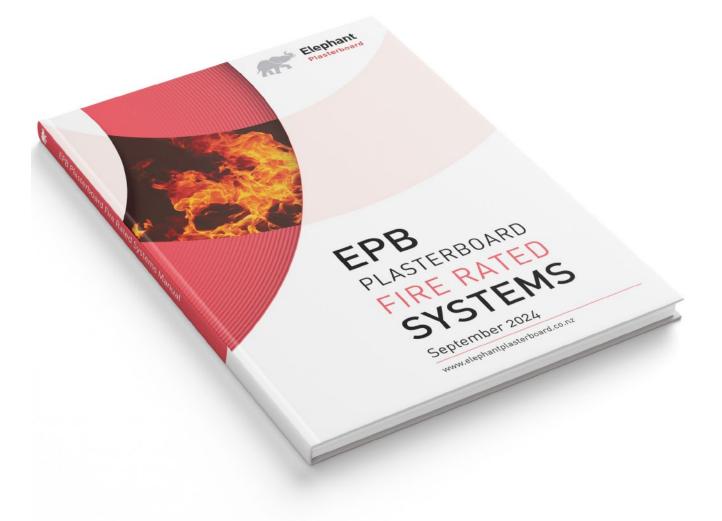

For Non-Acoustic Fire Rated system options, go to

EPB Plasterboard Fire Rated Systems Manual

Fire Rated Walls

System	Lining	FRR	Load Bearing	No Con	ise trol	Lining Requirements	Pag
Number	Suffix		Ability	STC	Rw		
Timber	Frame	Walls - Two	Way FR	R			
	-S20	30/30/30	LB	37	36	1 x 10mm EPB Standard each side	
E2TL30	-F20	30/30/30	LB	37	36	1 x 10mm EPB FireSmart each side	
	-S26	30/30/30	LB	37	36	1 x 13mm EPB Standard each side	
E4TL45	-S40	45/45/45	LB	42	41	2 x 10mm EPB Standard each side	
E4T60	-S40	-/60/60	NLB	42	41	2 x 10mm EPB Standard each side	
E2TL60	-F26	60/60/60	LB	38	37	1 x 13mm EPB FireSmart each side	
	-F40	60/60/60	LB	42	41	2 x 10mm EPB FireSmart each side	
	-S46	60/60/60	LB	42	41	1 x 10mm EPB Standard and 1 x 13mm EPB Standard each side	
E4TL60	-MS40	60/60/60	LB	42	41	1 x 10mm EPB Standard and 1 x 10mm EPB MultiSmart each side	1
	-\$52	60/60/60	LB	43	42	2 x 13mm EPB Standard each side	1
E2TL75	-F32	75/75/75	LB	38	37	1 x 16mm EPB FireSmart each side	-
	-FS52	-/90/90	NLB	43	42	1 x 13mm EPB FireSmart and 1 x 13mm EPB Standard each side	
E4T90	-FM46	-/90/90	NLB	43	42	1 x 13mm EPB FireSmart and 1 x 10mm EPB MultiSmart each side	
E4TL90	-F52	90/90/90	LB	45	44	2 x 13mm EPB FireSmart each side	
E4T105	-F52	-/105/105	NLB	44	43	2 x 13mm EPB FireSmart each side	
E4T120	-F58	-/120/120	NLB	46	45	1 x 16mm EPB FireSmart and 1 x 13mm EPB FireSmart each side	
E6TL120	-F78	120/120/120	LB	44	43	3 x 13mm EPB FireSmart each side	
	-F10	30/30/30	LB	46	45	1 x 10mm EPB FireSmart one side Brick Veneer other side	
EBV1TL30	-S13	30/30/30	LB	46	45	1 x 13mm EPB Standard one side Brick Veneer other side	-
EBV1TL60	-F13	60/60/60	LB	46	45	1 x 13mm EPB FireSmart one side Brick Veneer other side	-
Steel Fra	ame W	alls - Two W	ay FRR				
E2SL15	-S26	15/15/15	LB	35	34	1 x 13mm EPB Standard each side	
	-S26	-/30/30	NLB	35	34	1 x 13mm EPB Standard each side	
E2S30	-M20	-/30/30	NLB	36	35	1 x 10mm EPB MultiSmart each side	
	-M26	30/30/30	LB	37	36	1 x 13mm EPB MultiSmart each side	
E2SL30	-F32	30/30/30	LB	37	36	1 x 16mm EPB FireSmart each side	
	-F40	30/30/30	LB	43	42	2 x 10mm EPB FireSmart each side	
4SL30	-\$52	30/30/30	LB	43	42	2 x 13mm EPB Standard each side	
E2S60	-M26	-/60/60	NLB	37	36	1 x 13mm EPB MultiSmart each side (requires wall insulation)	1

Fire Rated Walls

System	Lining	FRR	Load Bearing	No Con		Lining Requirements	Pag
Number	Suffix		Ability	STC	Rw	Linnig requirements	Tag
E4S60	-\$52	-/60/60	NLB	45	44	2 x 13mm EPB Standard each side	
E4300	-M40	-/60/60	NLB	45	44	2 x 10mm EPB MultiSmart each side	
E4SL60	-F52	60/60/60	LB	46	45	2 x 13mm EPB FireSmart each side	
E2S75	-F32	-/75/75	NLB	38	37	1 x 16mm EPB FireSmart each side	
E4S90	-M46	-/90/90	NLB	45	44	1 x 10mm EPB MultiSmart and 1 x 13mm EPB MultiSmart each side	
E4SL90	-F64	90/90/90	LB	47	46	2 x 16mm EPB FireSmart each side	_
E4S120	-F58	-/120/120	NLB	46	45	1 x 16mm EPB FireSmart and 1 x 13mm FireSmart each side	Please
Double	Steel F	rame Wall v	vith Fire	Smai	rt Cei	ntral Liner - Two Way FRR	
E2CSD60	-F26	-/60/60	NLB	44	43	1 x 13mm EPB FireSmart each side (requires wall insulation)	reter E

Fire Rated Universal Walls

System	Lining	FRR	Load Bearing		ise trol	Lining Requirements
Number	Suffix		Ability	STC	Rw	
Univers	al Timk	per or Steel	Frame V	/all -	One	Way FRR
E1UW15	-S13	15/15/15	LB	-	-	1 x 13mm EPB Standard one side
E1UW30	-F16a	30/30/30	LB	-	-	1 x 16mm EPB FireSmart one side
E2UW30	-F20	30/30/30	LB	-	-	2 x 10mm EPB FireSmart one side
E2UW45	-F26	45/45/45	LB	-	-	2 x 13mm EPB FireSmart one side
E2UW60	-F26a	60/60/60	LB	-	-	2 x 13mm EPB FireSmart one side
E20000	-F29	60/60/60	LB	-	-	1 x 16mm EPB FireSmart and 1 x 13mm EPB FireSmart one side
F21 114/00	-F39a	90/90/90	LB	-	-	3 x 13mm EPB FireSmart one side
E3UW90	-F42	90/90/90	LB	-	-	1 x 16mm EPB FireSmart and 2 x 13mm EPB FireSmart one side
E3UW120	-F45a	120/120/120	LB	-	-	1 x 13mm EPB FireSmart and 2 x 16mm EPB FireSmart one side

September 2024

Fire Rated Walls with simultaneous fire exposure on both sides

System Lining		FKK	Load Bearing	Noise Control		Lining Requirements
	Suffix		Ability	STC	Rw	
Single T	imber	Frame Wall	with Sin	nulta	neou	is Fire Exposure on Both sides - Two Way FRR
E2TL30S	-F26	30/-/-	LB	38	37	1 x 13mm EPB FireSmart each side
E4TL60S	-F52	60/-/-	LB	46	45	2 x 13mm EPB FireSmart each side

Smoke Separation Walls

System	Lining	FRR	Load Bearing	No Con	ise trol	Lining Requirements	Page				
Number Suffi	Suffix	ix	Ability	STC	Rw		rage				
Smoke	Smoke Separation - Timber or Steel Frame Wall - Two Way FRR										
E2sm10	-	10/10/10	LB	-	-	1 x Minimum 10mm EPB Plasterboard each side					

Fire Rated Floor/Ceilings

System	Lining	FD 2	Load		Noise Contro	1	
Number	Suffix	FRR	Bearing Ability	STC	Rw	IIC	Lining Requirements
Floor/C	eiling						
E1FC15	-\$13	15/15/15	LB	38	37	31	1 x 13mm EPB Standard
E1FC30	-F13	30/30/30	LB	39	39	32	1 x 13mm EPB FireSmart
E2FC30	-\$26	30/30/30	LB	39	38	32	2 x 13mm EPB Standard
E1FC45	-F13	45/45/45	LB	39	39	32	1 x 13mm EPB FireSmart
E1FC60	-F16	60/60/60	LB	39	38	32	1 x 16mm EPB FireSmart
	-FS26	60/60/60	LB	40	39	33	1 x 13mm EPB FireSmart and 1 x 13mm EPB Standard
E2FC60	-F26	60/60/60	LB	41	40	34	2 x 13mm EPB FireSmart
E2FC90	-F29	90/90/90	LB	41	40	34	1 x 16mm EPB FireSmart and 1 x 13mm EPB FireSmart
E3FC120	-F39	120/120/120	LB	43	42	35	3 x 13mm EPB FireSmart
Compo	site Joi	st Floor/Cei	ling				
E1CJ30	-F13	30/30/30	LB	39	38	32	1 x 13mm EPB FireSmart
E2CJ30	-\$26	30/30/30	LB	39	38	32	2 x 13mm EPB Standard
E1CJ45	-F13	45/45/45	LB	39	38	32	1 x 13mm EPB FireSmart
E1CJ60	-F16	60/60/60	LB	39	38	32	1 x 16mm EPB FireSmart
E2CJ60	-FS26	60/60/60	LB	40	39	33	1 x 13mm EPB FireSmart and 1 x 13mm EPB Standard
Steel Jo	ist Floc	or/Ceiling					
E1SJ30	-F13	30/30/30	LB	35	34	31	1 x 13mm EPB FireSmart
E2SJ60	-F26	60/60/60	LB	39	38	32	2 x 13mm EPB FireSmart
Battene	d Floo	r/Ceiling					
E1BC30	-F13	30/30/30	LB	35	34	31	1 x 13mm EPB FireSmart
E1BC60	-F16	60/60/60	LB	39	38	32	1 x 16mm EPB FireSmart
Direct F	ix Clip	Floor/Ceilin	g				
E1DF45	-F13	45/45/45	LB	49	48	42	1 x 13mm EPB FireSmart
E1DF60	-F16	60/60/60	LB	49	48	43	1 x 16mm EPB FireSmart

Fire Rated Floor/Ceilings

				-				
System	Lining	FRR	Load Bearing		Noise Contro	I	Lining Requirements	Page
Number	Suffix		Ability	STC	Rw	IIC		
E2DF60	-FS26	60/60/60	LB	49	48	43	1 x 13mm EPB FireSmart and 1 x 13mm EPB Standard	
	-F26	60/60/60	LB	52	51	43	2 x 13mm EPB FireSmart	
E2DF90	-F32	90/90/90	NLB	54	53	43	2 x 16mm EPB FireSmart	
E3DF120	-F39	120/120/120	LB	54	53	43	3 x 13mm EPB FireSmart	
Suspen	ded Gr	id Floor/Cei	ling					
E2SC30	-S26	30/30/30	LB	50	49	42	2 x 13mm EPB Standard	Φ
E1SC45	-F13	45/45/45	LB	48	47	42	1 x 13mm EPB FireSmart	leas
E1SC60	-F16	60/60/60	LB	48	47	43	1 x 16mm EPB FireSmart	e refe
E1XC60	-F16	60/60/60	LB	48	47	43	1 x 16mm EPB FireSmart	er EP
525660	-FS26	60/60/60	LB	48	47	42	1 x 13mm EPB FireSmart and 1 x 13mm EPB Standard	B Fir
E2SC60	-F26	60/60/60	LB	51	50	42	2 x 13mm EPB FireSmart	e Rat
E2SC90	-F32	90/90/90	LB	53	52	43	2 x 16mm EPB FireSmart	ted S
E2XC90	-F29	90/90/90	LB	48	47	43	1 x 16mm EPB FireSmart and 1 x 13mm EPB FireSmart	Please refer EPB Fire Rated System

Fire Rated Universal Ceilings

System	Lining	FRR	Load Bearing		Noise Contro	I	Lining Requirements
Number	Suffix		Ability	STC	Rw	IIC	Lining requirements
Univers	al Ceili	ng - Timber	or Steel	Fran	ne		
E1UC15	-F13	15/15/15	LB	-	-	-	1 x 13mm EPB FireSmart
E1UC30	-F16a	30/30/30	LB	-	-	-	1 x 16mm EPB FireSmart
5211662	-F26a	60/60/60	LB	-	-	-	2 x 13mm EPB FireSmart
E2UC60	-F29	60/60/60	LB	-	-	-	1 x 16mm EPB FireSmart and 1 x 13mm EPB FireSmart
E3UC90	-F39a	90/90/90	LB	-	-	-	3 x 13mm EPB FireSmart
	-F42	90/90/90	LB	-	-	-	1 x 16mm EPB FireSmart and 2 x 13mm EPB FireSmart

r EPB Fire Rated Systems Manual for these System Specification sheets

12

Fire Rated Speciality Systems


System	Lining		Load			Control TC			
Number	Suffix	FRR	Bearing Ability	64mm	Stud	102mm Stud		Lining Requirements	Page
			,,	No Fill	Fill	No Fill	Fill		
Shaft M/	all Eire	e Rated fror	n Chaft (Sido o	nly				
Shartwa			n Shart .	Side o	ппу	1			
E1SWS60	-F13	-/60/60	NLB	39	45	42	46	1 x 13mm EPB FireSmart	
E2SWS90	-F26	-/90/90	NLB	43	49	46	50	2 x 13mm EPB FireSmart	
E2SWS120	-F29	-/120/120	NLB	44	50	46	51	1 x 16mm EPB FireSmart and 1 x 13mm EPB FireSmart	_
Shaft Wa	all - Fire	e Rated fror	n Either	Side					
E1SWE30	-F13	-/30/30	NLB	39	45	42	46	1 x 13mm EPB FireSmart	P
E2SWE60	-F26	-/60/60	NLB	43	49	46	50	2 x 13mm EPB FireSmart	Please
E2SWE90	-F29	-/90/90	NLB	44	50	46	51	1 x 16mm EPB FireSmart and 1 x 13mm EPB FireSmart	e refer
E3SWE120	-F42	-/120/120	NLB	46	51	48	52	1 x 16mm EPB FireSmart and 2 x 13mm EPB FireSmart	er EPI
EPB Sha	ft Pane			•	•		•		EPB Fire

EPB Shaft Panel

Fire Rated Columns & Beams

System	Lining	FRR	Load Bearing	No Con	ise trol	Lining Requirements
Number	Suffix		Ability	STC	Rw	
Steel Co	lumn 8	Beam - Tin	nber Stra	appe	d	
E1CBT15	-S13	15/-/-	LB	-	-	1 x 13mm EPB Standard
E1CBT30	-F16	30/-/-	LB	-	-	1 x 16mm EPB FireSmart
E2CBT30	-F20	30/-/-	LB	-	-	2 x 10mm EPB FireSmart
E2CBT60	-F26	60/-/-	LB	-	-	2 x 13mm EPB FireSmart
E2CBT90	-F32	90/-/-	LB	-	-	2 x 16mm EPB FireSmart
E3CBT120	-F45	120/-/-	LB	-	-	1 x 13mm EPB FireSmart and 2 x 16mm EPB FireSmart
Steel Co	lumn 8	Beam - Ste	el Clip a	nd C	hanr	nel
E1CBS15	-S13	15/-/-	LB	-	-	1 x 13mm EPB Standard
E1CBS30	-F16	30/-/-	LB	-	-	1 x 16mm EPB FireSmart
E2CBS30	-F20	30/-/-	LB	-	-	2 x 10mm EPB FireSmart
E2CBS60	-F26	60/-/-	LB	-	-	2 x 13mm EPB FireSmart
E2CBS90	-F32	90/-/-	LB	-	-	2 x 16mm EPB FireSmart
E3CBS120	-F45	120/-/-	LB	-	-	1 x 13mm EPB FireSmart and 2 x 16mm EPB FireSmart

r EPB Fire Rated Systems Manual for these System Specification sheets

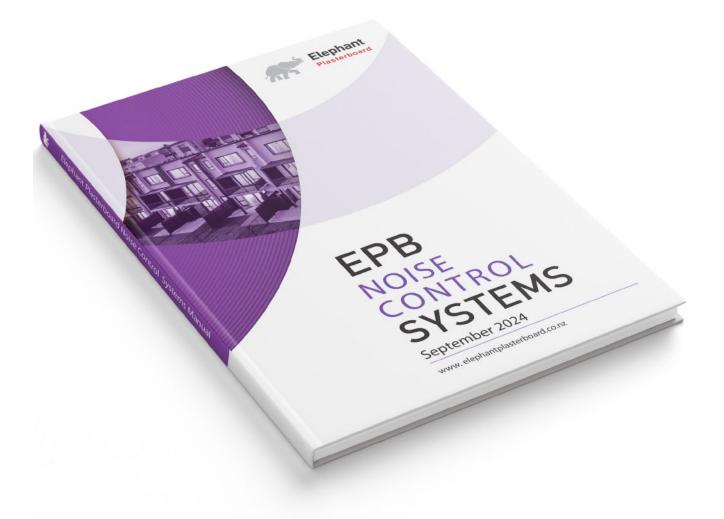

For Noise Control Fire Rated system options, go to

EPB Plasterboard Noise Control Systems Manual

September 2024

Full Intertenancy - Fire Rated Walls

System Number	Lining Suffix	FRR	Load Bearing Ability	No Con STC	ise trol Rw	Lining Requirements	Page
Timber I	Double	e Frame Wa	lls - Loa	d Be	aring	l de la constante de	
	-F30	30/30/30	LB	55	54	1 x 10mm EPB FireSmart one side 2 x 10mm EPB FireSmart other side	
E3TDLA30	-\$39	30/30/30	LB	57	56	1 x 13mm EPB Standard one side 2 x 13mm EPB Standard other side	_
	-M30	30/30/30	LB	58	57	1 x 10mm EPB MultiSmart one side 2 x 10mm EPB MultiSmart other side	_
E4TDLA45	-S40	45/45/45	LB	58	57	2 x 10mm EPB Standard each side	_
E2TDLA60	-M26	60/60/60	LB	55	54	1 x 13mm EPB MultiSmart each side	Plea
	-MS39	60/60/60	LB	58	57	1 x 13mm EPB MultiSmart one side 2 x 13mm EPB Standard other side	Please refer to the
E3TDLA60	-M33	60/60/60	LB	59	58	1 x 13mm EPB MultiSmart one side 2 x 10mm EPB MultiSmart other side	fer t
	-M39	60/60/60	LB	61	60	1 x 13mm EPB MultiSmart one side 2 x 13mm EPB MultiSmart other side	o the
	-S46	60/60/60	LB	59	58	1 x 10mm EPB Standard and 1 x 13mm EPB Standard each side	
E4TDLA60	-F40	60/60/60	LB	60	59	2 x 10mm EPB FireSmart each side	Nois
	-S52	60/60/60	LB	61	60	2 x 13mm EPB Standard each side	ie Co
	-M40	60/60/60	LB	62	61	2 x 10mm EPB MultiSmart each side	ntro
E2TDLA75	-F32	75/75/75	LB	56	55	1 x 16mm EPB FireSmart each side	Syst
E4TDLA90	-F52	90/90/90	LB	64	63	2 x 13mm EPB FireSmart each side	tems
-	-M52	90/90/90	LB	67	66	2 x 13mm EPB MultiSmart each side	EPB Noise Control Systems Manual for th
limber S	single	-rame Wall	s with R	esilie	ent M	lount - Load Bearing	ua
E3TMLA30	-S39	30/30/30	LB	55	54	Framing Side: 1 x 13mm EPB Standard Mount Side: 2 x 13mm EPB Standard	lfor
	-M30	30/30/30	LB	56	55	Framing Side: 1 x 10mm EPB MultiSmart Mount Side: 2 x 10mm EPB MultiSmart	these
E4TMLA30	-S40	30/30/30	LB	58	57	Framing Side: 2 x 10mm EPB FireSmart Mount Side: 2 x 10mm EPB FireSmart	e Sys
E4TMLA45	-S52	45/45/45	LB	61	60	Framing Side: 2 x 13mm EPB Standard Mount Side: 2 x 13mm EPB Standard	tem
E3TMLA60	-M39	60/60/60	LB	58	57	Framing Side: 1 x 13mm EPB MultiSmart Mount Side: 2 x 13mm EPB MultiSmart	Spec
E4TMLA60	-M40	60/60/60	LB	62	61	Framing Side: 2 x 10mm EPB MultiSmart Mount Side: 2 x 10mm EPB MultiSmart	ificat
E4TMLA90	-M52	90/90/90	LB	63	62	Framing Side: 2 x 13mm EPB MultiSmart Mount Side: 2 x 13mm EPB MultiSmart	System Specification sheets
Timber	single	-rame Wall	s with R	esilie	ent R	ail - Load Bearing	she
E4TRLA45	-S52	45/45/45	LB	55	54	Framing Side: 2 x 13mm EPB Standard Rail Side: 2 x 13mm EPB Standard	ets
E4TRLA60	-M40	60/60/60	LB	55	54	Framing Side: 2 x 10mm EPB MultiSmart Rail Side: 2 x 10mm EPB MultiSmart	_
E4TRLA90	-F52	90/90/90	LB	56	55	Framing Side: 2 x 13mm EPB FireSmart Rail Side: 2 x 13mm EPB FireSmart	
	-M52	90/90/90	LB	57	56	Framing Side: 2 x 13mm EPB MultiSmart Rail Side: 2 x 13mm EPB MultiSmart	

Full Intertenancy - Fire Rated Walls

System Number	Lining Suffix	FRR	Load Bearing Ability		ise trol Rw	Lining Requirements	Page
Steel Do	uble F	rame Walls	- Non L	oad	Beari	ing	
E3SDA30	-\$39	-/30/30	NLB	55	54	1 x 13mm EPB Standard one side 2 x 13mm EPB Standard other side	
ESSDASU	-M30	-/30/30	NLB	56	55	1 x 10mm EPB MultiSmart one side 2 x 10mm EPB MultiSmart other side	
E4SDA45	-F40	-/45/45	NLB	58	57	2 x 10mm EPB FireSmart each side	
E2SDA60	-M26	-/60/60	NLB	55	54	1 x 13mm EPB MultiSmart each side	
	-MS39	-/60/60	NLB	57	56	1 x 13mm EPB MultiSmart one side 2 x 13mm EPB Standard other side	Plea
	-FM33	-/60/60	NLB	58	57	1 x 13mm EPB FireSmart one side 2 x 10mm EPB MultiSmart other side	Please refer to the
E3SDA60	-M33	-/60/60	NLB	58	57	1 x 13mm EPB MultiSmart one side 2 x 10mm EPB MultiSmart other side	fer to
	-M39	-/60/60	NLB	61	60	1 x 13mm EPB MultiSmart one side 2 x 13mm EPB MultiSmart other side	o the
FACDACO	-\$52	-/60/60	NLB	61	60	2 x 13mm EPB Standard each side	
E4SDA60	-M40	-/60/60	NLB	61	60	2 x 10mm EPB MultiSmart each side	Nois
E2SDA75	-F32	-/75/75	NLB	56	55	1 x 16mm EPB FireSmart each side	ie Co
E4SDA75	-MS52	-/75/75	NLB	63	62	1 x 13mm EPB Standard and 1x13mm EPB MultiSmart each side	ntro
	-F52	-/90/90	NLB	62	61	2 x 13mm EPB FireSmart each side	l Syst
E4SDA90	-M46	-/90/90	NLB	63	62	1 x 10mm EPB MultiSmart and 1 x 13mm EPB MultiSmart each side	iems
	-M52	-/90/90	NLB	65	64	2 x 13mm EPB MultiSmart each side	EPB Noise Control Systems Manual for the
Steel Do	uble F	rame Walls	- Load	Beari	ng		ua
E2SDLA30	-M26	30/30/30	LB	55	54	1 x 13mm EPB MultiSmart each side	for t
LZJDLAJU	-F32	30/30/30	LB	56	55	1 x 16mm EPB FireSmart each side	
E3SDLA30	-MF33	30/30/30	LB	58	57	1 x 13mm EPB MultiSmart one side 2 x 10mm EPB FireSmart other side	e Sys
ESSDLASU	-M39	30/30/30	LB	61	60	1 x 13mm EPB MultiSmart one side 2 x 13mm EPB MultiSmart other side	tem
E4SDLA30	-F40	30/30/30	LB	59	58	2 x 10mm EPB FireSmart each side	Spec
	-S52	45/45/45	LB	61	60	2 x 13mm EPB Standard each side	ifica
E4SDLA45	-M40	45/45/45	LB	61	60	2 x 10mm EPB MultiSmart each side	tion
E4SDLA60	-M52	60/60/60	LB	65	64	2 x 13mm EPB MultiSmart each side	System Specification sheets
E4SDLA90	-F64	90/90/90	LB	66	65	1 x 16mm EPB FireSmart each side	ţ

September 2024

Full Intertenancy - Fire Rated Walls

System Number	Lining Suffix	FRR	Load Bearing Ability	No Con STC		Lining Requirements	Page
Steel Do	uble F	rame Walls	with Fi	reSm	art C	entral Liner - Non Load Bearing	
E4CSDA60	-MS46	-/60/60	NLB	56	56	1 x 13mm EPB FireSmart and 1 x 10mm EPB Standard each side	_
LACIDAGO	-MS52	-/60/60	NLB	57	58	1 x 13mm EPB FireSmart And 1 x 13mm EPB Standard each side	
Steel Fra	ime Wa	alls with Re	silient N	Лоип	t - N	on Load Bearing	
E3SMA30	-M30	-/30/30	NLB	55	54	Frame Side: 1 x 10mm EPB MultiSmart Mount Side: 2 x 10mm EPB MultiSmart	-
E4SMA30	-F40	-/30/30	NLB	56	55	Frame Side: 2 x 10mm EPB FireSmart Mount Side: 2 x 10mm EPB FireSmart	Plea
E3SMA60	-MS39	-/60/60	NLB	56	55	Frame Side: 1 x 13mm EPB MultiSmart Mount Side: 2 x 13mm EPB Standard	ase ro
235111100	-M39	-/60/60	NLB	57	56	Frame Side: 1 x 13mm EPB MultiSmart Mount Side: 2 x 13mm EPB MultiSmart	Please refer to the
E4SMA60	-\$52	-/60/60	NLB	58	57	Frame Side: 2 x 13mm EPB Standard Mount Side: 2 x 13mm EPB Standard	5 th
LIJMAOU	-M40	-/60/60	NLB	59	58	Frame Side: 2 x 10mm EPB MultiSmart Mount Side: 2 x 10mm EPB MultiSmart	e EPI
E4SMA90	-M46	-/90/90	NLB	60	59	Frame Side: 1 x 13mm EPB MultiSmart and 1 x 10mm EPB MultiSmart Mount Side: 1 x 13mm EPB MultiSmart and 1 x 10mm EPB MultiSmart	BNO
E43IMA90	-M52	-/90/90	NLB	62	61	Frame Side: 2 x 13mm EPB MultiSmart Mount Side: 2 x 13mm EPB MultiSmart	ise C
Steel Fra	me Wa	alls with Re	silient F	Rail -	Non	Load Bearing	n St
E4SRA60	-S52	-/60/60	NLB	55	54	Frame Side: 2 x 13mm EPB Standard Rail Side: 2 x 13mm EPB Standard	trols
E43KA00	-M40	-/60/60	NLB	56	55	Frame Side: 2 x 10mm EPB MultiSmart Rail Side: 2 x 10mm EPB MultiSmart	EPB Noise Control Systems Manual for thes
	-M46	-/90/90	NLB	57	56	Frame Side: 1 x 13mm EPB MultiSmart and 1 x 10mm EPB MultiSmart Rail Side: 1 x 13mm EPB MultiSmart and 1 x 10mm EPB MultiSmart	ms N
E4SRA90	-F52	-/90/90	NLB	57	56	Frame Side: 2 x 13mm EPB FireSmart Rail Side: 2 x 13mm EPB FireSmart	lanu
	-M52	-/90/90	NLB	59	58	Frame Side: 2 x 13mm EPB MultiSmart Rail Side: 2 x 13mm EPB MultiSmart	al for
Quiet St	eel Fra	me Walls -	Non Lo	ad Be	arin	g	÷
E4SQA30	-F40	-/30/30	NLB	55	54	2 x 10mm EPB FireSmart each side	D D
E4SQA45	-S46	-/45/45	NLB	56	55	1x 10mm EPB Standard and 1 x 13mm Standard each side	yste
	-M33	-/60/60	NLB	55	54	1 x 13mm EPB MultiSmart one side 2 x 10mm EPB MultiSmart other side	m Sp
E3SQA60	-M36	-/60/60	NLB	55	54	1 x 13mm EPB MultiSmart one side 1 x 10mm EPB MultiSmart and 1 x 13mm EPB MultiSmart other side	oecifi
	-M39	-/60/60	NLB	57	56	1 x 13mm EPB MultiSmart one side 2 x 13mm EPB MultiSmart other side	catio
E4SQA60	-S52	-/60/60	NLB	57	56	2 x 13mm EPB Standard each side	System Specification sheets
2132/100	-M40	-/60/60	NLB	57	56	2 x 10mm EPB MultiSmart each side	eets
E4SQA75	-MS52	-/75/75	NLB	59	58	1 x13mm EPB MultiSmart and 1x13mm EPB Standard each side	
E4SQA90	-M46	-/90/90	NLB	59	58	1 x 10mm EPB MultiSmart and 1 x 13mm EPB MultiSmart each side	_
50,000	-M52	-/90/90	NLB	61	60	2 x 13mm EPB MultiSmart each side	

Full Intertenancy - Fire Rated Walls

System Number	Lining Suffix	FRR	Load Bearing Ability	No Con STC		Lining Requirements	Page
Stagger	ed Stee	el Stud Wal	ls - Non	Load	l Bea	ring	
E3SSA30	-\$39	-/30/30	NLB	55	54	1 x 13mm EPB Standard on One side 2 x 13mm EPB Standard on Other side	
E4SSA45	-F40	-/45/45	NLB	56	55	2 x 10mm EPB FireSmart each side	
5255460	-MS39	-/60/60	NLB	56	55	1 x 13mm EPB MultiSmart one side 2 x 13mm EPB Standard other side	
E3SSA60	-M39	-/60/60	NLB	57	56	1 x 13mm EPB MultiSmart one side 2 x 13mm EPB MultiSmart other side	
E4SSA60	-S52	-/60/60	NLB	59	58	2 x 13mm EPB Standard each side	Please
E4SSA90	-M46	-/90/90	NLB	59	58	1 x 10mm EPB MultiSmart and 1 x 13mm EPB MultiSmart each side	se ref
E433A90	-M52	-/90/90	NLB	62	61	2 x 13mm EPB MultiSmart each side	refer to

Full Intertenancy - Fire Rated Floor/Ceilings

System Number	Lining Suffix	FRR	Load Bearing Ability	STC	Noise Control Rw	lic	Lining Requirements	Page
Direct Fix	Clip - F	loating Flo	oor/Ceil	ing -	Timb	er Joi	ist	
	-FS26	60/60/60	LB	66	65	57-76	1 x 13mm EPB FireSmart and 1 x 13mm EPB Standard	
EFJ2DFA60	-F26	60/60/60	LB	67	66	57-76	2 x 13mm EPB FireSmart	
	-M26	60/60/60	LB	68	67	57-77	2 x 13mm EPB MultiSmart	
	-FS26	60/60/60	LB	63	62	55-72	1 x 13mm EPB FireSmart and 1 x 13mm EPB Standard	
EFP2DFA60	-F26	60/60/60	LB	64	63	55-72	2 x 13mm EPB FireSmart	Plea
	-M26	60/60/60	LB	65	64	56-72	2 x 13mm EPB MultiSmart	se ref
Direct Fix	Clip - F	loating Flo	oor/Ceil	ing -	Steel	Joist		fer
EFJ2DFsA45	-F26	45/45/45	LB	66	65	56-76	2 x 13mm EPB FireSmart	to th
	-M26	45/45/45	LB	67	66	56-76	2 x 13mm EPB MultiSmart	e EPI
EFP2DFsA45	-F26	45/45/45	LB	63	62	55-72	2 x 13mm EPB FireSmart	BNOi
	-M26	45/45/45	LB	64	63	55-72	2 x 13mm EPB MultiSmart	ise C
EFJ2DFsA60	-F29	60/60/60	LB	67	66	56-76	1 x 13mm EPB FireSmart and 1 x 16mm EPB FireSmart	ontro
EFP2DFsA60	-F29	60/60/60	LB	64	63	56-72	1 x 13mm EPB FireSmart and 1 x 16mm EPB FireSmart	ol Sys
Direct Fix	Clip - F	loor/Ceilir	ng - Tim	ber J	oist	1		tei
	-FS26	60/60/60	LB	56	55	46-73	1 x 13mm EPB FireSmart and 1 x 13mm EPB Standard	ms M
E2DFA60	-F26	60/60/60	LB	57	56	46-73	2 x 13mm EPB FireSmart	Please refer to the EPB Noise Control Systems Manual for the
	-M26	60/60/60	LB	58	57	46-73	2 x 13mm EPB MultiSmart	I for
E2DFA90	-FM29	90/90/90	LB	57	56	47-73	1 x 16mm EPB FireSmart and 1 x 13mm EPB MultiSmart	thes
	-F32	90/90/90	LB	58	57	47-73	2 x 16mm EPB FireSmart	se System Specification sheets
Suspende	d Grid	Floor/Ceili	ng - Lin	nber.	Joist			te
	-MS26	60/60/60	LB	56	55	40-72	1 x 13mm EPB MultiSmart and 1 x 13mm EPB Standard	n Sp
E2SCA60	-F26	60/60/60	LB	56	55	40-72	2 x 13mm EPB FireSmart	ecifi
	-M26	60/60/60	LB	56	55	40-72	2 x 13 EPB MultiSmart	catio
E2SCA75	-F29	75/75/75	LB	57	56	47-72	1 x 16mm EPB FireSmart and 1 x 13mm EPB FireSmart	n she
E2SCA90	-F32	90/90/90	LB	57	56	40-73	2 x 16mm EPB FireSmart	eets
Direct Fix	Clip - F	loor/Ceilir	ig - Stee	ei Joie	st			
E2DFsA45	-F26	45/45/45	LB	56	55	47-74	2 x 13mm EPB FireSmart	
	-M26	45/45/45	LB	57	56	47-74	2 x 13mm EPB MultiSmart	
E2DFsA60	-FM29	60/60/60	LB	57	56	47-75	1 x 16mm EPB FireSmart and 1 x 13mm EPB MultiSmart	
	-F32	60/60/60	LB	57	56	47-75	2 x 16mm EPB FireSmart	

Sub Intertenancy - Walls

System	Lining	FRR	Load Bearing		ise trol	Lining Requirements	Pa
Number	Suffix	FNN	Ability	STC	Rw		Га
Single Tir	mber Fr	ame Walls -	Load Bea	aring			
	-S20	30/30/30	LB	39	38	1 x 10mm EPB Standard each side	
E2TLa30	-\$26	30/30/30	LB	40	39	1 x 13mm EPB Standard each side	
	-M20	30/30/30	LB	41	40	1 x 10mm EPB MultiSmart each side	
	-\$30	30/30/30	LB	42	41	1 x 10mm EPB Standard one side 2 x 10mm EPB Standard other side	
E3TLa30	-\$39	30/30/30	LB	43	42	1 x 13mm EPB Standard one side 2 x 13mm EPB Standard other side	
	-M30	30/30/30	LB	44	43	1 x 10mm EPB MultiSmart on One side 2 x 10mm EPB MultiSmart on Other side	
E4TLa45	-S40	45/45/45	LB	44	43	2 x 10mm EPB Standard each side	ר ובמסב ו בובו נס נווב
E2TLa60	-M26	60/60/60	LB	42	41	1 x 13mm EPB MultiSmart each side	
	-MS39	60/60/60	LB	45	44	1 x 13mm EPB MultiSmart one side 2 x 13mm EPB Standard other side	
E3TLa60	-M33	60/60/60	LB	45	44	1 x 13mm EPB MultiSmart one side 2 x 10mm EPB MultiSmart other side	
	-M39	60/60/60	LB	46	45	1 x 13mm EPB MultiSmart one side 2 x 13mm EPB MultiSmart other side	
	-S46	60/60/60	LB	45	44	1 x 10mm EPB Standard and 1 x 13mm EPB Standard each side	
E4TLa60	-\$52	60/60/60	LB	46	45	2 x 13mm EPB Standard each side	
	-M40	60/60/60	LB	46	45	2 x 10mm EPB MultiSmart each side	
E4TLa90	-M52	90/90/90	LB	48	47	2 x 13mm EPB MultiSmart each side	
Double T	ïmber F	rame Walls	- Load Be	earing	J		2
	-\$20	30/30/30	LB	50	49	1 x 10mm EPB Standard each side	3
2TDLa30	-S26	30/30/30	LB	52	51	1 x 13mm EPB Standard each side	_
	-M20	30/30/30	LB	52	51	1 x 10mm EPB MultiSmart each side	
Single Tir	mber Fr	ame Walls w	ith Resil	ient N	loun	t- Load Bearing	
3TMLa30	-\$30	30/30/30	LB	52	51	Frame Side: 1 x 10mm EPB Standard Mount Side: 2 x 10mm EPB Standard	
Single Tir	mber Fr	ame Walls w	ith Resil	ient R	lail- L	oad Bearing	
	-\$30	30/30/30	LB	47	46	Frame Side: 1 x 10mm EPB Standard Rail Side: 2 x 10mm EPB Standard	
3TRLa30	-\$39	30/30/30	LB	50	49	Frame Side: 1 x 13mm EPB Standard Rail Side: 2 x 13mm EPB Standard	
	-M30	30/30/30	LB	51	50	Frame Side: 1 x 10mm EPB MultiSmart Rail Side: 2 x 10mm EPB MultiSmart	
3TRLa60	-MS39	60/60/60	LB	52	50	Frame Side: 1 x 13mm EPB MultiSmart Rail Side: 2 x 13mm EPB Standard	
	-M39	60/60/60	LB	52	51	Frame Side: 1 x 13mm EPB MultiSmart Rail Side: 2 x 13mm EPB MultiSmart	

Freephone 0800 353 742

September 2024

Sub Intertenancy - Walls

System Number	Lining Suffix	FRR	Load Bearing Ability		ise trol Rw	Lining Requirements	Page
Single St	eel Fran	ne Walls - No	on Load I	Bearir	ng		
E2Sa15	-S20	-/15/15	NLB	40	39	1 x 10mm EPB Standard each side	
F26-20	-S26	-/30/30	NLB	41	40	1 x 13mm EPB Standard each side	
E2Sa30	-M20	-/30/30	NLB	42	41	1 x 10mm EPB MultiSmart each side	
	-\$33	-/30/30	NLB	43	42	1 x 13mm EPB Standard one side 2 x 10mm EPB Standard other side	
E3Sa30	-\$39	-/30/30	NLB	44	42	1 x 13mm EPB Standard one side 2 x 13mm EPB Standard other side	Plea
	-M30	-/30/30	NLB	44	43	1 x 10mm EPB MultiSmart one side 2 x 10mm EPB MultiSmart other side	ise re
E4Sa45	-S40	-/45/45	NLB	45	44	2 x 10mm EPB Standard each side	Please refer to the
E2Sa60	-M26	-/60/60	NLB	43	42	1 x 13mm EPB MultiSmart each side	o the
	-MS39	-/60/60	NLB	44	43	1 x 13mm EPB MultiSmart one side 2 x 13mm EPB Standard other side	
E3Sa60	-M39	-/60/60	NLB	45	44	1 x 13mm EPB MultiSmart one side 2 x 13mm EPB MultiSmart other side	Noi
	-S46	-/60/60	NLB	46	45	1 x 10mm EPB Standard and 1 x 13mm EPB Standard each side	se Co
E4Sa60	-S52	-/60/60	NLB	48	47	2 x 13mm EPB Standard each side	ontro
	-M40	-/60/60	NLB	48	47	2 x 10mm EPB MultiSmart each side	l Sys
E4Sa90	-M46	-/90/90	NLB	50	49	1 x 10mm EPB MultiSmart and 1 x 13mm EPB MultiSmart each side	tems
E4Sa105	-M52	-/105/105	NLB	52	51	2 x 13mm EPB MultiSmart each side	EPB Noise Control Systems Manual for the
Single St	eel Fran	ne Walls - Lo	ad Beari	ng			lua
E2SLa30	-M26	30/30/30	LB	43	42	1 x 13mm EPB MultiSmart each side	for
E3SLa30	-M39	30/30/30	LB	45	44	1 x 13mm EPB MultiSmart one side 2 x 13mm EPB MultiSmart other side	the
E4SLa30	-S40	30/30/30	LB	45	44	2 x 10mm EPB Standard each side	se Sy
	-S52	45/45/45	LB	48	47	2 x 13mm EPB Standard each side	stem
E4SLa45	-M40	45/45/45	LB	48	47	2 x 10mm EPB MultiSmart each side	Spe
E4SLa60	-M52	60/60/60	LB	52	51	2 x 13mm EPB MultiSmart each side	cifica
E4SLa90	-F64	90/90/90	LB	53	52	2 x 16mm EPB FireSmart each side	e System Specification sheets
Double S	teel Fra	me Walls - N	lon Load	Bear	ing	·	she
	-S26	-/30/30	NLB	52	51	1 x 13mm EPB Standard each side	eets
E2SDa30	-M20	-/30/30	NLB	52	51	1 x 10mm EPB MultiSmart each side	

Sub Intertenancy - Walls

System	System NumberLining SuffixFRRLoad Bearing AbilityNoise ControlSuffixFRRLoad Bearing AbilityNoise Control					Lining Requirements	Page
Number			Rw				
Steel Fra	me Wall	s with Resili	ent Rail-	Non	Load	Bearing	
E3SRa30	-\$39	-/30/30	NLB	51	50	Frame Side: 1 x 13mm EPB Standard Rail Side: 2 x 13mm EPB Standard	
ESSNASU	-M30	-/30/30	NLB	51	50	Frame Side: 1 x 10mm EPB MultiSmart Rail Side: 2 x 10mm EPB MultiSmart	
E3SRa60	-MS39	-/60/60	NLB	52	51	Frame Side: 1 x 13mm EPB MultiSmart Rail Side: 2 x 13mm EPB Standard	
ESSRAOU	-M39	-/60/60	NLB	53	52	Frame Side: 1 x 13mm EPB MultiSmart Rail Side: 2 x 13mm EPB MultiSmart	
Quiet Ste	el Fram	e Walls - No	n Load B	earin	g		P
E2SQa30	-S26	-/30/30	NLB	47	46	1 x 13mm EPB Standard each side	ease
EZSQ850	-M20	-/30/30	NLB	48	47	1 x 10mm EPB MultiSmart each side	refe
5260-20	-\$39	-/30/30	NLB	53	52	1 x 13mm EPB Standard one side 2 x 13mm EPB Standard other side	Please refer to the
E3SQa30	-M30	-/30/30	NLB	53	52	1 x 10mm EPB MultiSmart one side 2 x 10mm EPB MultiSmart other side	
E3SQa45	-MS33	-/45/45	NLB	52	51	1 x 13mm EPB MultiSmart one side 2 x 10mm EPB Standard other side	^D B N
E2SQa60	-M26	-/60/60	NLB	50	49	1 x 13mm EPB MultiSmart each side	oise (
Staggere	d Steel	Stud Walls -	Non Loa	d Bea	aring		Cor
5255-20	-S26	-/30/30	NLB	50	49	1 x 13mm EPB Standard each side	ntrol
E2SSa30	-M20	-/30/30	NLB	49	48	1 x 10mm EPB MultiSmart each side	Syst
5255-60	-M26	-/60/60	NLB	52	51	1 x 13mm EPB MultiSmart each side	ems .
E2SSa60	-F32	-/60/60	NLB	54	53	1 x 16mm EPB FireSmart each side	EPB Noise Control Systems Manu

Sub Intertenancy - Floor/Ceilings

System	Lining	FRR	Load Bearing		Noise Control		Lining Requirements			
Number	Suffix		Ability	STC	Rw	IIC				
Direct F	Direct Fix Clip - Floor/Ceiling									
E1DFa15	-S13	15/15/15	LB	48	47	43-69	1 x 13mm EPB Standard			
E2DFa30	-S26	30/30/30	LB	53	52	43-69	2 x 13mm EPB Standard			
E1DFa45	-M13	45/45/45	LB	52	51	43-69	1 x 13mm EPB MultiSmart			
E1DFa60	-F16	60/60/60	LB	52	51	43-69	1 x 16mm EPB FireSmart			
Suspend	ded Gri	d Floor/Cei	ling							
E1SCa15	-S13	15/15/15	LB	48	47	39-62	1 x 13mm EPB Standard			
E2SCa30	-\$26	30/30/30	LB	53	52	42-67	2 x 13mm EPB Standard			
E1SCa45	-M13	45/45/45	LB	51	50	43-69	1 x 13mm EPB MultiSmart			
E1SCa60	-F16	60/60/60	LB	52	51	43-69	1 x 16mm EPB FireSmart			

e Control Systems Manual for these System Specification sheets

INTRODUCTION

This manual provides details for construction of two way fire and acoustic walls and floor/ceilings with EPB Plasterboard & Fibre Cement to provide fire protection as required by the NZBC clause C1 to C6 "Protection From Fire".

Elephant Plasterboard (NZ) Limited has many different combinations of two way fire and acoustic plasterboard & fibre cement wall and floor/ ceiling fire rated systems. It is the responsibility of the specifier to accommodate the required performance of the building they are considering. The specifier should take into consideration both external and internal noise control and fire rating for occupants intended use. Special consideration must be taken in the construction process.

All construction details that have been provided in this manual are generic only and it is important that expert advice is sought to determine suitability in each individual project.

Limitations and Conditions of Use

- EPB Plasterboard is intended for normal conditions of dry internal use.
- EPB Plasterboard must not be used for bracing applications in or around baths and shower areas.
- EPB Plasterboard must not be exposed to liquid water or be installed in situations where extended exposures to humidity above 90% Relative Humidity are to be expected. Bathrooms, kitchens and laundries should have adequate ventilation or heating to avoid condensation build-up.
- A suitable surface finish (e.g. Vinyl wallpaper or gloss and semi-gloss alkyd paints) must be applied to EPB Plasterboard in all areas where liquid water or high humidity can be expected.
- EPB Plasterboard must not be installed over a vapour barrier.
- EPB Plasterboard must not be applied directly to masonry, concrete or solid plaster, unless timber strapping or steel furring channels are used.
- EPB Plasterboard must not be exposed to temperatures of 52°C or greater for prolonged periods.
- EPB Plasterboard may not be used as an external lining.

New Zealand Building Code (NZBC) Compliance

EPB Plasterboard is manufactured to AS/NZS 2588 and has been specifically formulated to meet New Zealand Building Code requirements. EPB Plasterboard has been marketed internationally since 1975 and the product has established an excellent history of performance for its use in buildings throughout New Zealand and the Asia/Pacific region. EPB Plasterboard meets the durability requirements of the NZBC and is subject to use, installation and maintenance in accordance with the instructions outlaid in this manual. The Manufacturing plant is International Standard ISO 9001 and ISO 14001 registered.

NZBC Clause B1 Structure

Framing material specifications used with EPB Plasterboard Systems must be in accordance with the performance requirements of NZBC Clause B1. Timber framed walls and floors must be installed and meet the requirements of NZS 3604.

NZBC Clause B2 Durability

EPB Plasterboard Fire, Noise Control & Bracing Systems have a serviceable life of not less than 50 years and so is in accordance to NZBC B2.3.1.

• NZBC Clause C1-C6 Protection from Fire

EPB Plasterboard Fire & Noise Control Systems can meet the requirements of providing passive fire protection as per NZBC Clause C1-C6.

• NZBC Clause E3 Internal Moisture

EPB Plasterboard Wet Area Systems can meet the requirements of NZBC Acceptable Solution E3/AS1.

• NZBC Clause F2 Hazardous Building Materials

EPB Plasterboard Systems meet this requirement of NZBC Clause F2 and will not present a health hazard to people.

NZBC Clause G6 - Airborne & Impact Sound

EPB Plasterboard Noise Control Systems entitled 'Full Intertenancy' (STC 55 or greater) systems meet the requirements of NZBC Clause G6.

INTRODUCTION

Fire Resistance Ratings (FRR)

To prevent fire spread or structural collapse, the Acceptable Solutions require building elements to have fire resistance ratings (FRRs). The level of FRR required depends on the risk group of the building.

FRR components

An FRR comprises three numbers: these give time values in minutes for structural adequacy, integrity and insulation. Eg. --/60/60 (a/b/c). Primary and secondary elements required to have an FRR will, depending on their function, need to satisfy one or more of these three criteria as follows:

a) **Structural Adequacy**: usually provided by primary elements within a fire cell. These include building elements which are part of the structure, and those providing support to other elements with an FRR within the same or adjacent fire cells. Examples are: columns, beams, floors and walls (which may also be fire separations).

b) **Integrity**: usually provided by secondary elements. Examples are fire separations, which are internal partitions and floors, areas of external walls not permitted to be an unprotected area, and some areas of roofs when close to another building or crossed by an exit way. Primary elements forming an integral part of a fire separation are also rated for integrity.

c) Insulation: applies to fire separations and is required where the transmission of heat through the element may endanger occupants on the other side or cause fire to spread to other fire cells or adjacent buildings. For example, insulation is necessary for fire separations between sleeping spaces, where protecting a safe path or through external walls.

EPB Plasterboard Fire Rated Systems have numerous system combinations as outlined in this manual. All EPB Plasterboard Fire Rated systems have been tested or internally assessed or have opinions provided by independent accredited quality assurance organisations like "The Building Research Association of New Zealand (BRANZ)".

Internal Lining Surface Finish Properties

EPB Plasterboard has been tested at BRANZ in accordance with ISO 5660 Reaction to fire tests (Heat release, smoke production and mass loss rate) Part 1: Heat release rate (cone calorimeter method); and ISO 5660 Reaction to fire tests (Heat release, smoke production and mass loss rate) Part 2: Smoke production rate (dynamic measurement).

A Group Number Classification of **1-S** was achieved in Fire test FH 5695-TT for all EPB Plasterboard paper faced sheet linings. This classification only applies to EPB Plasterboard paper faced sheet linings without paint or wallpaper finish. Contact the surface finish suppliers for group number information for their products.

'Group Number 1-S' is the highest performance expectation under 'Part 4. Control of Internal Fire and Smoke Spread' clause C/AS2 to C/AS7 of the NZBC. It means an EPB Plasterboard paper faced sheet lining can be specified for use in any risk group application.

Control Of External Fire Spread

External spread of fire applies where:

- The building height is greater than 10m and upper floors have sleeping uses or are different property, refer to clause C3.5 of the NZBC;
- The building is located within 1m of a relevant boundary, refer to clause C3.7 of the NZBC.

Refer to Table 5.1 of Section 5.4 of C/AS1 and Table 5.5 of Section 5.8.1 of C/AS2 for the information about various risk groups to identify the external fire spread safety requirement applicable to the exterior surface finishes.

For the situations where 'no requirement' is listed in the compliance documents, James Hardie cladding systems installed over a flexible underlay as per the information published in the James Hardie Technical Specification Literature complies. See page 13 for list of relevant James Hardie Technical Literature.

For the other situations, James Hardie claddings in conjunction with RAB[™] Board fixed into timber frame with R2.2 fibreglass insulation/James Hardie Mineral Insulation complies.

In addition, for buildings over 10m in height, the external wall cavity must be blocked off either at each floor level or at heights no more than 3.5m to prevent fire spread within the cavity. Refer to latest James Hardie Fire & Acoustic Design Manual - Figure 7: Intertenancy Fire Separation, for the horizontal joint detail to create a fire separation in conjunction with James Hardie claddings.

For construction details of James Hardie claddings with RAB[™] Board, Ask James Hardie on 0800 808 868.

Freephone 0800 353 742

EPB Plasterboard & Fibre Cement Fire Rated Walls

EPB Plasterboard & Fibre Cement Fire Rated Systems have been tested on timber & steel frame walls as Load Bearing (LB)

Timber Frame

Stud heights, stud spacings, load and framing dimensions for Load Bearing (LB) Timber framed walls are determined by the NZBC, and NZS 3604. Heights greater than what is defined in NZS 3604 will need specific design by a structural engineer.

Internal Walls

Minimum framing of 90 x 45mm shall be used with a maximum stud spacing of 600mm. Nogs to be spaced at 800mm maximum. Minimum framing depth as per fire and acoustic system selected or the structural requirements whichever is greater. All sheet edges must be supported by framing timber. Timber framing treatment to comply with the minimum requirements of NZS 3602. When framing at 140 x 45mm the maximum stud spacing 600mm.

External Walls

Minimum framing & maximum stud spacings according to the table provided on figure EFC-001. Nogs to be spaced at 800mm maximum. Minimum framing depth as per fire and acoustic system selected or the structural requirements whichever is greater. All sheet edges must be supported by framing timber. Timber framing treatment to comply with the minimum requirements of NZS 3602.

Floors

Floor joists of minimum 45mm width to be used. Strutting of floor joist as per NZS 3604 is required. Bottom plate fixing in timber floors must penetrate through floor into joists or solid blocking.

Steel Frame

Steel framing for fire rated walls must be in accordance with NASH standard for residential and low rise buildings and AS/NZ 1170 standards. Steel frame must comply with the durability requirements of NZBC. Steel sections shall be galvanized/zinc coated and have a base metal thickness (BMT) 0.55mm minimum for non-load bearing walls and 0.75mm minimum for load bearing walls and 1.6mm maximum. A minimum of 89mm deep x 36mm wide steel stud framing to be used in external walls. Maximum stud spacing at 400mm centres. Nogs to be spaced at 800mm centres maximum. All sheet edges must be formed over and supported by framing.

All steel framing must be used according to their manufacturer's instructions. Steel framing properties vary considerably depending upon the grade of steel used. It is the designer's responsibility to ensure the type of framing selected is fit for purpose and suitable to carry design loads.

Thermal Fire Batten

Fire battens are used on all FRR steel stud systems and must be used between James Hardie cladding and steel framing face. For steel framing in interior/exterior applications the NZBC also requires additional external insulation to achieve adequate thermal resistance. Refer to James Hardie Fire and Acoustic Design Manual for correct assembly and installation of Thermal Fire Battens.

These insulated battens are assembled on site by cutting a 100mm wide strip from 9mm thick EasyLap[™] Panel and adhering a 10mm thick x 100mm wide XPS (extruded polystyrene) on its face. All fire battens are fixed horizontally and vertically to all steel members. All battens must be neatly cut and tightly fitted covering all steel members. All thermal fire battens must be fitted with the polystyrene to the exterior face. The batten is tacked to the steel framing as shown in the following detail.

Structural Steel Members in Fire Rated Walls

Structural steel members such as columns or beams are sometimes located inside the cavities of two way fire rated wall or floor/ceiling systems. The FRR of the two way fire rated system applies across the entire element, from exposed side to the unexposed side. The temperature inside the cavity can rise above the critical temperature level for structural steel members resulting in premature buckling. Therefore by containing a structural steel member within a two way fire system, it cannot be automatically assumed that the structural steel member will maintain it's structural integrity of the two way fire system within which it is contained. Hence, either reference should be made to the column and beam section of the EPB Fire Rated System Manual for further information on protection of structural steel members.

Cavity Insulation

In order to achieve the stated fire ratings in this manual all cavities must be filled with an insulation material regardless if its an internal or external wall.

• Glass wool Insulation

Any brand of R2.2 glass wool insulation with a weight between 12-18kg/m³ may be used. This insulation can be substituted with a higher R-value fibreglass insulation to achieve higher insulation requirements.

James Hardie Mineral Insulation

In a fire rated system where a mineral insulation is specified, only James Hardie Mineral Insulation must be used. James Hardie Mineral Insulation cannot be substituted with any other insulation material. Refer to the James Hardie Mineral Insulation Technical Supplement for correct application.

Also refer to clause H1 of the NZBC for further information on R-value Requirement



Fire Retardant Flexible Underlay

All external walls must have a fire retardant flexible underlay or a rigid air barrier installed beneath the cladding. In a FRR system, any flexible underlay that complies with Table 23 of E2/AS1 and has a Flammability Index not exceeding 5, when tested to AS 1530.2 may be used. Installation of a flexible underlay must be in accordance with the manufacturer's recommendations and their installation instructions.

Rigid Air Barrier

James Hardie RAB[™] Board can be used to achieve the published fire ratings stated in this manual. Refer to James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual for information regarding its installation.

For EH wind zone or Specific Engineering Design (SED) projects where the design wind pressures are between 1.5kPa (ULS) and 2.5kPa (ULS), James Hardie RAB[™] Board must be used.

In addition, for buildings over 10m in height, the external wall cavity must be blocked off either at each floor level or at heights no more than 3.5m to prevent fire spread within the cavity. Refer to latest James Hardie Fire & Acoustic Design Manual - Figure 7: Intertenancy Fire Separation, for the horizontal joint detail to create a fire separation in conjunction with James Hardie claddings.

Flexible underlay is not required when using James Hardie RAB[™] Board. For construction details of James Hardie claddings with RAB[™] Board, Ask James Hardie on 0800 808 868.

EPB QuickBrace System

The bracing systems specified in the EPB QuickBrace Systems Manual can easily be combined with the EPB Fire Rated Systems by adhering to the details outlined for the relevant Bracing system type and relevant Fire Rated System requirements. For Single layered Fire Rated systems, use the QuickBrace fastening pattern and the required screw length of the Fire Rated Systems. For Double layered Fire Rated systems, the bracing sheet can be either:

- The Inner sheet fixed directly to the framing. Use the QuickBrace fastening pattern and the required screw length of the Fire Rated System. The inner layer can be left unstopped; or
- The Outer sheet. Use the QuickBrace fastening pattern and the required screw length of the Fire Rated System.

EPB Plasterboard & Fibre Cement Fire Rated Floor/Ceiling

EPB Plasterboard & Fibre Cement Fire Rated Systems have been tested on Load bearing floor/ceiling systems. Refer to this manual for fixings and layer combinations. Ceiling linings must be mechanically fixed. Glue may not be substituted for mechanical fixing if used in a passive fire system. Screw lengths, spacings and type as defined by this manual must be used.

Timber Joists

Floor/ceiling system as defined in NZS 3604 for floor loadings (2.0 kPa or 3.0 kPa) may be used. Consult NZS 3604 latest edition for floor joist spans. Floor joists must have a minimum of 190mm depth x 45mm width and a maximum spacing of 600mm centres. Consult the appropriate supplier's technical information for design strength and serviceability.

Steel Joists

Steel floor joists shall be a minimum depth of 190mm C-section with 45mm flanges and a steel gauge of 1.6mm minimum. Joists to be spaced at no more than 600mm centres.

• Flooring

Floor/Ceiling system must have a floor that is at least 20mm thick particle board complying with AS/NZS 1860 Part 1: 2017 or minimum 17mm thick structural ply complying with AS/NZS 2269 Part 0: 2012 fixed to the floor joists as per manufacturer's installation instructions.

• Floating Floor

The floating floor systems must be either 19mm James Hardie Tongue & Groove Secura[™] Interior Floor or 20mm Tongue & Groove Particle Board complying to AS/NZS 1860.

Post Fire Stability

The fire rated walls built close to boundary are required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4. The bottom plate of these walls acan be fixed in accordance with the post fire stability details published in this design manual on page 85, using Pryda Brace anchor brackets on either side og the stud.

For steel framing, post fire stability must be as per SED.

Product & Component Substitution

When a product specified in a system as per this manual is substituted, the performance of the system will be compromised. Therefore the materials specified in the system must not be substituted. Elephant Plasterboard (NZ) Limited does not take any liability if substitution of components are implemented in any EPB Plasterboard Systems without consultation.

EPB Plasterboard Substitution Options

The table below indicates which products can substitute the original EPB Plasterboard type specified.

- \checkmark indicates that the FRR performance will be maintained
- X indicates that the FRR performance will be lower and so therefore the substitution is not allowed

Original EPB	EPB Plasterboard Substitution Options - FRR performance									
Plasterboard	Stan	dard		FireSmart			MultiSmart		Smart	
specified	10mm	13mm	10mm	13mm	16mm	10mm	13mm	10mm	13mm	
10mm Standard	\checkmark	\checkmark	\checkmark	\checkmark	\checkmark	\checkmark	\checkmark	\checkmark	\checkmark	
13mm Standard	х	\checkmark	х	\checkmark	\checkmark	\checkmark	\checkmark	\checkmark	\checkmark	
10mm FireSmart	х	\checkmark								
13mm FireSmart	х	х	х	\checkmark	\checkmark	х	\checkmark	х	\checkmark	
16mm FireSmart	х	х	х	х	\checkmark	х	х	Х	Х	
10mm MultiSmart	х	х	х	\checkmark	\checkmark	\checkmark	\checkmark	\checkmark	\checkmark	
13mm MultiSmart	Х	Х	Х	\checkmark	\checkmark	Х	\checkmark	Х	\checkmark	

James Hardie Cladding Options & Technical Literature

The James Hardie product layout and installation must be in accordance with the relevant James Hardie product literature for the cladding selected. Refer to the table below for limitations and relevant James Hardie product technical literature.

	1	Direct Fix				
	Cavity Battens ed for buildings over 10 atherboard Cavity Fix Te		- Refer to Linea [™] Weatherboard Direct Fix Technical Specification			
Linea [™] Oblique [™]	⁴ Weatherboard		1			
Horizontal fixing		r Cavity Battens ired for buildings over 10 blique™ Weatherboard F		chnical	Specification	
Vertical fixing	- RAB™ Board requi - Refer to Linea™ O	Hardie Horizontal Timbe ired for buildings over 10 blique™ Weatherboard \ n to JH 40mm structural	m or EH wind zone /ertical Installation Techi		ecification & Linea™ Oblique™ al Specification	
Stria™ Cladding						
Horizontal fixing	r Cavity Battens ired for buildings over 10 adding Timber Cavity Bat		l Specifi	ication		
Vertical fixing	- RAB [™] Board requi	Hardie Horizontal Timbe ired for buildings over 10 adding Vertical Technical	0m or EH wind zone			
Horizontal fixing CLD™ Structural Batten	- Install over CLD™	be used to achieve fire r Structural Cavity Battens adding CLD™ Structural (5	ipecifica	ition	
Axon [™] Panel &	EasyLap™ Panel					
Timber Ca	wity Batten	Dire	rect Fix		CLD™ Structural Batten	
- RAB [™] Board require over 10m or EH wind - Refer to Axon [™] Pan Panel Timber Cavity Specification	d zone el & EasyLap™	Direct Fixed & Fixed	- Refer to Axon [™] Panel EasyLap [™] Panel Direct Fixed & Fixed to CLD [™] Structural Cavity Batten Technical Specification		 - RAB[™] Board must be used to achieve fire ratings - Refer to Axon[™] Panel EasyLap[™] Panel Direct Fixed & Fixed to CLD[™] Structural Cavity Batten Technical Specification 	
Hardie [™] Plank W		Hardie [™] Flex Sheet				
- Install over Timber Cavity Battens - Refer to Hardie™ Plank Weatherboard Technical Specification			- Install over Timber Cavity Battens - Refer to Hardie™Flex Sheet Technical Specification			
ExoTec™Facade	Panel		Villaboard [™] Lining RAB [™] Board		RAB [™] Board	
- RAB [™] Board must b - Install over Top Hat	-	- Refer Villaboard [™] Lining Installation Manual - For internal applications				


- Install over Top Hat systemInstallation Manual- Refer to ExoTec™ Facade Panel Top Hat Rainscreen Technical
Specification- For internal applications
only

- Cannot be used as a weathertight

cladding.


Nomenclature:

EPB Specification Reference - Fire Wall with Fibre Cement

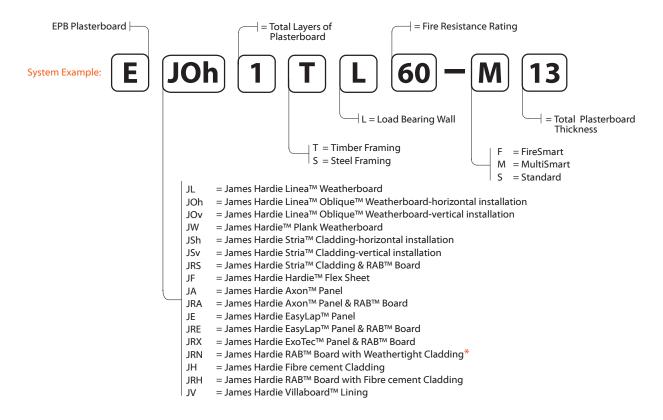

*Note1 : It is also important to consider that the fire properties of the external cladding is in accordance with NZBC C/VM1 or C/AS documents. Refer to Table 5.1 of Section 5.4 of C/AS1 and Table 5.5 of Section 5.8.1 of C/AS2 for the information about various risk groups to identify the external fire spread safety requirement applicable to the exterior surface finishes.

EPB Specification Reference - Floor/Ceiling with Fibre Cement

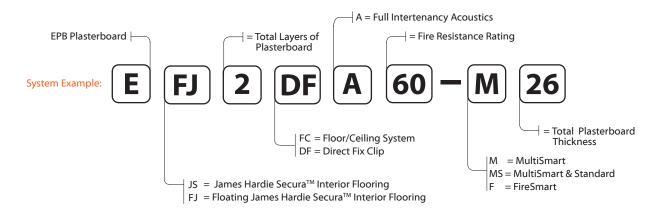

External Timber Frame Walls

Load Bearing

Two Way FRR

EJL1TL30

EPB & James Hardie Linea[™] Weatherboard

External Wall - Timber Frame

	moerre	unic	Loud Dearing		
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
EJL1TL30	-F10	30/30/30	R2.2 glass wool	46	1 x 10mm EPB FireSmart on Internal side James Hardie Linea [™] Weatherboard to External side

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

For the type of allowable underlay refer to table below.

	EH Wind Zone	Other Wind Zone
Buildings <10m	RAB	Flexible Underlay
Buildings >10m	RAB	RAB

Fire Retardant Flexible Underlay

Install any Fire Retardant Flexible Underlay beneath the claddings, that complies with Table 23 of E2/AS1 and has a flammability index not exceeding 5.

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing. 6mm RAB[™] Board : Use 40 x 2.8mm fibre cement nail at 200mm centres 9mm RAB[™] Board : Use 50 x 2.8mm fibre cement nail at 200mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

When Cavity Batten is required, use a nominal 20mm Timber Cavity Batten. Refer to LineaTM Weatherboard Cavity Fix Technical Specification for installation instructions. When Cladding can be directly fixed without a cavity batten then a fire retardant flexible underlay must be used (if allowable). Refer to LineaTM Weatherboard Direct Fix Technical Specification.

Linea[™] Weatherboard Cladding

James Hardie Linea[™] Weatherboard cladding to external side of the timber framing. Consider the nail length required depending on the type of fixing i.e. Cavity fixing or Direct fixing. Refer to both Linea[™] Weatherboard Cavity Fix Technical Specification and Linea[™] Weatherboard Direct Fix Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use 90mm thick R2.2 glass wool insulation.

EPB Plasterboard Lining

<u>NB</u>: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 10mm EPB FireSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings

Fasteners

41mm x 6g High Thread Drywall Screws

Fastener Centres

When using RAB[™] Board


Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

When using Fire Retardant Flexible Underlay

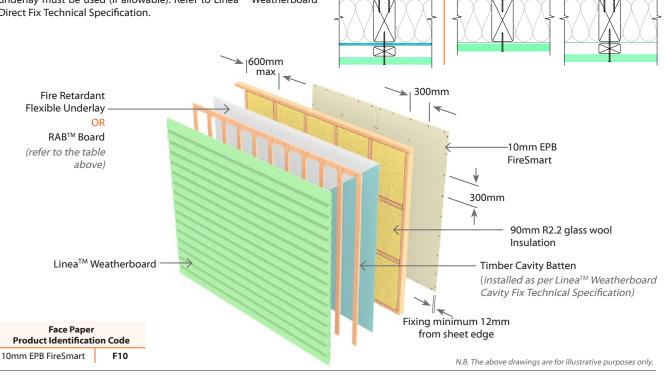

EJL1TL60

EPB & James Hardie Linea[™] Weatherboard

External Wall - Timber Frame

		unic			Eodd Dealing
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
EJL1TL60	-M13	60/60/60	R2.2 glass wool	47	1 x 13mm EPB MultiSmart on Internal side James Hardie Linea™ Weatherboard to Other side

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

For the type of allowable underlay refer to table below.

	EH Wind Zone	Other Wind Zone
Buildings <10m	RAB	Flexible Underlay
Buildings >10m	RAB	RAB

Fire Retardant Flexible Underlay

Install any Fire Retardant Flexible Underlay beneath the claddings, that complies with Table 23 of E2/AS1 and has a flammability index not exceeding 5.

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing. 6mm RAB[™] Board : Use 40 x 2.8mm fibre cement nail at 200mm centres 9mm RAB[™] Board : Use 50 x 2.8mm fibre cement nail at 200mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

When Cavity Batten is required, use a nominal 20mm Timber Cavity Batten. Refer to LineaTM Weatherboard Cavity Fix Technical Specification for installation instructions. When Cladding can be directly fixed without a cavity batten then a fire retardant flexible underlay must be used (if allowable). Refer to LineaTM Weatherboard Direct Fix Technical Specification.

Linea[™] Weatherboard Cladding

James Hardie Linea[™] Weatherboard cladding to external side of the timber framing. Consider the nail length required depending on the type of fixing i.e. Cavity fixing or Direct fixing. Refer to both Linea[™] Weatherboard Cavity Fix Technical Specification and Linea[™] Weatherboard Direct Fix Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use 90mm thick R2.2 glass wool insulation.

EPB Plasterboard Lining

<u>NB</u>: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 13mm EPB MultiSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings

Fasteners

41mm x 6g High Thread Drywall Screws

Fastener Centres

When using RAB[™] Board


Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

When using Fire Retardant Flexible Underlay

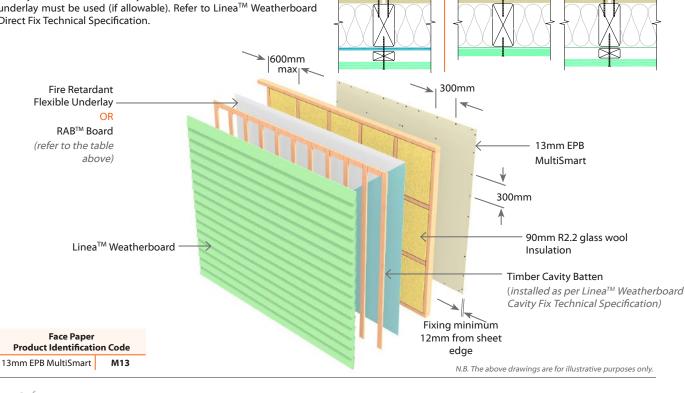

Load Bearing

October 2024

Load Bearing

Two Way FRR

EJOh1TL30

EPB & James Hardie Linea[™] Oblique[™] Weatherboard - Horizontal

External Wall - Timber Frame

System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
EJOh1TL30	-F10	30/30/30	R2.2 glass wool	46	1 x 10mm EPB FireSmart on Internal side James Hardie Linea™ Oblique™ Weatherboard horizontal to External side

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

For the type of allowable underlay refer to table below.

	EH Wind Zone	Other Wind Zone
Buildings <10m	RAB	Flexible Underlay
Buildings >10m	RAB	RAB

Fire Retardant Flexible Underlay

Install any Fire Retardant Flexible Underlay beneath the claddings, that complies with Table 23 of E2/AS1 and has a flammability index not exceeding 5.

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing. 6mm RAB[™] Board : Use 40 x 2.8mm fibre cement nail at 200mm centres 9mm RAB[™] Board : Use 50 x 2.8mm fibre cement nail at 200mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

Use a nominal 20mm Timber Cavity Batten. Refer to Linea[™] Oblique[™] Horizontal Installation Technical Specification for installation instructions.

Linea[™] Oblique[™] Weatherboard Cladding - Horizontal

James Hardie Linea[™] Oblique[™] Weatherboard cladding fixed horizontally to external side of the timber framing. Refer to both Linea[™] Oblique[™] Horizontal Installation Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use 90mm thick R2.2 glass wool insulation.

EPB Plasterboard Lining

<u>NB</u>: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 10mm EPB FireSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings

Fasteners

41mm x 6g High Thread Drywall Screws

When using RAB™ Board

Fastener Centres


Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

When using Fire Retardant Flexible Underlay

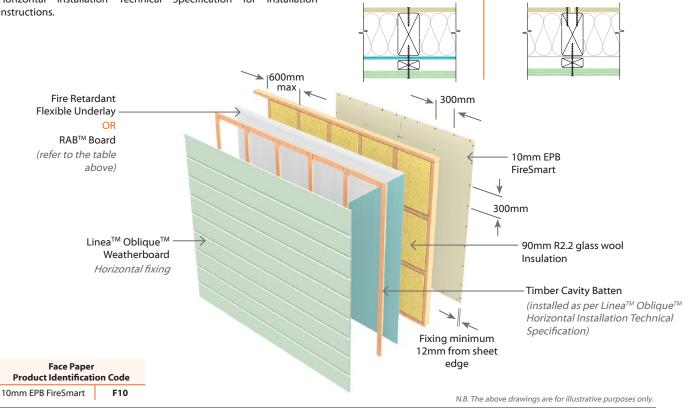

EJOv1TL30

EPB & James Hardie Linea[™] Oblique[™] Weatherboard - Vertical

External Wall - Timber Frame

					Loud Dealing
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
EJOv1TL30	-F10	30/30/30	R2.2 glass wool	46	1 x 10mm EPB FireSmart on Internal side James Hardie Linea [™] Oblique [™] Weatherboard vertical to External side

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- · Maximum stud spacing's are 600mm centres.
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

For the type of allowable underlay refer to table below.

	EH Wind Zone	Other Wind Zone
Buildings <10m	RAB	Flexible Underlay
Buildings >10m	RAB	RAB

Fire Retardant Flexible Underlay

Install any Fire Retardant Flexible Underlay beneath the claddings, that complies with Table 23 of E2/AS1 and has a flammability index not exceeding 5.

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing. 6mm RAB[™] Board : Use 40 x 2.8mm fibre cement nail at 200mm centres 9mm RAB[™] Board : Use 50 x 2.8mm fibre cement nail at 200mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

Use a 20mm James Hardie Horizontal Timber Cavity Batten. Refer to Linea[™] Oblique[™] Vertical Installation Technical Specification for installation instructions.

Linea[™] Oblique[™] Weatherboard Cladding - Vertical

James Hardie Linea[™] Oblique[™] Weatherboard cladding fixed vertically to external side of the timber framing. Refer to both Linea™ Oblique[™] Vertical Installation Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use 90mm thick R2.2 glass wool insulation.

EPB Plasterboard Lining

One layer of 10mm EPB FireSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

41mm x 6g High Thread Drywall Screws

using RAB[™] Board

Fastener Centres


Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

When using Fire Retardant Flexible Underlay

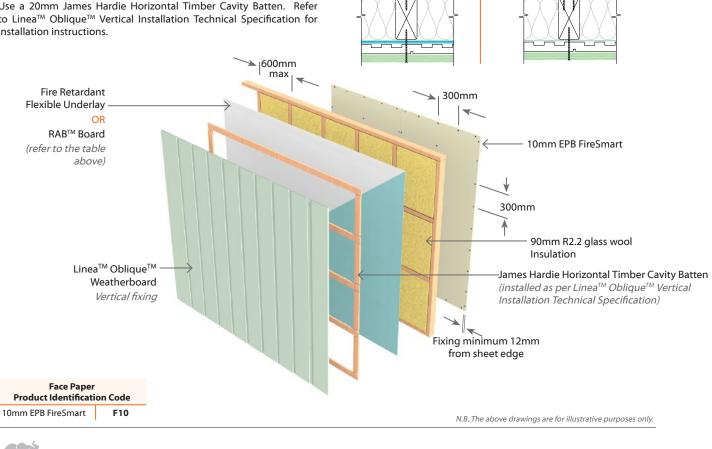

Two Way FRR

Load Bearing

EPB & James Hardie Linea[™] Oblique[™] Weatherboard - Horizontal

October 2024

Two Way FRR

Load Bearing

External Wall - Timber Frame

EJOh1TL60

		anne			Louid Dearning
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
EJOh1TL60	-M13	60/60/60	R2.2 glass wool	47	1 x 13mm EPB MultiSmart on Internal side James Hardie Linea [™] Oblique [™] Weatherboard horizontal to External side

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

For the type of allowable underlay refer to table below.

	EH Wind Zone	Other Wind Zone
Buildings <10m	RAB	Flexible Underlay
Buildings >10m	RAB	RAB

Fire Retardant Flexible Underlay

Install any Fire Retardant Flexible Underlay beneath the claddings, that complies with Table 23 of E2/AS1 and has a flammability index not exceeding 5.

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing. 6mm RAB[™] Board : Use 40 x 2.8mm fibre cement nail at 200mm centres 9mm RAB[™] Board : Use 50 x 2.8mm fibre cement nail at 200mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home $\mathsf{RAB}^{\mathsf{TM}}$ Pre-Cladding & $\mathsf{RAB}^{\mathsf{TM}}$ Board Installation Manual.

Cavity Batten

Use a nominal 20mm Timber Cavity Batten. Refer to Linea[™] Oblique[™] Horizontal Installation Technical Specification for installation instructions.

Linea[™] Oblique[™] Weatherboard Cladding - Horizontal

James Hardie Linea[™] Oblique[™] Weatherboard cladding fixed horizontally to external side of the timber framing. Refer to both Linea[™] Oblique[™] Horizontal Installation Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use 90mm thick R2.2 glass wool insulation.

EPB Plasterboard Lining

<u>NB</u>: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 13mm EPB MultiSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings

Fasteners

41mm x 6g High Thread Drywall Screws

Fastener Centres


Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

When using Fire Retardant Flexible Underlay

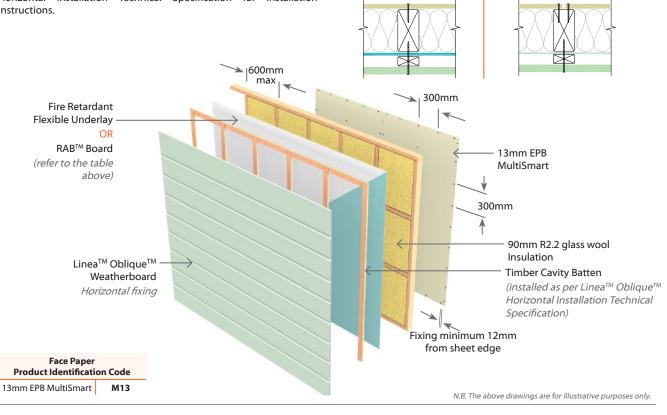

Freephone 0800 353 742

EJOv1TL60 EPB & James Hardie Linea[™] Oblique[™] Weatherboard - Vertical

External Wall - Timber Frame

	Louid Dealing				
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
EJOv1TL60	-M13	60/60/60	R2.2 glass wool	47	1 x 13mm EPB MultiSmart on Internal side James Hardie Linea [™] Oblique [™] Weatherboard vertical to External side

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

For the type of allowable underlay refer to table below.

	EH Wind Zone	Other Wind Zone
Buildings <10m	RAB	Flexible Underlay
Buildings >10m	RAB	RAB

Fire Retardant Flexible Underlay

Install any Fire Retardant Flexible Underlay beneath the claddings, that complies with Table 23 of E2/AS1 and has a flammability index not exceeding 5.

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing. 6mm RAB[™] Board : Use 40 x 2.8mm fibre cement nail at 200mm centres 9mm RAB[™] Board : Use 50 x 2.8mm fibre cement nail at 200mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home $\mathsf{RAB}^{\mathsf{TM}}$ Pre-Cladding & $\mathsf{RAB}^{\mathsf{TM}}$ Board Installation Manual.

Cavity Batten

Use a 20mm James Hardie Horizontal Timber Cavity Batten. Refer to Linea[™] Oblique[™] Vertical Installation Technical Specification for installation instructions.

Linea[™] Oblique[™] Weatherboard Cladding - Vertical

James Hardie LineaTM ObliqueTM Weatherboard cladding fixed vertically to external side of the timber framing. Refer to both LineaTM ObliqueTM Vertical Installation Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use 90mm thick R2.2 glass wool insulation.

EPB Plasterboard Lining

<u>NB</u>: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 13mm EPB MultiSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings

Fasteners

41mm x 6g High Thread Drywall Screws


Fastener Centres

Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

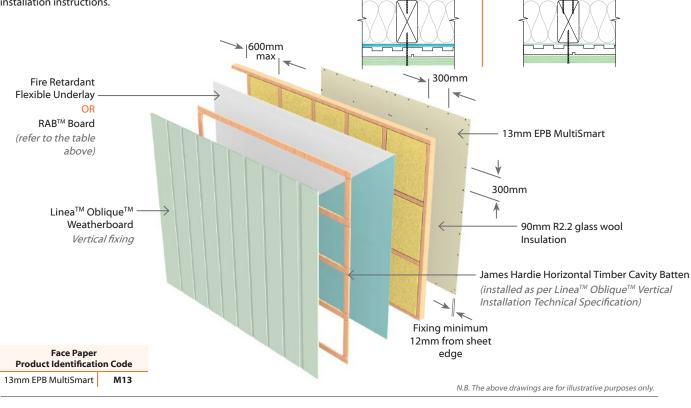

nt Flexible Underlay

Two Way FRR

EJW<u>1TL30</u>

EPB & Hardie[™] Plank Weatherboard

External Wall - Timber Frame

	Louid Dealing				
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
EJW1TL30	-F10	30/30/30	R2.2 glass wool	45	1 x 10mm EPB FireSmart on Internal side Hardie™ Plank Weatherboard to External side

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the
- NZBC verification method B1/VM1, paragraph 22.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

Fire Retardant Flexible Underlay

Install any Fire Retardant Flexible Underlay beneath the claddings, that complies with Table 23 of E2/AS1 and has a flammability index not exceeding 5.

Cavity Batten

When Cavity Batten is required, use a nominal 20mm Timber Cavity Batten. Refer to HardieTM Plank Weatherboards Technical Specification for installation instructions.

When Cladding can be directly fixed without a cavity batten then a fire retardant flexible underlay must be used.

Hardie[™] Plank Weatherboard Cladding

Hardie[™] Plank Weatherboard cladding to external side of the timber framing. Consider the nail length required depending on the type of fixing i.e. Cavity fixing or Direct fixing. Refer to both Hardie[™] Plank Weatherboards Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Freephone 0800 353 742

Wall Insulation

Insulation must be installed between studs and nogs. Use 90mm thick R2.2 glass wool insulation.

EPB Plasterboard Lining

<u>NB</u>: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 10mm EPB FireSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

41mm x 6g High Thread Drywall Screws


Fastener Centres

Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

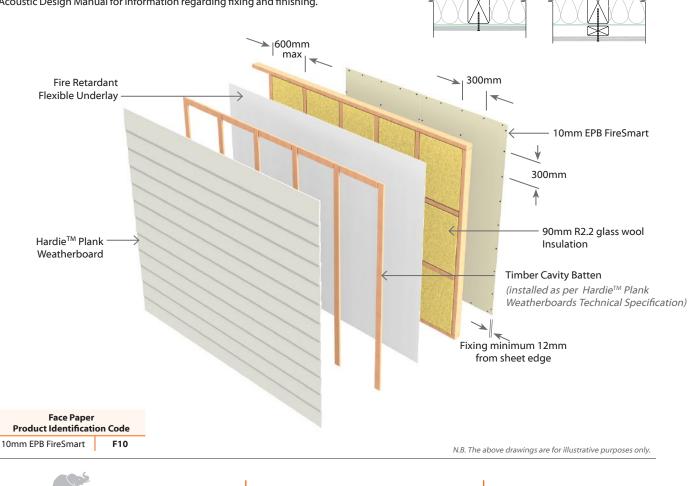

EJW1TL60

EPB & Hardie[™] Plank Weatherboard

External Wall - Timber Frame

System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement	
EJW1TL60	-M13	60/60/60	Hardie™ Mineral	46	1 x 13mm EPB MultiSmart on Internal Hardie™ Plank Weatherboard to Exter	

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the
- NZBC verification method B1/VM1, paragraph 2.2.4 Refer to latest James Hardie Fire & Acoustic Design Manual figures and

tables for further detail.

Underlay

Fire Retardant Flexible Underlay

Install any Fire Retardant Flexible Underlay beneath the claddings, that complies with Table 23 of E2/AS1 and has a flammability index not exceeding 5.

Cavity Batten

When Cavity Batten is required, use a nominal 20mm Timber Cavity Batten. Refer to HardieTM Plank Weatherboards Technical Specification for installation instructions.

When Cladding can be directly fixed without a cavity batten then a fire retardant flexible underlay must be used.

Hardie[™] Plank Weatherboard Cladding

Hardie[™] Plank Weatherboard cladding to external side of the timber framing. Consider the nail length required depending on the type of fixing i.e. Cavity fixing or Direct fixing. Refer to both Hardie[™] Plank Weatherboards Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use Hardie™ Mineral insulation.

EPB Plasterboard Lining

<u>NB</u>: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 13mm EPB MultiSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

41mm x 6g High Thread Drywall Screws


Fastener Centres

Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

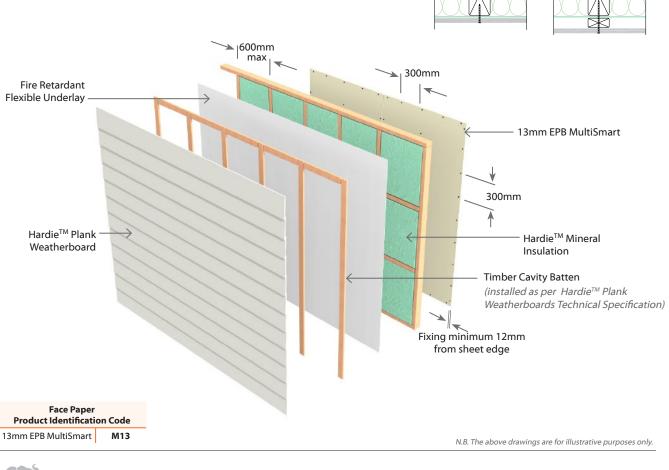

Two Way FRR

EJSh1TL30

EPB & James Hardie Stria™ Cladding - Horizontal

External Wall - Timber Frame

		anne	2000 Deaning		
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
EJSh1TL30	-F10	30/30/30	R2.2 glass wool	46	1 x 10mm EPB FireSmart on Internal side James Hardie Stria™ Cladding horizontal to External side

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

For the type of allowable underlay refer to table below.

	EH Wind Zone	Other Wind Zone
Buildings <10m	RAB	Flexible Underlay
Buildings >10m	RAB	RAB

Fire Retardant Flexible Underlay

Install any Fire Retardant Flexible Underlay beneath the claddings, that complies with Table 23 of E2/AS1 and has a flammability index not exceeding 5.

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing.

6mm RAB™ Board : Use 40 x 2.8mm fibre cement nail at 200mm centres 9mm RAB™ Board : Use 50 x 2.8mm fibre cement nail at 200mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

Use a nominal 20mm Timber Cavity Batten. Refer to Stria[™] Cladding Timber Cavity Batten Horizontal Technical Specification for installation instructions.

James Hardie Stria[™] Cladding - Horizontal

James Hardie StriaTM Cladding fixed horizontally to external side of the timber framing. Refer to both StriaTM Cladding Timber Cavity Batten Horizontal Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use 90mm thick R2.2 glass wool insulation.

EPB Plasterboard Lining

<u>NB</u>: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 10mm EPB FireSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

41mm x 6g High Thread Drywall Screws

Fastener Centres

en using RAB™ Board


Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

When using Fire Retardant Flexible Underlay

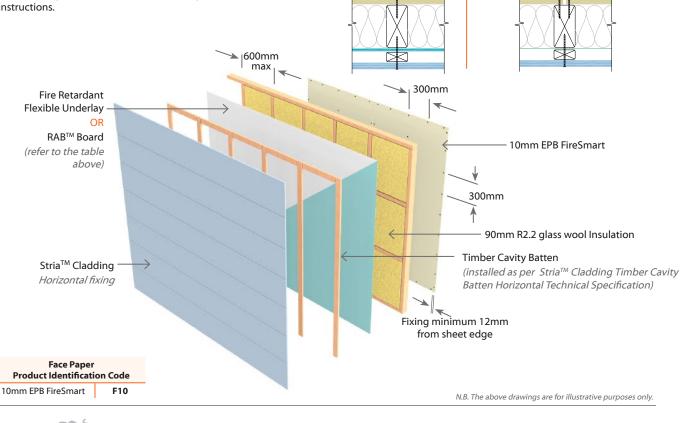

Freephone 0800 353 742

EJSv1TL30

EPB & James Hardie Stria[™] Cladding - Vertical

External Wall - Timber Frame

	Load Dearing				
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
EJSv1TL30	-F10	30/30/30	R2.2 glass wool	46	1 x 10mm EPB FireSmart on Internal side James Hardie Stria [™] Cladding vertical to External side

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

For the type of allowable underlay refer to table below.

	EH Wind Zone	Other Wind Zone
Buildings <10m	RAB	Flexible Underlay
Buildings >10m	RAB	RAB

Fire Retardant Flexible Underlay

Install any Fire Retardant Flexible Underlay beneath the claddings, that complies with Table 23 of E2/AS1 and has a flammability index not exceeding 5.

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing.

6mm RAB™ Board : Use 40 x 2.8mm fibre cement nail at 200mm centres 9mm RAB™ Board : Use 50 x 2.8mm fibre cement nail at 200mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

Use a 20mm James Hardie Horizontal Timber Cavity Batten. Refer to StriaTM Cladding Vertical Technical Specification for installation instructions.

James Hardie Stria[™] Cladding - Vertical

James Hardie Stria[™] Cladding fixed vertically to external side of the timber framing. Refer to both Stria[™] Cladding Vertical Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use 90mm thick R2.2 glass wool insulation.

EPB Plasterboard Lining

<u>NB</u>: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 10mm EPB FireSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

41mm x 6g High Thread Drywall Screws

Fastener Centres

When using RAB[™] Board


Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

When using Fire Retardant Flexible Underlay

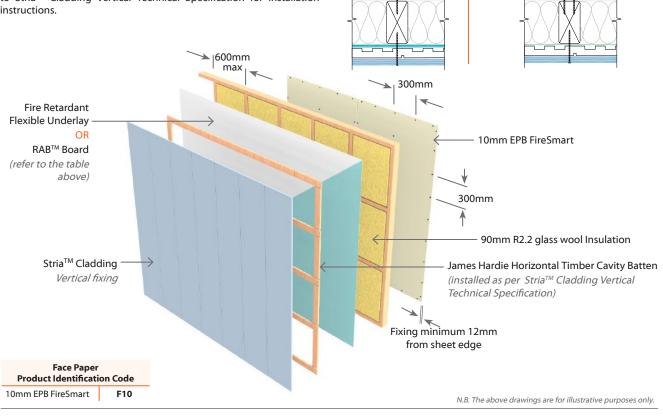

Two Way FRR

EJSh1TL60

EPB & James Hardie Stria[™] Cladding - Horizontal

External Wall - Timber Frame

System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement		
EJSh1TL60	-M13	60/60/60	R2.2 glass wool	47	1 x 13mm EPB MultiSmart on Internal side James Hardie Stria™ Cladding horizontal to External side		

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.
- The fire rated walls built close to boundary are also required to
- achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

For the type of allowable underlay refer to table below.

	EH Wind Zone	Other Wind Zone
Buildings <10m	RAB	Flexible Underlay
Buildings >10m	RAB	RAB

Fire Retardant Flexible Underlay

Install any Fire Retardant Flexible Underlay beneath the claddings, that complies with Table 23 of E2/AS1 and has a flammability index not exceeding 5.

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing.

6mm RAB[™] Board : Use 40 x 2.8mm fibre cement nail at 200mm centres 9mm RAB[™] Board : Use 50 x 2.8mm fibre cement nail at 200mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

Use a nominal 20mm Timber Cavity Batten. Refer to Stria[™] Cladding Timber Cavity Batten Horizontal Technical Specification for installation instructions.

James Hardie Stria[™] Cladding - Horizontal

James Hardie Stria[™] Cladding fixed horizontally to external side of the timber framing. Refer to both Stria[™] Cladding Timber Cavity Batten Horizontal Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use 90mm thick R2.2 glass wool insulation.

EPB Plasterboard Lining

<u>NB</u>: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 13mm EPB MultiSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

asteriers

41mm x 6g High Thread Drywall Screws

Fastener Centres

en using RAB™ Board


Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

When using Fire Retardant Flexible Underlay

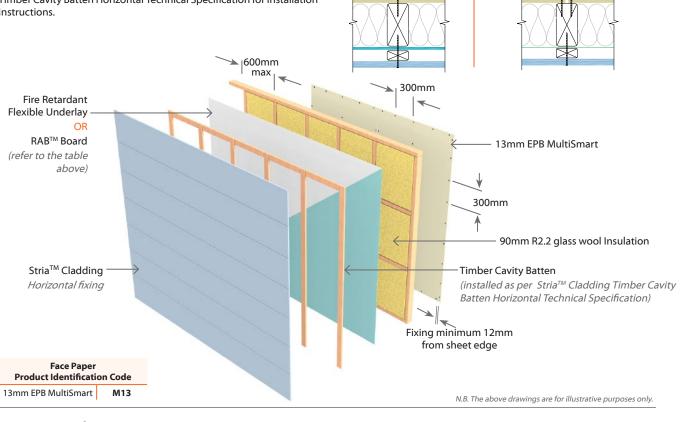

EPB & James Hardie Stria[™] Cladding - Vertical

EJSv1TL60

External Wall - Timber Frame

	Load Bearing				
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
EJSv1TL60	-M13	60/60/60	R2.2 glass wool	47	1 x 13mm EPB MultiSmart on Internal side James Hardie Stria [™] Cladding vertical to External side

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.
- The fire rated walls built close to boundary are also required to
- achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

For the type of allowable underlay refer to table below.

	EH Wind Zone	Other Wind Zone
Buildings <10m	RAB	Flexible Underlay
Buildings >10m	RAB	RAB

Fire Retardant Flexible Underlay

Install any Fire Retardant Flexible Underlay beneath the claddings, that complies with Table 23 of E2/AS1 and has a flammability index not exceeding 5.

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing. 6mm RAB[™] : Use 40 x 2.8mm fibre cement nail at 200mm centres 9mm RAB[™] : Use 50 x 2.8mm fibre cement nail at 200mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

Use a 20mm James Hardie Horizontal Timber Cavity Batten. Refer to Stria $^{\rm TM}$ Cladding Vertical Technical Specification for installation instructions.

James Hardie Stria[™] Cladding - Vertical

James Hardie Stria[™] Cladding fixed vertically to external side of the timber framing. Refer to both Stria[™] Cladding Vertical Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use 90mm thick R2.2 glass wool insulation.

EPB Plasterboard Lining

<u>NB</u>: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 13mm EPB MultiSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

41mm x 6g High Thread Drywall Screws

en using RAB[™] Board

Fastener Centres


Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

When using Fire Retardant Flexible Underlay

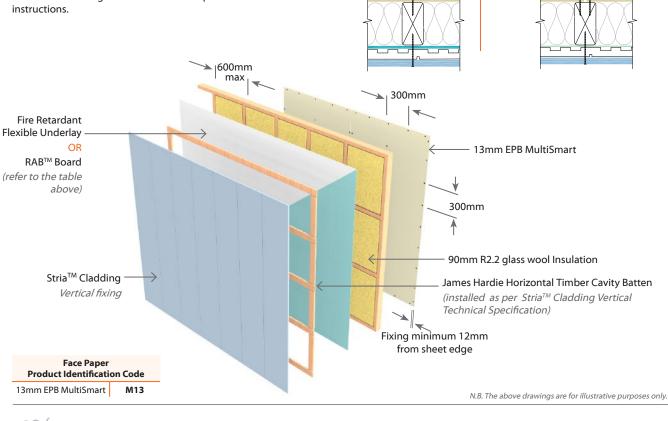

Freephone 0800 353 742

Two Way FRR

EJRS1TL30

EPB & James Hardie Stria[™] Cladding & RAB[™] Board with CLD[™] Battens

External Wall - Timber Frame

					g
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
EJRS1TL30	-F10	30/30/30	R2.2 glass wool	46	1 x 10mm EPB FireSmart on Internal side James Hardie Stria™ Cladding and RAB™ Board with CLD™ Structural Cavity Batten to External side

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing. 6mm RAB[™] Board : Use 40 x 2.8mm fibre cement nail at 150mm centres

9mm RAB™ Board : Use 50 x 2.8mm fibre cement nail at 150mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

Use 70 x 19mm CLD[™] Structural Cavity Batten. Refer to Stria[™] Cladding CLD Structural Cavity Batten Technical Specification for installation instructions.

James Hardie Stria[™] Cladding

James Hardie Stria™ Cladding fixed horizontally to external side of the timber framing. Refer to both Stria™ Cladding CLD Structural Cavity Batten Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use 90mm thick R2.2 glass wool insulation.

EPB Plasterboard Lining

<u>NB</u>: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 10mm EPB FireSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

41mm x 6g High Thread Drywall Screws


Fastener Centres

Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

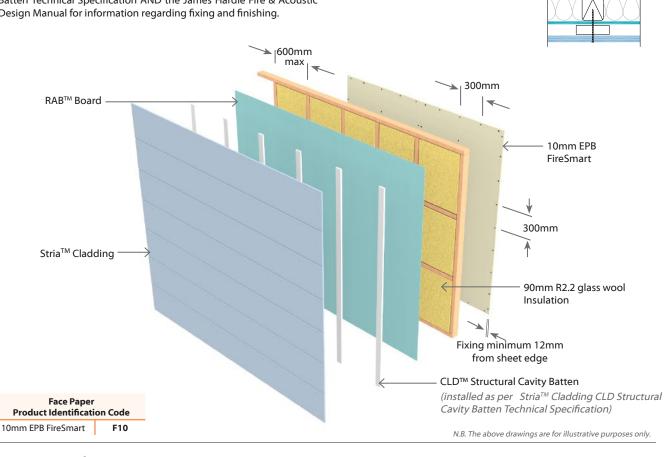

The Freep

EJRS1TL60

EPB & James Hardie Stria[™] Cladding & RAB[™] Board with CLD[™] Battens

External Wall - Timber Frame

					Loud Dealing
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
EJRS1TL60	-M13	60/60/60	Hardie™ Mineral	47	1 x 13mm EPB MultiSmart on Internal side James Hardie Stria™ Cladding and RAB™ Board with CLD™ Structural Cavity Batten to External side

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.

• The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing.

6mm RAB[™] Board : Use 40 x 2.8mm fibre cement nail at 150mm centres 9mm RAB[™] Board : Use 50 x 2.8mm fibre cement nail at 150mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

Use 70 x 19mm CLD[™] Structural Cavity Batten. Refer to Stria[™] Cladding CLD Structural Cavity Batten Technical Specification for installation instructions.

James Hardie Stria[™] Cladding

James Hardie Stria[™] Cladding fixed horizontally to external side of the timber framing. Refer to both Stria[™] Cladding CLD Structural Cavity Batten Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use Hardie™ Mineral insulation.

EPB Plasterboard Lining

<u>NB:</u> The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 13mm EPB MultiSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

41mm x 6g High Thread Drywall Screws


Fastener Centres

Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

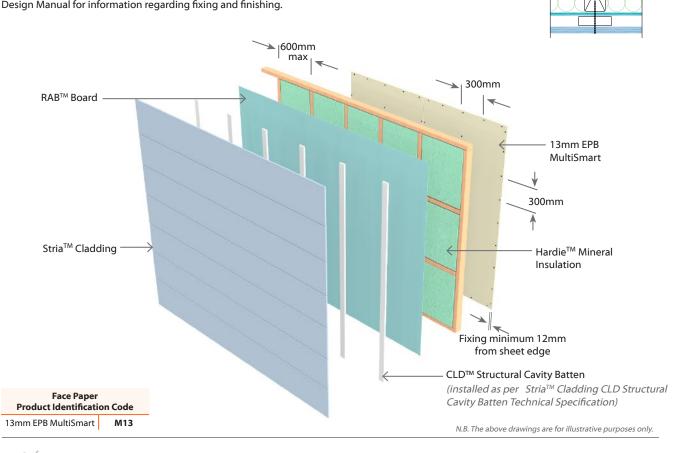

Two Way FRR

Two Way FRR

EJF1TL30

EPB & James Hardie Hardie[™] Flex Sheet

External Wall - Timber Frame

System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
EJF1TL30	-F10	30/30/30	R2.2 glass wool	42	1 x 10mm EPB FireSmart on Internal side James Hardie Hardie™Flex Sheet to External side

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.
- The fire rated walls built close to boundary are also required to
- achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

Fire Retardant Flexible Underlay

Install any Fire Retardant Flexible Underlay beneath the claddings, that complies with Table 23 of E2/AS1 and has a flammability index not exceeding 5.

Cavity Batten

When Cavity Batten is required, use a nominal 20mm Timber Cavity Batten. Refer to James Hardie HardieTM Flex Sheet Technical Specification.

When Cladding can be directly fixed without a cavity batten then a fire retardant flexible underlay must be used.

James Hardie Hardie[™] Flex Sheet Cladding

James Hardie Hardie[™] Flex Sheet cladding to external side of the timber framing. Consider the nail length required depending on the type of fixing i.e. Cavity fixing or Direct fixing. Refer to both James Hardie Hardie[™] Flex Sheet Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use 90mm thick R2.2 glass wool insulation.

EPB Plasterboard Lining

<u>NB</u>: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 10mm EPB FireSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

41mm x 6g High Thread Drywall Screws


Fastener Centres

Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

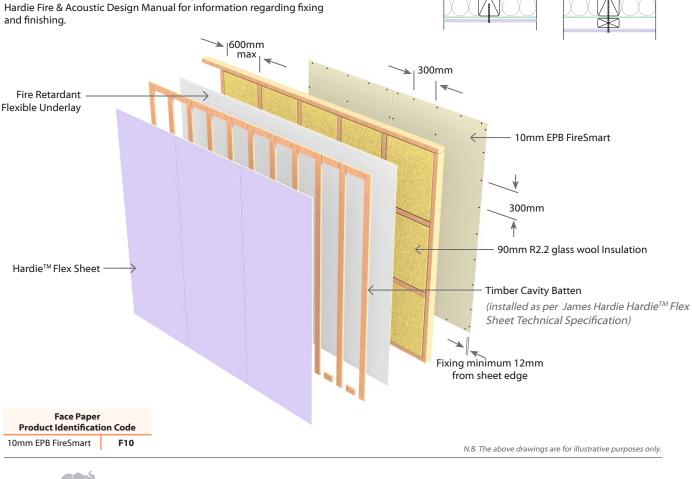

EJF1TL60

EPB & James Hardie Hardie[™] Flex Sheet

External Wall - Timber Frame

	Load Dearing				
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
EJF1TL60	-M13	60/60/60	Hardie™ Mineral	43	1 x 13mm EPB MultiSmart on Internal side James Hardie Hardie™Flex Sheet to External side

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the
- NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

Fire Retardant Flexible Underlay

Install any Fire Retardant Flexible Underlay beneath the claddings, that complies with Table 23 of E2/AS1 and has a flammability index not exceeding 5.

Cavity Batten

When Cavity Batten is required, use a nominal 20mm Timber Cavity Batten. Refer to James Hardie Hardie[™] Flex Sheet Technical Specification.

When Cladding can be directly fixed without a cavity batten then a fire retardant flexible underlay must be used.

James Hardie Hardie[™] Flex Sheet Cladding

James Hardie Hardie[™] Flex Sheet cladding to external side of the timber framing. Consider the nail length required depending on the type of fixing i.e. Cavity fixing or Direct fixing. Refer to both James Hardie Hardie[™] Flex Sheet Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use Hardie[™] Mineral insulation.

EPB Plasterboard Lining

<u>NB</u>: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 13mm EPB MultiSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

41mm x 6g High Thread Drywall Screws


Fastener Centres

Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

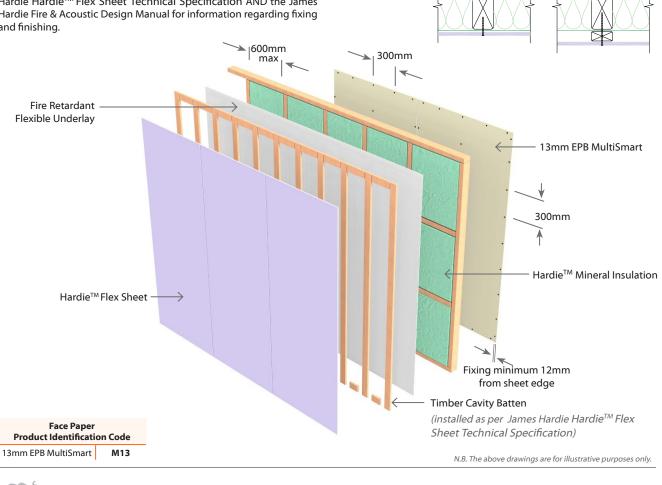

Two Way FRR

Two Way FRR

EJA1TL30

EPB & James Hardie Axon[™] Panel

External Wall - Timber Frame

External Wall - T	Load Bearing				
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
EJA1TL30	-F10	30/30/30	R2.2 glass wool	41	1 x 10mm EPB FireSmart on Internal side James Hardie Axon™ Panel to External side

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- · Maximum stud spacing's are 600mm centres.
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the

NZBC verification method B1/VM1, paragraph 2.2.4 Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

For the type of allowable underlay refer to table below.

	EH Wind Zone	Other Wind Zone
Buildings <10m	RAB	Flexible Underlay
Buildings >10m	RAB	RAB

Fire Retardant Flexible Underlay

Install any Fire Retardant Flexible Underlay beneath the claddings, that complies with Table 23 of E2/AS1 and has a flammability index not exceeding 5.

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing.

6mm RAB[™] Board : Use 40 x 2.8mm fibre cement nail at 200mm centres 9mm RAB[™] Board : Use 50 x 2.8mm fibre cement nail at 200mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

48

When Cavity Batten is required, use a nominal 20mm Timber Cavity Batten. Refer to Axon[™] Panel Timber Cavity Batten Technical Specification. When Cladding is allowed to be directly fixed without a cavity batten then a fire retardant flexible underlay must be used.

Freephone 0800 353 742

James Hardie Axon[™] Panel Cladding

James Hardie Axon[™] Panel cladding to external side of the timber framing. Consider the nail length required depending on the type of fixing i.e. Cavity fixing or Direct fixing. Refer to both Axon[™] Panel Timber Cavity Batten Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use 90mm thick R2.2 glass wool insulation.

EPB Plasterboard Lining

NB: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 10mm EPB FireSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings

Fasteners

41mm x 6g High Thread Drywall Screws

Fastener Centres

When using RAB[™] Board


Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

When using Fire Retardant Flexible Underlay

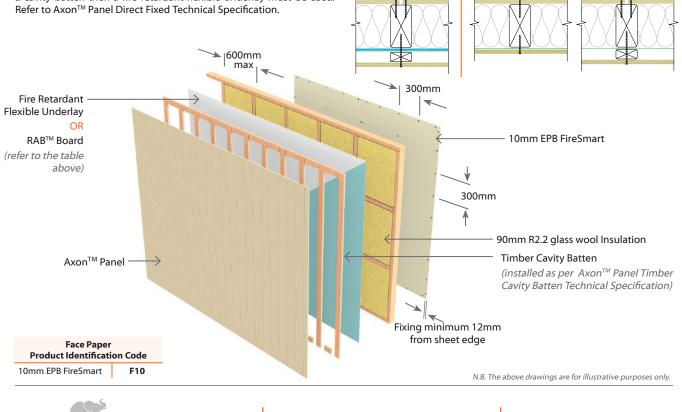

www.elephantplasterboard.co.nz

EJA1TL60

EPB & James Hardie Axon[™] Panel

External Wall - Timber Frame

System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement			
EJA1TL60	-M13	60/60/60	Hardie™ Mineral	42	1 x 13mm EPB MultiSmart on Internal side James Hardie Axon™ Panel to External side			

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.

• The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

For the type of allowable underlay refer to table below.

	EH Wind Zone	Other Wind Zone
Buildings <10m	RAB	Flexible Underlay
Buildings >10m	RAB	RAB

Fire Retardant Flexible Underlay

Install any Fire Retardant Flexible Underlay beneath the claddings, that complies with Table 23 of E2/AS1 and has a flammability index not exceeding 5.

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing.

6mm RAB[™] Board : Use 40 x 2.8mm fibre cement nail at 200mm centres 9mm RAB[™] Board : Use 50 x 2.8mm fibre cement nail at 200mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

When Cavity Batten is required, use a nominal 20mm Timber Cavity Batten. Refer to $Axon^{TM}$ Panel Timber Cavity Batten Technical Specification. When Cladding is allowed to be directly fixed without a cavity batten then a fire retardant flexible underlay must be used. Refer to $Axon^{TM}$ Panel Direct Fixed Technical Specification.

James Hardie Axon[™] Panel Cladding

James Hardie Axon[™] Panel cladding to external side of the timber framing. Consider the nail length required depending on the type of fixing i.e. Cavity fixing or Direct fixing. Refer to both Axon[™] Panel Timber Cavity Batten Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use Hardie™ Mineral insulation.

EPB Plasterboard Lining

<u>NB</u>: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 13mm EPB MultiSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings

Fasteners

41mm x 6g High Thread Drywall Screws

Fastener Centres

When using RAB™ Board


Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

When using Fire Retardant Flexible Underlay

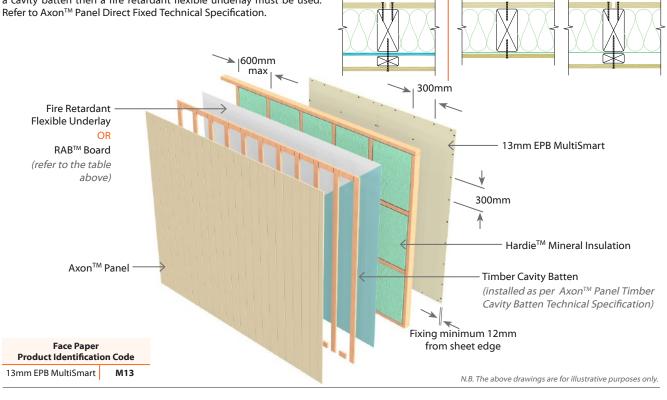

Two Way FRR

October 2024

Load Bearing

Two Way FRR

EJRA1TL30

EPB & James Hardie Axon[™] Panel & RAB[™] Board on CLD[™] Battens

External Wall - Timber Frame

					Eodd Dealling	
System Number	Lining Suffix	ng Frr FRR Insulation Cor		Noise Control STC	Lining Requirement	
EJRA1TL30	-F10	30/30/30	R2.2 glass wool	45	1 x 10mm EPB FireSmart on Internal side James Hardie Axon™ Panel and RAB™ Board with CLD™ Structural Cavity Batten to External side	

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.

 The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing. 6mm RAB[™] Board : Use 40 x 2.8mm fibre cement nail at 150mm centres 9mm RAB[™] Board : Use 50 x 2.8mm fibre cement nail at 150mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

Use 70 x 19mm CLD[™] Structural Cavity Batten. Refer to Axon[™] Panel CLD Structural Cavity Batten Technical Specification.

James Hardie Axon™ Panel Cladding

James Hardie Axon[™] Panel cladding to external side of the timber framing. Refer to both Axon[™] Panel CLD Structural Cavity Batten Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use 90mm thick R2.2 glass wool insulation.

EPB Plasterboard Lining

<u>NB</u>: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 10mm EPB FireSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

41mm x 6g High Thread Drywall Screws


Fastener Centres

Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

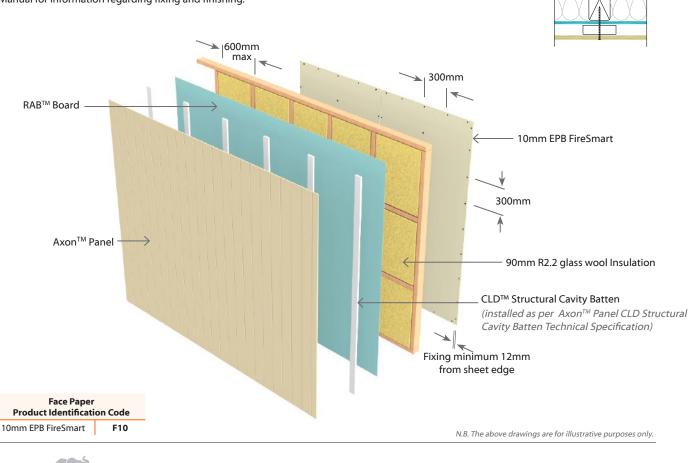

EJRA1TL60

EPB & James Hardie Axon[™] Panel & RAB[™] Board on CLD[™] Battens

Two Way FRR

External Wall - Timber Frame

External Wall -	External Wall - Timber Frame								
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement				
EJRA1TL60	-M13	60/60/60	Hardie™ Mineral	46	1 x 13mm EPB MultiSmart on Internal side James Hardie Axon™ Panel and RAB™ Board with CLD™ Structural Cavity Batten to External side				

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- · Maximum stud spacing's are 600mm centres.

• The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing. 6mm RAB[™] Board : Use 40 x 2.8mm fibre cement nail at 150mm centres 9mm RAB[™] Board : Use 50 x 2.8mm fibre cement nail at 150mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

Use 70 x 19mm CLD[™] Structural Cavity Batten. Refer to Axon[™] Panel CLD Structural Cavity Batten Technical Specification.

James Hardie Axon[™] Panel Cladding

James Hardie Axon[™] Panel cladding to external side of the timber framing. Refer to both Axon[™] Panel CLD Structural Cavity Batten Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use Hardie™ Mineral insulation.

EPB Plasterboard Lining

NB: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 13mm EPB MultiSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

41mm x 6g High Thread Drywall Screws


Fastener Centres

Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

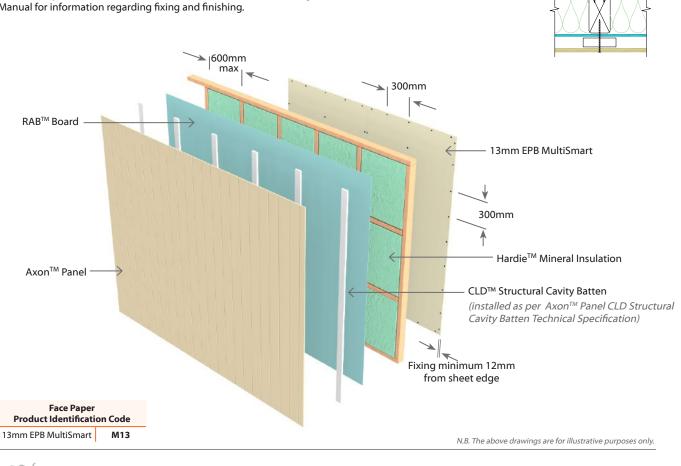

Two Way FRR

EJE1TL30

EPB & James Hardie EasyLap[™] Panel

External Wall - Timber Frame

System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement			
EJE1TL30	-F10	30/30/30	R2.2 glass wool	42	1 x 10mm EPB FireSmart on Internal side James Hardie EasyLap [™] Panel to External side			

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

For the type of allowable underlay refer to table below.

	EH Wind Zone	Other Wind Zone
Buildings <10m	RAB	Flexible Underlay
Buildings >10m	RAB	RAB

Fire Retardant Flexible Underlay

Install any Fire Retardant Flexible Underlay beneath the claddings, that complies with Table 23 of E2/AS1 and has a flammability index not exceeding 5.

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing.

6mm RAB™ Board : Use 40 x 2.8mm fibre cement nail at 200mm centres 9mm RAB™ Board : Use 50 x 2.8mm fibre cement nail at 200mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

When Cavity Batten is required, use a nominal 20mm Timber Cavity Batten. Refer to Axon[™] Panel & EasyLap[™] Panel Timber Cavity Batten Technical Specification for installation instructions.

James Hardie EasyLap[™] Panel Cladding

James Hardie EasyLap[™] Panel cladding to external side of the timber framing. Refer to both Axon[™] Panel & EasyLap[™] Panel Timber Cavity Batten Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use 90mm thick R2.2 glass wool insulation.

EPB Plasterboard Lining

<u>NB</u>: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 10mm EPB FireSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

41mm x 6g High Thread Drywall Screws

Fastener Centres

When using RARTM Roard


Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

When using Fire Retardant Flexible Underlay

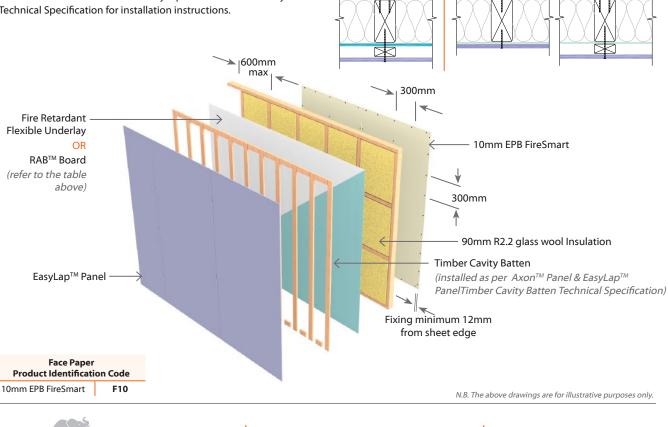

EJE1TL60

EPB & James Hardie EasyLap[™] Panel

External Wall - Timber Frame

	Load Dealing					
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement	
EJE1TL60	-M13	60/60/60	Hardie™ Mineral	43	1 x 13mm EPB MultiSmart on Internal side James Hardie EasyLap [™] Panel to External side	

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- · Maximum stud spacing's are 600mm centres.
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

For the type of allowable underlay refer to table below.

	EH Wind Zone	Other Wind Zone
Buildings <10m	RAB	Flexible Underlay
Buildings >10m	RAB	RAB

Fire Retardant Flexible Underlay

Install any Fire Retardant Flexible Underlay beneath the claddings, that complies with Table 23 of E2/AS1 and has a flammability index not exceeding 5.

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing.

6mm RAB™ Board : Use 40 x 2.8mm fibre cement nail at 200mm centres 9mm RAB™ Board : Use 50 x 2.8mm fibre cement nail at 200mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

When Cavity Batten is required, use a nominal 20mm Timber Cavity Batten. Refer to Axon[™] Panel & EasyLap[™] Panel Timber Cavity Batten Technical Specification for installation instructions.

James Hardie EasyLap[™] Panel Cladding

James Hardie EasyLap[™] Panel cladding to external side of the timber framing. Refer to both Axon[™] Panel & EasyLap[™] Panel Timber Cavity Batten Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use Hardie™ Mineral insulation.

EPB Plasterboard Lining

<u>NB</u>: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 13mm EPB MultiSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

41mm x 6g High Thread Drywall Screws

Fastener Centres

When using RAB[™] Board


Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

When using Fire Retardant Flexible Underlay

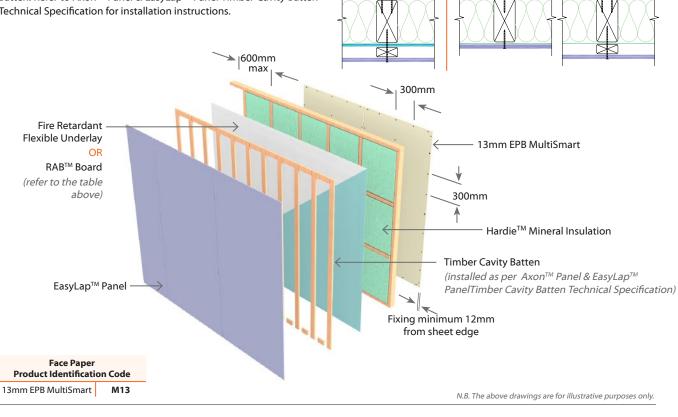

Two Way FRR

Two Way FRR

EJRE1TL30

EPB & James Hardie EasyLap[™] Panel & RAB[™] Board with CLD[™] Battens

External Wall - Timber Frame

-			-					 5
Sy	stem Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement		
E	EJRE1TL30	-F10	30/30/30	R2.2 glass wool	46	1 x 10mm EPB FireSmart on Internal si James Hardie EasyLap™ Panel and RA with CLD™ Structural Cavity Batten to	B™ Board	

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.

• The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing.

6mm RAB[™] Board : Use 40 x 2.8mm fibre cement nail at 150mm centres 9mm RAB[™] Board : Use 50 x 2.8mm fibre cement nail at 150mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

Use 70 x 19mm CLD[™] Structural Cavity Batten. Refer to EasyLap[™] Panel Technical Specification

James Hardie EasyLap[™] Panel Cladding

James Hardie EasyLap[™] Panel cladding to external side of the timber framing. Refer to both EasyLap™ Panel Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use 90mm thick R2.2 glass wool insulation.

EPB Plasterboard Lining

NB: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 10mm EPB FireSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

41mm x 6g High Thread Drywall Screws


Fastener Centres

Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

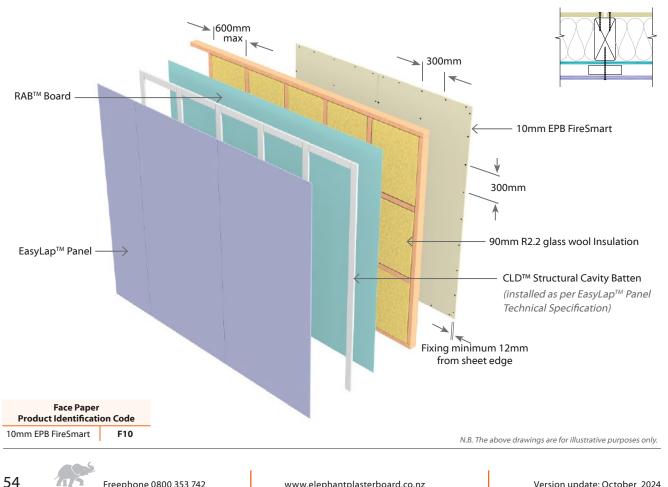

EJRE1TL60

EPB & James Hardie EasyLap[™] Panel & RAB[™] Board with CLD[™] Battens

Two Way FRR

External Wall - Timber Frame

External Wall - T	Load Bearing					
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement	
EJRE1TL60	-M13	60/60/60	Hardie™ Mineral	47	1 x 13mm EPB MultiSmart on Internal side James Hardie EasyLap™ Panel and RAB™ Board with CLD™ Structural Cavity Batten to External side	

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.

• The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing. 6mm RAB[™] Board : Use 40 x 2.8mm fibre cement nail at 150mm centres 9mm RAB[™] Board : Use 50 x 2.8mm fibre cement nail at 150mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

Use 70 x 19mm CLD[™] Structural Cavity Batten. Refer to EasyLap[™] Panel Technical Specification

James Hardie EasyLap[™] Panel Cladding

James Hardie EasyLap[™] Panel cladding to external side of the timber framing. Refer to both EasyLap[™] Panel Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use Hardie™ Mineral insulation.

EPB Plasterboard Lining

NB: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 13mm EPB MultiSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

41mm x 6g High Thread Drywall Screws


Fastener Centres

Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide

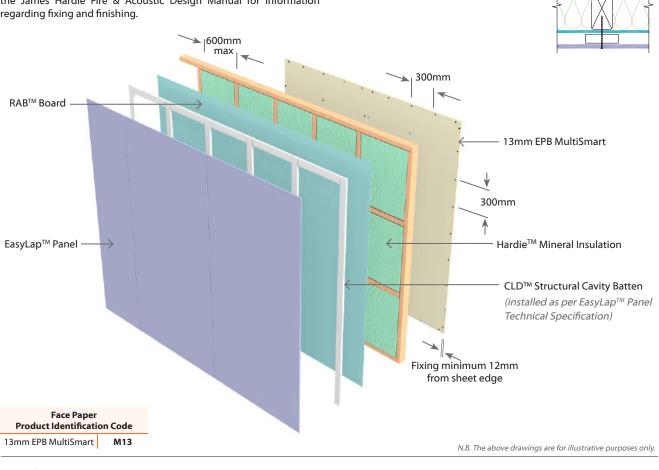

October 2024

Load Bearing

Two Way FRR

EJRX1TL30

EPB & JH ExoTec[™] Facade Panel & RAB[™] Board with Top Hat System

External Wall - Timber Frame

					Louid Dealing	
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement	
EJRX1TL30	-F10	30/30/30	R2.2 glass wool	47	1 x 10mm EPB FireSmart on Internal side James Hardie ExoTec™ Facade Panel and RAB™ Board with Top hat system to External side	

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.

 The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing.

6mm RAB™ Board : Use 40 x 2.8mm fibre cement nail at 150mm centres 9mm RAB™ Board : Use 50 x 2.8mm fibre cement nail at 150mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

Use ExoTec[™] Top hat system. Refer to ExoTec[™] Facade Panel Top Hat Rainscreen Technical Specification

James Hardie ExoTec[™] Facade Panel Cladding

James Hardie ExoTec[™] Facade Panel cladding to external side of the timber framing. Refer to both ExoTec[™] Facade Panel Top Hat Rainscreen Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use 90mm thick R2.2 glass wool insulation.

EPB Plasterboard Lining

<u>NB</u>: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 10mm EPB FireSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

41mm x 6g High Thread Drywall Screws


Fastener Centres

Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

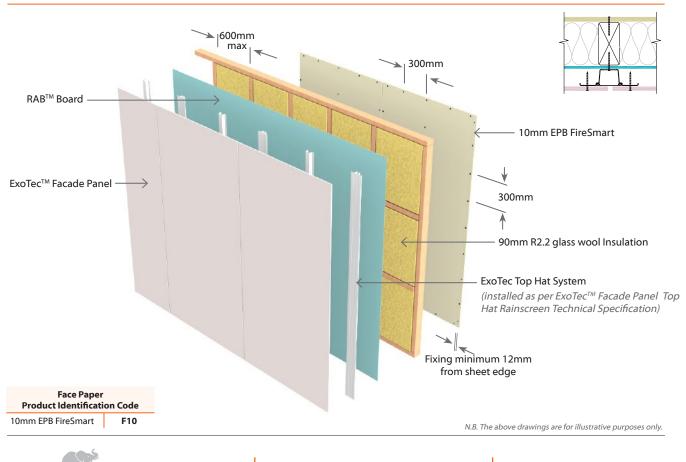

EJRX1TL60

EPB & JH ExoTec[™] Facade Panel & RAB[™] Board with Top Hat System

Two Way FRR

External Wall - Timber Frame

External Wall - T	Load Bearing					
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement	
EJRX1TL60	-M13	60/60/60	Hardie™ Mineral	48	1 x 13mm EPB MultiSmart on Internal side James Hardie ExoTec™ Facade Panel and RAB™ Board with Top hat system to External side	

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.

• The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

Underlay

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing. 6mm RAB[™] Board : Use 40 x 2.8mm fibre cement nail at 150mm centres 9mm RAB[™] Board : Use 50 x 2.8mm fibre cement nail at 150mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

Use ExoTec[™] Top hat system. Refer to ExoTec[™] Facade Panel Top Hat **Rainscreen Technical Specification**

James Hardie ExoTec[™] Facade Panel Cladding

James Hardie ExoTec[™] Facade Panel cladding to external side of the timber framing. Refer to both ExoTec[™] Facade Panel Top Hat Rainscreen Technical Specification AND the James Hardie Fire & Acoustic Design Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use Hardie™ Mineral insulation.

EPB Plasterboard Lining

NB: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 13mm EPB MultiSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

41mm x 6g High Thread Drywall Screws


Fastener Centres

Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

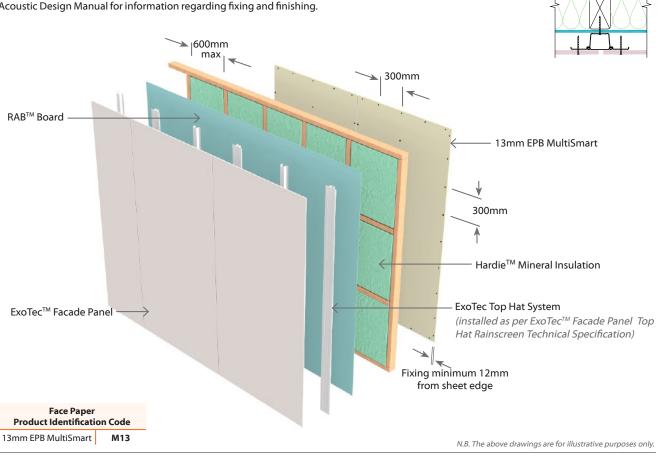

Two Way FRR

EJRN1TL30 EPB & James Hardie RAB[™] Board & a Weathertight Cladding

External Wall - Timber Frame

	Loud Dealing				
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
EJRN1TL30	-F10	30/30/30	R2.2 glass wool	42	1 x 10mm EPB FireSmart on Internal side James Hardie RAB™ Board with a Weathertight Cladding to External side

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further instructions.

Underlay

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing.

6mm RAB[™] Board : Use 40 x 2.8mm fibre cement nail at 150mm centres 9mm RAB[™] Board : Use 50 x 2.8mm fibre cement nail at 150mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

Cavity battens as per cladding manufacturer's technical specification. Weathertight Cladding

The Exterior wall must be clad with a suitable weathertight material. Cladding fixed as per manufacturer's technical specification.

N.B: It is important to consider the fire properties of the external cladding is in accordance with NZBC C/VM1 or C/AS documents.

Refer to Table 5.1 of Section 5.4 of C/AS1 and Table 5.5 of Section 5.8.1 of C/AS2 for the information about various risk groups to identify the external fire spread safety requirement applicable to the exterior surface finishes.

Wall Insulation

Insulation must be installed between studs and nogs. Use 90mm thick R2.2 glass wool insulation.

EPB Plasterboard Lining

NB: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 10mm EPB FireSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

41mm x 6g High Thread Drywall Screws


Fastener Centres

Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

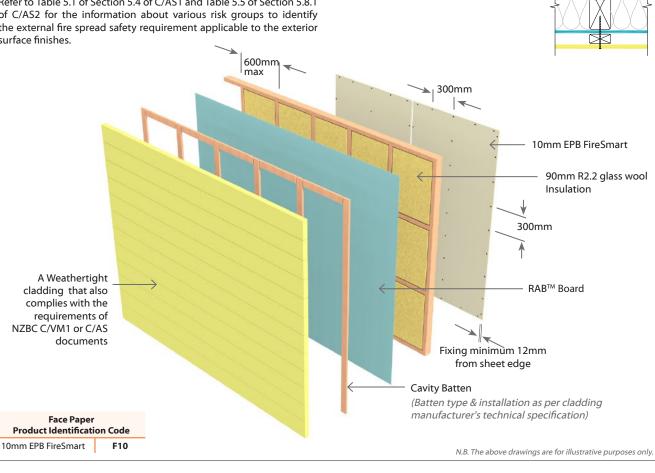

EJRN1TL60

EPB & James Hardie RAB[™] Board & a Weathertight Cladding

Two Way FRR

Load Bearing

External Wall - Timber Frame

	Loud Dealing				
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
EJRN1TL60	-M13	60/60/60	Hardie™ Mineral	42	1 x 13mm EPB MultiSmart on Internal side James Hardie RAB™ Board with a Weathertight Cladding to External side

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further instructions.

Underlay

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing.

6mm RAB[™] Board : Use 40 x 2.8mm fibre cement nail at 150mm centres 9mm RAB[™] Board : Use 50 x 2.8mm fibre cement nail at 150mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

Cavity battens as per cladding manufacturer's technical specification. Weathertight Cladding

The Exterior wall must be clad with a suitable weathertight material. Cladding fixed as per manufacturer's technical specification.

N.B: It is important to consider the fire properties of the external cladding is in accordance with NZBC C/VM1 or C/AS documents.

Refer to Table 5.1 of Section 5.4 of C/AS1 and Table 5.5 of Section 5.8.1

Wall Insulation

Insulation must be installed between studs and nogs. Use Hardie™ Mineral insulation.

EPB Plasterboard Lining

NB: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 13mm EPB MultiSmart lining to internal side of framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

41mm x 6g High Thread Drywall Screws


Fastener Centres

Fix at 300mm centres around sheet perimeter and up all intermediate studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

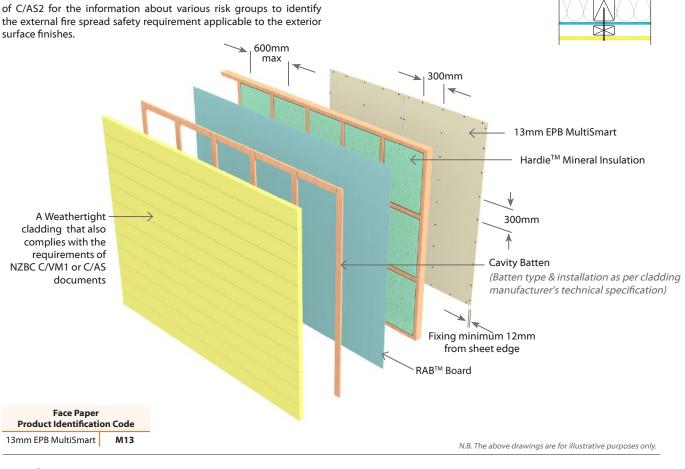

October 2024

Load Bearing

Two Way FRR

EJRN2TL60

EPB & James Hardie RAB[™] Board & a Weathertight Cladding

External Wall - Timber Frame

		-				J
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement	
	-F20	60/60/60	Hardie™ Mineral	46	2 x 10mm EPB FireSmart on Internal si James Hardie RAB [™] Board with a Wea	
EJRN2TL60	-526	60/60/60	Hardie™ Mineral	47	2 x 13mm EPB Standard on Internal sid James Hardie RAB [™] Board with a Wea	
	-M20	60/60/60	Hardie [™] Mineral	47	2 x 10mm EPB MultiSmart on Internal James Hardie RAB [™] Board with a Wea	

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

• Minimum framing dimension is 90 x 45mm.

• Nogs must be in place at a maximum of 800mm centres.

Maximum stud spacing's are 600mm centres.

• The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further instructions.

Underlay

RAB™ Board

One layer of James Hardie RAB[™] Board fixed to entire framing.

6mm RAB™ Board : Use 40 x 2.8mm fibre cement nail at 150mm centres 9mm RAB™ Board : Use 50 x 2.8mm fibre cement nail at 150mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

Cavity battens as per cladding manufacturer's technical specification.

Weathertight Cladding

The Exterior wall must be clad with a suitable weathertight material. Cladding fixed as per manufacturer's technical specification.

N.B: It is important to consider the fire properties of the external cladding is in accordance with NZBC C/VM1 or C/AS documents.

Refer to Table 5.1 of Section 5.4 of C/AS1 and Table 5.5 of Section 5.8.1 of C/AS2 for the information about various risk groups to identify the external fire spread safety requirement applicable to the exterior surface finishes.

Wall Insulation

Insulation must be installed between studs and nogs. Use Hardie™ Mineral insulation.

EPB Plasterboard Lining

<u>NB:</u> The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

Two layers of EPB Plasterboard lining to internal side of framing as per specified system above. First layer or inner layer to be fixed vertically. Vertical or Horizontal fixing permitted on outer layer only. Use full height or full length sheets where possible. All sheet joints must be fixed over solid timber framing. Vertical Joints of the outer layer should be offset 600mm from those of the inner layer. Sheet end butt joints must be formed over nogs. Offset the outer layer joints from the inner layer. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

Inner layer: 41mm x 6g High Thread Drywall Screws Outerlayer: 51mm x 7g High Thread Drywall Screws

Fastener Centres


Inner Layer: Fix at 600mm centres at sheet perimeter and all studs. Outer Layer: Fix at 300mm centres at sheet perimeter and all studs. Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Avoid outer layer screws from hitting inner layer screws.

Jointing and Finishing of EPB Plasterboard

Inner Layer: Unstopped.

Outer Layer: All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

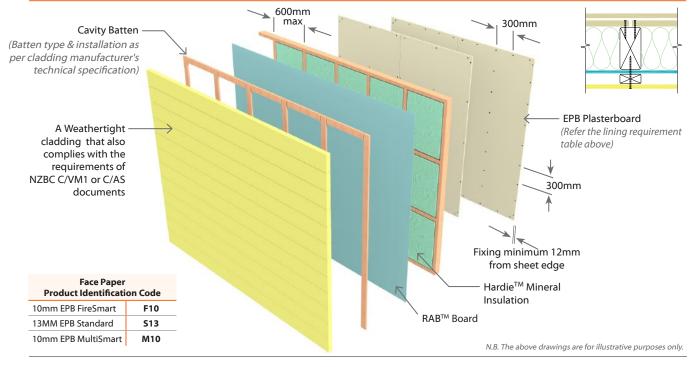

External Steel Frame Walls

EPB & RAB[™] Board with selected James Hardie Fibre Cement Cladding

October 2024

Load Bearing

Two Way FRR

External Wall - Steel Frame

EJRH1SL30

External trail 5	ce er i ran				Louid Dearning		
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement		
	-M13	30/30/30	Hardie™ Mineral	42 - 47	1 x 13mm EPB MultiSmart on Internal side James Hardie RAB™ Board with selected James Hardie cladding to External side		
EJRH1SL30	-F16	30/30/30	Hardie™ Mineral	42 - 47	1 x 16mm EPB FireSmart on Internal side James Hardie RAB™ Board with selected James Hardie Fibre Cement cladding with to External side		

Framing, Wall Height, Load and Framing Dimension

Steel framing for fire rated walls must be in accordance with NASH standard for residential and low rise buildings and AS/NZ 1170 standards. The framing shall also meet the following;

- Steel sections shall be galvanized/zinc coated and have a base metal thickness (BMT) 0.55mm minimum for non-load bearing walls and 0.75mm minimum for load bearing walls and 1.6mm maximum
- The minimum size for steel stud framing to be used in external walls shall be minimum 89mm deep x 36mm wide
- Maximum stud spacing 400mm c/c
- Maximum nogs / dwangs spacing 800mm c/c
- Steel frame must comply with the durability requirements of NZBC
 The fire rated walls built close to boundary are also required to
- The fire fated walls built close to boundary are also required to achieve post fire stability in either direction as per SED in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Thermal Fire Batten

Fire battens are used on all FRR steel stud systems and must be used between James Hardie Cladding and steel framing face.

Refer to section 4.6 of James Hardie Fire & Acoustic Design Manual for installation detail.

Pre-Cladding / Underlay

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing.

RAB[™] Board must be used to achieve fire ratings

6mm RAB™ Board : Use 40 x 2.8mm fibre cement nail at 150mm centres 9mm RAB™ Board : Use 50 x 2.8mm fibre cement nail at 150mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

Refer to the table below for the type of cavity batten required for the selected James Hardie system.

James Hardie Cladding System	Cavity Batten type
ExoTec™	Top Hat System
EasyLap™	
Stria [™] (Horizontally fixed)	CLD Structural Cavity Batten
Axon™	

CLD[™] Structural Cavity Batten:

Use 70 x 19mm CLD[™] Structural Cavity Batten.

CLDTM Structural Cavity battens to be installed according to the selected type of James Hardie cladding and as per the relevant technical specification, refer page 29 of this manual.

ExoTec[™] Top Hat System:

For ExoTec[™] Top hat system installation instructions, refer to ExoTec[™] Facade Panel Top Hat Rainscreen Technical Specification

James Hardie Fibre Cement Cladding

One layer of selected James Hardie Fibre Cement cladding to one side of the framing. See list below for allowable James Hardie claddings.

Selected Cladding System
ExoTec™
EasyLap™
Stria [™] (Horizontally fixed)
Axon™

Refer to page 29 of this manual for the above mentioned James Hardie cladding's relevant technical literature.

Also refer to James Hardie Fire & Acoustic Design Manual.

Wall Insulation

Insulation must be installed between studs and nogs. Use Hardie[™] Mineral insulation.

EPB Plasterboard Lining

<u>NB</u>: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of EPB Plasterboard lining as per specified system above to internal side of the steel framing. Vertical fixing only permitted. Use full height sheets where possible. All sheet joints must be fixed over steel framing. Where sheet end butt joints are unavoidable, they must be formed over nogs. The layer is fixed hard to the floor. Sheet shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners (As per Specified System Above)

	Single Layer
System Number	Self-Tapping Drywall Screws
EJRH1SL30-M13	13mm
EJKH I SL3U-WI I 3	32 x 6g
EJRH1SL30-F16	16mm
	32 x 6g

Fastener Centres

Fix at 300mm centres up each stud with no fixing to top and bottom channel sections.

Place fasteners no closer than 12mm from the sheet edge and 50mm from sheet ends.

Place fasteners at 200mm centres where sheet end butt joints occur. Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

EPB Plasterboard & Fibre Cement Fire Rated Systems


EJRH1SL30 EPB & RAB[™] Board with selected James Hardie Fibre Cement Cladding


Two Way FRR

Load Bearing

External Wall - Steel Frame

System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
	-M13	30/30/30	Hardie™ Mineral	42 - 47	1 x 13mm EPB MultiSmart on Internal side James Hardie RAB™ Board with selected James Hardie cladding to External side
EJRH1SL30	-F16	30/30/30	Hardie™ Mineral	42 - 47	1 x 16mm EPB FireSmart on Internal side James Hardie RAB™ Board with selected James Hardie Fibre Cement cladding with to External side



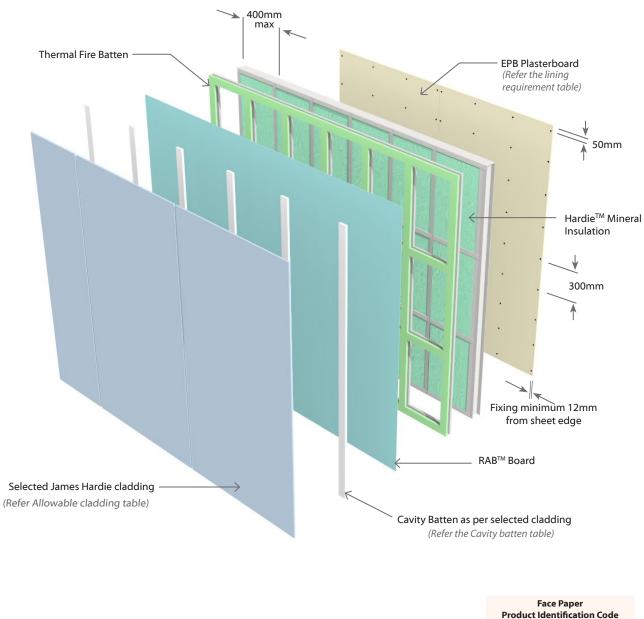

Trouvertaentineati	on coue
13mm EPB MultiSmart	M13
16mm EPB FireSmart	F16

N.B. The above drawings are for illustrative purposes only.

Two Way FRR

EJRH2SL30 EPB & RAB[™] Board with selected James Hardie Fibre Cement Cladding

External Wall - Steel Frame

External Wall - Steel Frame						Load Bearing
	System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
	EJRH2SL30	-F20	30/30/30	Hardie™ Mineral	47 - 53	2 x 10mm EPB FireSmart on Internal side James Hardie RAB™ Board with selected James Hardie cladding to External side

Framing, Wall Height, Load and Framing Dimension

Steel framing for fire rated walls must be in accordance with NASH standard for residential and low rise buildings and AS/NZ 1170 standards. The framing shall also meet the following;

- Steel sections shall be galvanized/zinc coated and have a base metal thickness (BMT) 0.55mm minimum for non-load bearing walls and 0.75mm minimum for load bearing walls and 1.6mm maximum
- The minimum size for steel stud framing to be used in external walls shall be minimum 89mm deep x 36mm wide
- Maximum stud spacing 400mm c/c
- Maximum nogs / dwangs spacing 800mm c/c
- Steel frame must comply with the durability requirements of NZBC
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction as per SED in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Thermal Fire Batten

Fire battens are used on all FRR steel stud systems and must be used between James Hardie Cladding and steel framing face.

Refer to section 4.6 of James Hardie Fire & Acoustic Design Manual for installation detail.

Pre-Cladding / Underlay

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing.

RAB[™] Board must be used to achieve fire ratings

6mm RAB[™] Board : Use 40 x 2.8mm fibre cement nail at 150mm centres 9mm RAB[™] Board : Use 50 x 2.8mm fibre cement nail at 150mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

Refer to the table below for the type of cavity batten required for the selected James Hardie system.

James Hardie Cladding System	Cavity Batten type
ExoTec™	Top Hat System
EasyLap™	
Stria [™] (Horizontally fixed)	CLD Structural Cavity Batten
Axon™	

CLD[™] Structural Cavity Batten:

Use 70 x 19mm CLD[™] Structural Cavity Batten.

CLD[™] Structural Cavity battens to be installed according to the selected type of James Hardie cladding and as per the relevant technical specification, refer page 29 of this manual.

ExoTec[™] Top Hat System:

For ExoTec[™] Top hat system installation instructions, refer to ExoTec[™] Facade Panel Top Hat Rainscreen Technical Specification

James Hardie Fibre Cement Cladding

One layer of selected James Hardie Fibre Cement cladding to one side of the framing. See list below for allowable James Hardie claddings.

Selected Cladding Type					
ExoTec™					
EasyLap™					
Stria [™] (Horizontally fixed)					
Axon™					

Refer to page 29 of this manual for the above mentioned James Hardie cladding's relevant technical literature.

Also refer to James Hardie Fire & Acoustic Design Manual.

Wall Insulation

Insulation must be installed between studs and nogs. Use Hardie™ Mineral insulation.

EPB Plasterboard Lining

NB: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

Two layers of 10mm EPB FireSmart lining to internal side of the steel framing

Vertical fixing only permitted. Use full height sheets where possible. All vertical sheet joints must be fixed over framing. Vertical joints of the outer layer should be offset to those of the inner layer. Where sheet end butt joints are unavoidable, the inner layer joints must be formed over nogs. Stagger the outer layer butt joints from the inner layer by minimum 100mm. The layers are fixed hard to the floor. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

	1 st Layer	2 nd Layer			
System Number	Self-Tapping Drywall Screws				
EJRH2SL30-F20	10mm	10mm			
EJKH23L30-F20	25 x 6g	32 x 6g			

Fastener Centres

Inner Layer: Fix at 600mm centres up each stud with no fixing to top and bottom track sections.

Outer Layer: Fix at 300mm centres up each stud with no fixing to top and bottom track sections.

Place fasteners no closer than 12mm to the sheet edge and 50mm from sheet ends

Place fasteners at 200mm centres where sheet end butt joints occur. Avoid outer layer screws from hitting inner layer screws.

Jointing and Finishing of EPB Plasterboard

Inner Layer: Unstopped

Outer Layer: All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.



EPB Plasterboard & Fibre Cement Fire Rated Systems


EPB & RAB[™] Board with selected James Hardie Fibre Cement Cladding

Two Way FRR

Load Bearing

External Wall - Steel Frame

System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
EJRH2SL30	-F20	30/30/30	Hardie™ Mineral	47 - 53	2 x 10mm EPB FireSmart on Internal side James Hardie RAB™ Board with selected James Hardie cladding to External side

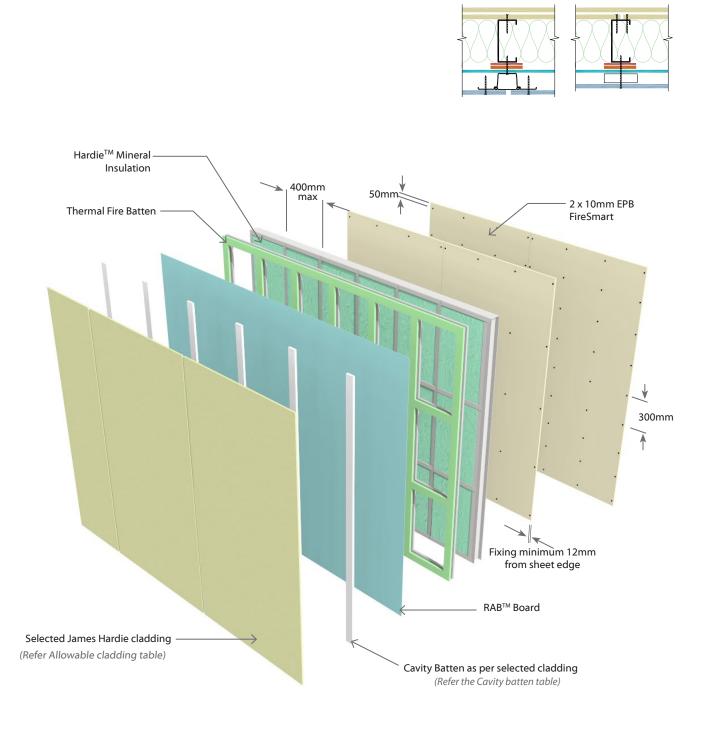

Face Paper **Product Identification Code** 10mm EPB FireSmart F10

N.B. The above drawings are for illustrative purposes only.

Two Way FRR

EJRH2SL60 EPB & RAB[™] Board with selected James Hardie Fibre Cement Cladding

External Wall - Steel Frame

External Wall - S	Load Bearing				
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
EJRH2SL60	-M26	60/60/60	Hardie™ Mineral	51- 54	2 x 13mm EPB MultiSmart on Internal side James Hardie RAB™ Board with selected James Hardie cladding to External side

Framing, Wall Height, Load and Framing Dimension

Steel framing for fire rated walls must be in accordance with NASH standard for residential and low rise buildings and AS/NZ 1170 standards. The framing shall also meet the following;

- Steel sections shall be galvanized/zinc coated and have a base metal thickness (BMT) 0.55mm minimum for non-load bearing walls and 0.75mm minimum for load bearing walls and 1.6mm maximum
- The minimum size for steel stud framing to be used in external walls shall be minimum 89mm deep x 36mm wide
- Maximum stud spacing 400mm c/c
- Maximum nogs / dwangs spacing 800mm c/c
- Steel frame must comply with the durability requirements of NZBC
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction as per SED in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Thermal Fire Batten

Fire battens are used on all FRR steel stud systems and must be used between James Hardie Cladding and steel framing face.

Refer to section 4.6 of James Hardie Fire & Acoustic Design Manual for installation detail.

Pre-Cladding / Underlay

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing.

RAB[™] Board must be used to achieve fire ratings

6mm RAB[™] Board : Use 40 x 2.8mm fibre cement nail at 150mm centres 9mm RAB[™] Board : Use 50 x 2.8mm fibre cement nail at 150mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

Refer to the table below for the type of cavity batten required for the selected James Hardie system.

James Hardie Cladding System	Cavity Batten type
ExoTec™	Top Hat System
EasyLap™	
Stria [™] (Horizontally fixed)	CLD Structural Cavity Batten
Axon™	

CLD[™] Structural Cavity Batten:

Use 70 x 19mm CLD[™] Structural Cavity Batten.

CLD[™] Structural Cavity battens to be installed according to the selected type of James Hardie cladding and as per the relevant technical specification, refer page 29 of this manual.

ExoTec[™] Top Hat System:

For ExoTec[™] Top hat system installation instructions, refer to ExoTec[™] Facade Panel Top Hat Rainscreen Technical Specification

James Hardie Fibre Cement Cladding

One layer of selected James Hardie Fibre Cement cladding to one side of the framing. See list below for allowable James Hardie claddings.

Selected Cladding Type					
ExoTec™					
EasyLap™					
Stria™ (Horizontally fixed)					
Axon™					

Refer to page 29 of this manual for the above mentioned James Hardie cladding's relevant technical literature.

Also refer to James Hardie Fire & Acoustic Design Manual.

Wall Insulation

Insulation must be installed between studs and nogs. Use Hardie™ Mineral insulation.

EPB Plasterboard Lining

NB: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

Two layers of 13mm EPB MultiSmart lining to internal side of the steel framing

Vertical fixing only permitted. Use full height sheets where possible. All vertical sheet joints must be fixed over framing. Vertical joints of the outer layer should be offset to those of the inner layer. Where sheet end butt joints are unavoidable, the inner layer joints must be formed over nogs. Stagger the outer layer butt joints from the inner layer by minimum 100mm. The layers are fixed hard to the floor. Sheet shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

	1 st Layer	2 nd Layer			
System Number	self-Tapping Drywall Screws				
EJRH2SL60-M26	13mm	13mm			
EJRH25L60-M26	25 x 6g	41 x 6g			

Fastener Centres

Inner Layer: Fix at 600mm centres up each stud with no fixing to top and bottom track sections.

Outer Layer: Fix at 300mm centres up each stud with no fixing to top and bottom track sections.


Place fasteners no closer than 12mm to the sheet edge and 50mm from sheet ends.


Place fasteners at 200mm centres where sheet end butt joints occur. Avoid outer layer screws from hitting inner layer screws.

Jointing and Finishing of EPB Plasterboard

Inner Layer: Unstopped

Outer Layer: All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

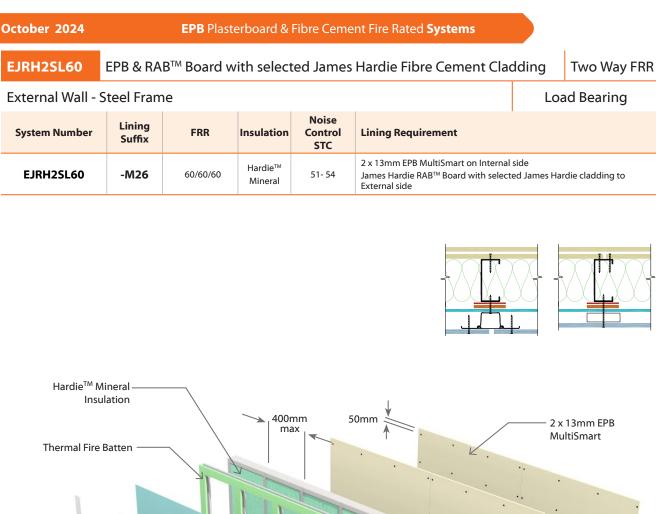

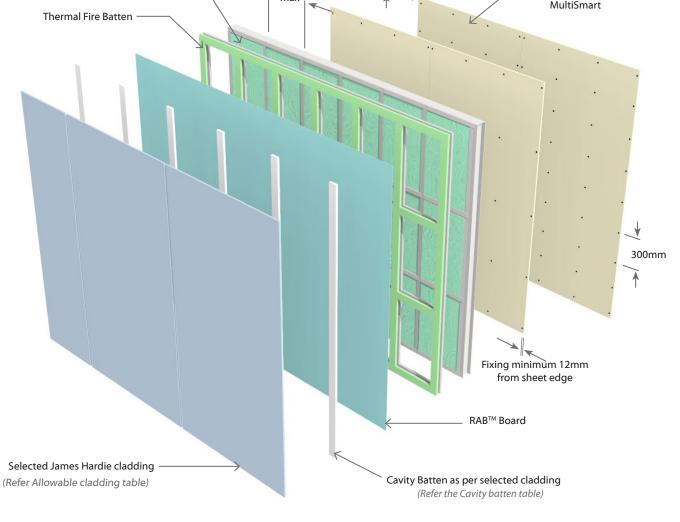

 Face Paper

 Product Identification Code

 13mm EPB MultiSmart
 M13

N.B. The above drawings are for illustrative purposes only.

October 2024

Two Way FRR

EJRN1SL30

EPB & James Hardie RAB[™] Board & a Weathertight Cladding

Load Bearing

		-				<u> </u>
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement	
	-M13	30/30/30	Hardie™ Mineral	42	1 x 13mm EPB MultiSmart on Internal James Hardie RAB [™] Board with a Wea	
EJRN1SL30	-F16	30/30/30	Hardie™ Mineral	43	1 x 16mm EPB FireSmart on Internal si James Hardie RAB [™] Board with a Wea	

Framing, Wall Height, Load and Framing Dimension

Steel framing for fire rated walls must be in accordance with NASH standard for residential and low rise buildings and AS/NZ 1170 standards. The framing shall also meet the following;

- Steel sections shall be galvanized/zinc coated and have a base metal thickness (BMT) 0.55mm minimum for non-load bearing walls and 0.75mm minimum for load bearing walls and 1.6mm maximum
- The minimum size for steel stud framing to be used in external walls shall be minimum 89mm deep x 36mm wide
- · Maximum stud spacing 400mm centres
- Maximum nogs / dwangs spacing 800mm centres
- Steel frame must comply with the durability requirements of NZBC
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction as per SED in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Thermal Fire Batten

Fire battens are used on all FRR steel stud systems and must be used between James Hardie Cladding and steel framing face.

Refer to section 4.6 of James Hardie Fire & Acoustic Design Manual for installation detail.

Pre-Cladding

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing.

6mm RAB[™] Board : Use 40 x 2.8mm fibre cement nail at 150mm centres 9mm RAB[™] Board : Use 50 x 2.8mm fibre cement nail at 150mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

Cavity battens to be installed according to the selected type of Cladding and its manufacturer's relevant technical specification.

Weathertight Cladding

The Exterior wall must be clad with a suitable weathertight material. Cladding fixed as per manufacturer's technical specification.

N.B: It is important to consider the fire properties of the external cladding is in accordance with NZBC C/VM1 or C/AS documents.

Refer to Table 5.1 of Section 5.4 of C/AS1 and Table 5.5 of Section 5.8.1 of C/AS2 for the information about various risk groups to identify the external fire spread safety requirement applicable to the exterior surface finishes.

Wall Insulation

Insulation must be installed between studs and nogs. Use Hardie[™] Mineral insulation.

EPB Plasterboard Lining

<u>NB</u>: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of EPB Plasterboard lining as per specified system above to internal side of the steel framing. Vertical fixing only permitted. Use full height sheets where possible. All sheet joints must be fixed over steel framing. Where sheet end butt joints are unavoidable, they must be formed over nogs. The layer is fixed hard to the floor. Sheet shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings

Fasteners (As per Specified System Above)

	Single Layer				
System Number	Self-Tapping Drywall Screws				
EJRN1SL30-M13	13mm				
EJRINTSESU-IVITS	32 x 6g				
EJRN1SL30-F16	16mm				
EJRN I SLSU-F 10	32 x 6g				

Fastener Centres

Fix at 300mm centres up each stud with no fixing to top and bottom channel sections.

Place fasteners no closer than 12mm from the sheet edge and 50mm from sheet ends.

Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.


EPB Plasterboard & Fibre Cement Fire Rated Systems


EJRN1SL30 EPB & James Hardie RAB[™] Board & a Weathertight Cladding

Two Way FRR

External Wall - Steel Frame

External Wall - S	Load Bearing				
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
	-M13	30/30/30	Hardie™ Mineral	42	1 x 13mm EPB MultiSmart on Internal side James Hardie RAB [™] Board with a Weathertight Cladding to External side
EJRN1SL30	-F16	30/30/30	Hardie™ Mineral	43	1 x 16mm EPB FireSmart on Internal side James Hardie RAB [™] Board with a Weathertight Cladding to External side



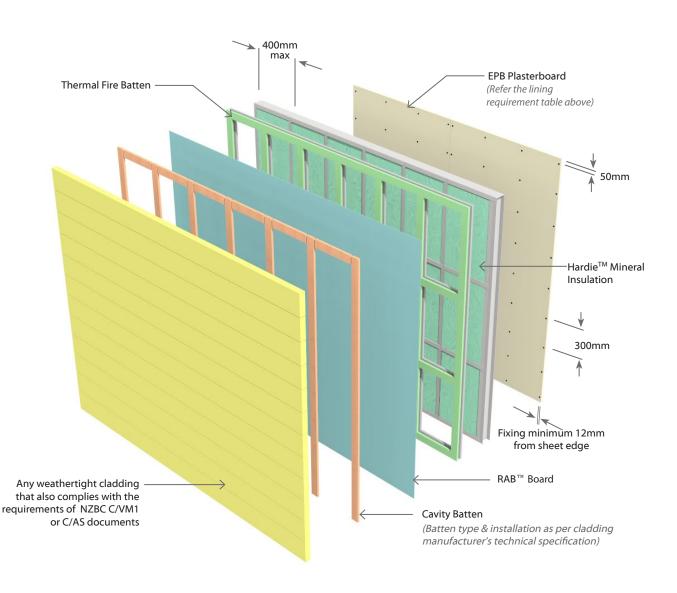

Face Paper Product Identification Code				
13mm EPB MultiSmart	M13			
16mm EPB FireSmart	F16			

N.B. The above drawings are for illustrative purposes only.

Two Way FRR

EJRN2SL30

EPB & James Hardie RAB[™] Board & a Weathertight Cladding

External Wall - Steel Frame

External Wall - Steel Frame					Load Bearing	
	System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
	EJRN2SL30	-F20	30/30/30	Hardie™ Mineral	47	2 x 10mm EPB FireSmart on Internal side James Hardie RAB [™] Board with a Weathertight Cladding to External side

Framing, Wall Height, Load and Framing Dimension

Steel framing for fire rated walls must be in accordance with NASH standard for residential and low rise buildings and AS/NZ 1170 standards. The framing shall also meet the following;

- · Steel sections shall be galvanized/zinc coated and have a base metal thickness (BMT) 0.55mm minimum for non-load bearing walls and 0.75mm minimum for load bearing walls and 1.6mm maximum
- The minimum size for steel stud framing to be used in external walls shall be minimum 89mm deep x 36mm wide
- Maximum stud spacing 400mm centres
- Maximum nogs / dwangs spacing 800mm centres
- Steel frame must comply with the durability requirements of NZBC
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction as per SED in accordance with the NZBC verification method B1/VM1, paragraph 224

Thermal Fire Batten

Fire battens are used on all FRR steel stud systems and must be used between James Hardie Cladding and steel framing face.

Refer to section 4.6 of James Hardie Fire & Acoustic Design Manual for installation detail.

Pre-Cladding

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing.

6mm RAB[™] Board : Use 40 x 2.8mm fibre cement nail at 150mm centres 9mm RAB[™] Board : Use 50 x 2.8mm fibre cement nail at 150mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

Cavity battens to be installed according to the selected type of Cladding and its manufacturer's relevant technical specification.

Weathertight Cladding

The Exterior wall must be clad with a suitable weathertight material. Cladding fixed as per manufacturer's technical specification.

N.B: It is important to consider the fire properties of the external cladding is in accordance with NZBC C/VM1 or C/AS documents.

Refer to Table 5.1 of Section 5.4 of C/AS1 and Table 5.5 of Section 5.8.1 of C/AS2 for the information about various risk groups to identify the external fire spread safety requirement applicable to the exterior surface finishes.

Wall Insulation

Insulation must be installed between studs and nogs. Use Hardie™ Mineral insulation.

EPB Plasterboard Lining

NB: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

Two layers of 10mm EPB FireSmart lining as per specified system above to internal side of the steel framing.

Vertical fixing only permitted. Use full height sheets where possible. All vertical sheet joints must be fixed over framing. Vertical joints of the outer layer should be offset to those of the inner layer. Where sheet end butt joints are unavoidable, the inner layer joints must be formed over nogs. Stagger the outer layer butt joints from the inner layer by minimum 100mm. The layers are fixed hard to the floor. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

	1 st Layer	2 nd Layer			
System Number	Self-Tapping Drywall Screws				
EJRN2SL30-F20	10mm	10mm			
EJRN25L30-F20	25 x 6g	32 x 6g			

Fastener Cenres

Inner Layer: Fix at 600mm centres up each stud with no fixing to top and bottom track sections.

Outer Layer: Fix at 300mm centres up each stud with no fixing to top and bottom track sections.


Place fasteners no closer than 12mm to the sheet edge and 50mm from sheet ends.

Place fasteners at 200mm centres where sheet end butt joints occur. Avoid outer layer screws from hitting inner layer screws.

Jointing and Finishing of EPB Plasterboard

Inner Layer: Unstopped

Outer Layer: All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

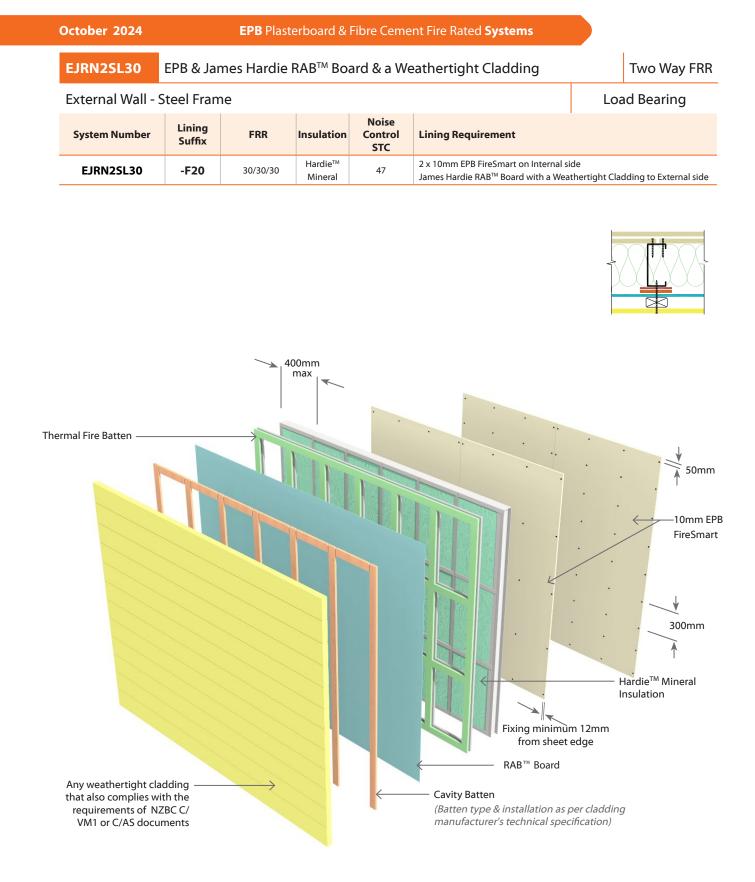

N.B. The above drawings are for illustrative purposes only.

Two Way FRR

EJRN2SL60

EPB & James Hardie RAB[™] Board & a Weathertight Cladding

External Wall - Steel Frame

External Wall - Steel Frame					Load Bearing
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
EJRN2SL60	-M26	60/60/60	Hardie™ Mineral	49	2 x 13mm EPB MultiSmart on Internal side James Hardie RAB [™] Board with a Weathertight Cladding to External side

Framing, Wall Height, Load and Framing Dimension

Steel framing for fire rated walls must be in accordance with NASH standard for residential and low rise buildings and AS/NZ 1170 standards. The framing shall also meet the following;

- · Steel sections shall be galvanized/zinc coated and have a base metal thickness (BMT) 0.55mm minimum for non-load bearing walls and 0.75mm minimum for load bearing walls and 1.6mm maximum
- The minimum size for steel stud framing to be used in external walls shall be minimum 89mm deep x 36mm wide
- Maximum stud spacing 400mm centres
- Maximum nogs / dwangs spacing 800mm centres
- Steel frame must comply with the durability requirements of NZBC
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction as per SED in accordance with the NZBC verification method B1/VM1, paragraph 224

Thermal Fire Batten

Fire battens are used on all FRR steel stud systems and must be used between James Hardie Cladding and steel framing face.

Refer to section 4.6 of James Hardie Fire & Acoustic Design Manual for installation detail.

Pre-Cladding

RAB[™] Board

One layer of James Hardie RAB[™] Board fixed to entire framing.

6mm RAB[™] Board : Use 40 x 2.8mm fibre cement nail at 150mm centres 9mm RAB[™] Board : Use 50 x 2.8mm fibre cement nail at 150mm centres Fixing to be 12mm from sheet edges

Reference to be made to the James Hardie Home RAB[™] Pre-Cladding & RAB[™] Board Installation Manual.

Cavity Batten

Cavity battens to be installed according to the selected type of Cladding and its manufacturer's relevant technical specification.

Weathertight Cladding

The Exterior wall must be clad with a suitable weathertight material. Cladding fixed as per manufacturer's technical specification.

N.B: It is important to consider the fire properties of the external cladding is in accordance with NZBC C/VM1 or C/AS documents.

Refer to Table 5.1 of Section 5.4 of C/AS1 and Table 5.5 of Section 5.8.1 of C/AS2 for the information about various risk groups to identify the external fire spread safety requirement applicable to the exterior surface finishes.

Wall Insulation

Insulation must be installed between studs and nogs. Use Hardie™ Mineral insulation.

EPB Plasterboard Lining

NB: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

Two layers of 13mm EPB MultiSmart lining to internal side of the steel framing. Vertical fixing only permitted. Use full height sheets where possible. All vertical sheet joints must be fixed over framing. Vertical joints of the outer layer should be offset to those of the inner layer. Where sheet end butt joints are unavoidable, the inner layer joints must be formed over nogs. Stagger the outer layer butt joints from the inner layer by minimum 100mm. The layers are fixed hard to the floor. Sheet shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

	1 st Layer	2 nd Layer			
System Number	Self-Tapping Drywall Screws				
EJRN2SL60-M26	13mm	13mm			
EJRN25L60-MI26	25 x 6g	41 x 6g			

Fastener Centres

Inner Layer: Fix at 600mm centres up each stud with no fixing to top and bottom track sections.

Outer Layer: Fix at 300mm centres up each stud with no fixing to top and bottom track sections.


Place fasteners no closer than 12mm to the sheet edge and 50mm from sheet ends.

Place fasteners at 200mm centres where sheet end butt joints occur. Avoid outer layer screws from hitting inner layer screws.

Jointing and Finishing of EPB Plasterboard

Inner Layer: Unstopped

Outer Layer: All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

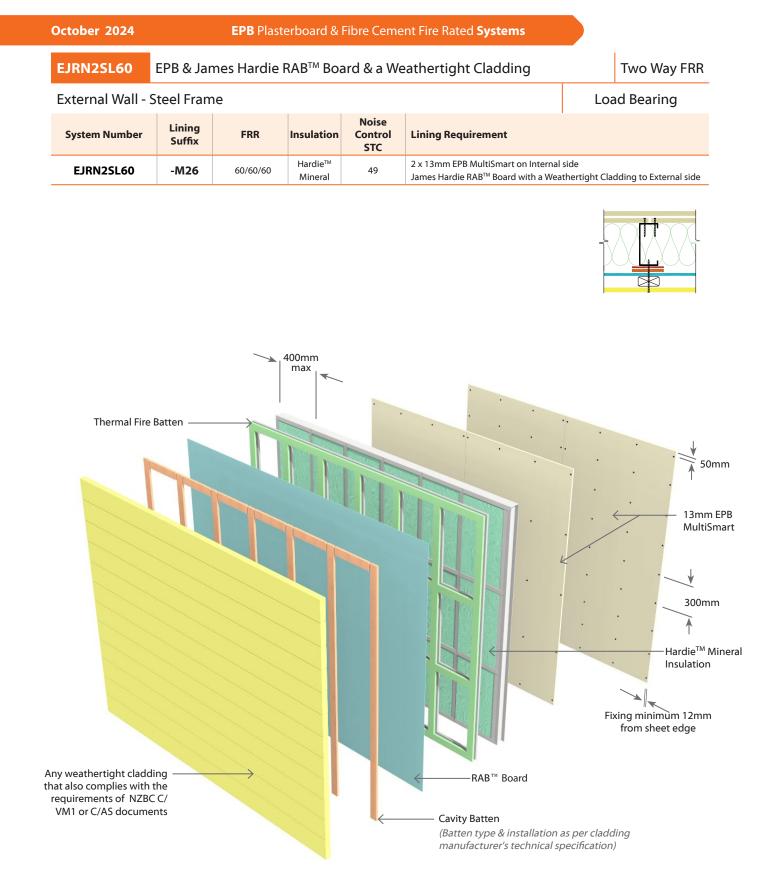



Internal Timber Frame Walls

EJV1TL30

EPB Plasterboard & James Hardie Villaboard[™] Lining

Internal Wall - Timber Frame

Internal Wall - Timber Frame						Load Bearing
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement	
EJV1TL30	-F10	30/30/30	R2.2 glass wool	42	1 x 10mm EPB FireSmart one side James Hardie Villaboard TM Lining othe	er side

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- Maximum stud spacing's are 600mm centres.
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

James Hardie Villaboard™ Lining

Fix James Hardie Villaboard[™] Lining to one side of framing. Refer to James Hardie Villaboard[™] Lining Installation Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use 90mm thick R2.2 glass wool insulation.

EPB Plasterboard Lining

NB: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 10mm EPB FireSmart lining to framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings

Fasteners 41mm x 6g High Thread Drywall screws

Fastener Centres


Fix at 300mm centres at sheet perimeter and up all other studs.

Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

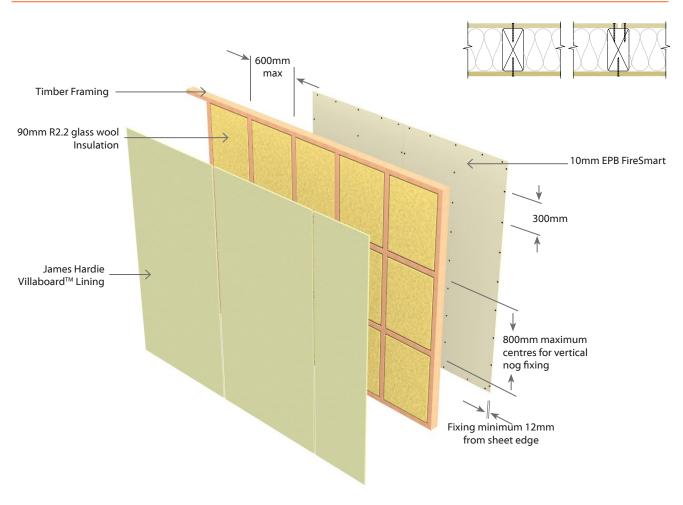

Load Bearing

Two Way FRR

EJV1TL60

EPB Plasterboard & James Hardie Villaboard[™] Lining

Internal Wall - Timber Frame

	Loud Dearing				
System Number	Lining Suffix	FRR	Insulation	Noise Control STC	Lining Requirement
EJV1TL60	-M13	60/60/60	Hardie™ Mineral	43	1 x 13mm EPB MultiSmart one side James Hardie Villaboard™ Lining other side

Framing, Wall Height, Load and Framing Dimension

Timber framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability. Timber framing must be in accordance with NZS3604 stud tables for load bearing or non-load bearing partitions. Furthermore;

- Minimum framing dimension is 90 x 45mm.
- Nogs must be in place at a maximum of 800mm centres.
- · Maximum stud spacing's are 600mm centres.
- The fire rated walls built close to boundary are also required to achieve post fire stability in either direction in accordance with the NZBC verification method B1/VM1, paragraph 2.2.4

Refer to latest James Hardie Fire & Acoustic Design Manual figures and tables for further detail.

James Hardie Villaboard[™] Lining

Fix James Hardie Villaboard[™] Lining to one side of framing. Refer to James Hardie Villaboard[™] Lining Installation Manual for information regarding fixing and finishing.

Wall Insulation

Insulation must be installed between studs and nogs. Use 90mm thick James Hardie Mineral Insulation.

EPB Plasterboard Lining

<u>NB:</u> The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 13mm EPB MultiSmart lining to framing. Vertical fixing only permitted. Use full height sheets where possible when fixing vertical. All sheet joints must be fixed over solid timber framing. Sheets shall be touch fitted.

Fixing of EPB Plasterboard Internal Linings

Fasteners

41mm x 6g High Thread Drywall screws

Fastener Centres


Fix at 300mm centres at sheet perimeter and up all other studs.

Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.

Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends. Place fasteners at 200mm centres where sheet end butt joints occur.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

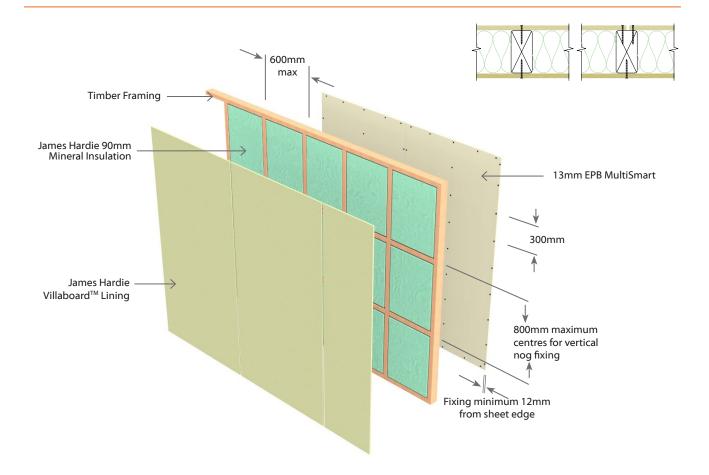

Floor/Ceiling Systems

EJS1FC30

EPB Plasterboard & James Hardie Secura[™] Interior Flooring

Floor/Ceiling - Timber Joist

Floor/Ceiling - T	Load Bearing				
System Number	Lining	FRR	Noise Control		Lining Requirement
System Number	Suffix	FAN	STC	IIC	Linnig Requirement
EJS1FC30	-M13	30/30/30	45	33	1 x 13mm EPB MultiSmart under the frame 19mm James Hardie Secura™ Interior Flooring above the frame

Floor Framing

Timber floor joists shall comply with NZS3604 with a minimum depth of 190mm x 45mm and spaced at no more than 450mm centres. Solid strutting at 1800mm maximum centres required.

Nogs fixed on the flat to receive the ends of flooring material shall be 100 x 50mm minimum.

Nogs fixed on the flat to receive the EPB Plasterboard lining shall be 75mm x 50mm minimum.

Nogs or framing is required at the perimeter of the fire rated ceiling. Refer to James Hardie Fire & Acoustic Design Manual.

Secura[™] Interior Flooring

19mm Secura[™] Interior Flooring, fixed to the joists at 200mm centres using 50 x 2.8mm round head nails.

25mm minimum distance from tongue and groove

12mm minimum edge distance

Also refer to James Hardie Secura Interior Flooring Installation Manual.

EPB Plasterboard Lining

NB: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 13mm EPB MultiSmart fixed at right angles directly to the underside of floor joists.

All joints must occur on joists and solid blocking. Sheets to be touched fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

41mm x 6g High Thread Drywall screws


Fastener Centres

Fix at 200mm centres around the sheet perimeter and intermediate joists.

Place fasteners no closer than 12mm from the sheet edge and 18mm from sheet ends.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

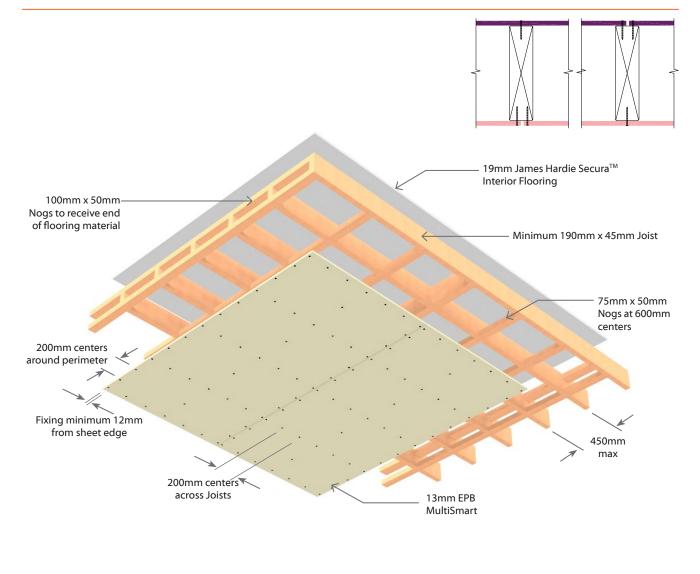

EJS1FC60

EPB Plasterboard & James Hardie Secura[™] Interior Flooring

Floor/Ceiling - Timber Joist

Floor/Ceiling - T	Load Bearing				
System Number	Lining Suffix	FRR	Noise Control		Lining Requirement
System Number			STC	IIC	Lining requirement
EJS1FC60	-F16	60/60/60	46	33	1 x 16mm EPB FireSmart under the frame 19mm James Hardie Secura™ Interior Flooring above the frame

Floor Framing

Timber floor joists shall comply with NZS3604 with a minimum depth of 190mm x 45mm and spaced at no more than 450mm centres. Solid strutting at 1800mm maximum centres required.

Nogs fixed on the flat to receive the ends of flooring material shall be 100 x 50mm minimum.

Nogs fixed on the flat to receive the EPB Plasterboard lining shall be 75mm x 50mm minimum.

Nogs or framing is required at the perimeter of the fire rated ceiling. Refer to James Hardie Fire & Acoustic Design Manual.

Secura[™] Interior Flooring

19mm Secura[™] Interior Flooring, fixed to the joists at 200mm centres using 50 x 2.8mm round head nails.

25mm minimum distance from tongue and groove

12mm minimum edge distance

Also refer to James Hardie Secura Interior Flooring Installation Manual.

EPB Plasterboard Lining

NB: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

One layer of 16mm EPB FireSmart fixed at right angles directly to the underside of floor joists.

All joints must occur on joists and solid blocking. Sheets to be touched fitted.

Fixing of EPB Plasterboard Internal Linings Fasteners

51mm x 7g High Thread Drywall screws


Fastener Centres

Fix at 150mm centres around the sheet perimeter and intermediate joists.


Place fasteners no closer than 12mm from the sheet edge and 18mm from sheet ends.

Jointing and Finishing of EPB Plasterboard

All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with Elephant Plasterboard Installation Guide.

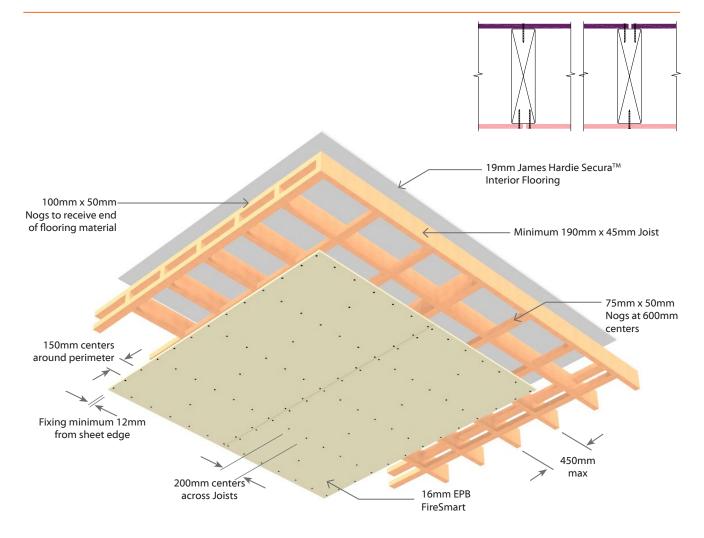

NOTES

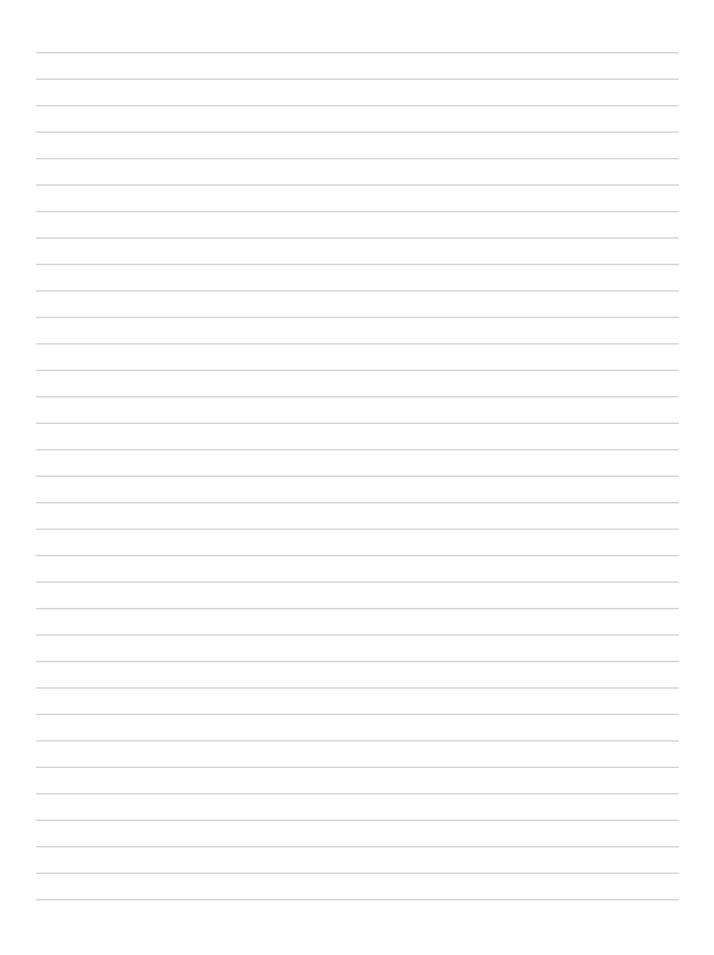

80

Floating Floor/Ceiling Systems

October 2024

EFJ2DFA60

EPB & Floating James Hardie Secura[™] Interior Flooring

Full Intertenancy Accoustic

Load Bearing

Direct Fix Clip Floating Floor/Ceiling - Timber Joist

System Number	Lining	FRR	Load Bearing	Noise Control		Lining Requirement	
	Suffix		Ability STO		IIC*		
EFJ2DFA60	-MS26	60/60/60	LB	67	57-76	1 x 13mm EPB MultiSmart AND 1 x 13mm EPB Standard under the battens	
	-M26	60/60/60	LB	68	57-77	2 x 13mm EPB MultiSmart under the battens	

Framing

Timber floor joists shall comply with NZS3604 with a minimum depth of 190mm x 45mm and spaced at no more than 450mm centres. Nogs or framing is required at the perimeter of the Fire Rated ceiling.

Alternatively, a proprietary I-joist system may be used subject to specific structural design and approved by the normal building consent process. Consult the joist manufacturer regarding construction of the solid blocking contained in the floor/ceiling to wall junctions.

Initial Floor

Refer to James Hardie Secura[™] Interior Flooring Fire Acoustic Floor System Installation Manual. 19mm thick James Hardie Secura[™] Interior Flooring laid at right angles to the timber joists in a staggered pattern. Sheet edges other than tongue and groove must be supported over floor joists. When using the site cut sheet pieces, the minimum length of the cut sheet to be used must be 900mm or more.

Adhesive Requirement (Both flooring layers)

A continuous 6mm bead of Adhesive to be applied over the joists or channels before laying the flooring materials.

- Suitable Adhesive options are:
- Bostik Seal n Flex-1 or
- Holdfast 220LM or
- Sikaflex 11FC

Fasteners

Initial Secura[™] Floor Layer

Fix SecuraTM Interior Flooring across the joists using angular grooved galvanised or stainless steel 50 x 2.87mm gun nails or can be screw fixed using a 50mm x 10g timber thread self-embedding screw.

Floating Secura[™] Floor Layer

Fix Secura[™] Interior Flooring across the Acoustic Channels using

40-45mm x 8-10g self embedding steel screws.

Fastening Centres (Both flooring layers)

Fix at 200mm centres along each joist or channel. Fasteners to be placed at 25mm min at long sheet edges and 12mm from transverse edges. Fastener edge distance of 50mm to be maintained at sheet corners.

Flooring Void

James Hardie Acoustic Cradles are to be positioned on the James Hardie SecuraTM Interior Flooring at 450mm centres max starting from the edge of the room. The Acoustic Cradles need not be aligned with the timber floor joists and can be laid in either direction.

The Cradles are not to be fixed down to the bottom flooring layer.

James Hardie Acoustic Channels to be placed inside the Acoustic Cradles. Acoustic Channels are spaced at 450mm centres maximum.

Flooring Void Sound Absorber

Install Sound Absorber between the James Hardie Acoustic Floor Channels. Use 50mm thick R1.2 glass wool blanket with a minimum density of $9.6 kg/m^3$.

Floating Floor

James Hardie Secura[™] Interior Flooring to be laid at right angles to the Acoustic Channels and fixed at 200mm centres along the channel. Lay the sheets in a staggered pattern. Flooring edges other than tongue and groove must be supported by channels.

Allow 5-8mm gap between Secura[™] Interior Flooring and the external/ internal walls. Fill the gaps with an acoustic sealant.

Acoustic Clip and Battens

Fasten the Acoustic Clip to the joists at 1200mm centres max (and not less than 900mm centres) to support the metal ceiling battens. Metal battens are spaced at 600mm centres maximum.

Ceiling Void Sound Absorber

Install Sound Absorber between the joists above the metal ceiling battens. Use minimum 75mm thick R1.8 glass wool blanket with a minimum density of 9.6kg/m³.

EPB Plasterboard Ceiling Lining

Two layers of EPB Plasterboard as per specified system above fixed at right angles directly to the underside of the metal battens. All sheet end butt joints shall occur on the battens. Offset the outer layer by 600mm from the inner layer. Sheet joints should be touched fitted.

Fixing of EPB Plasterboard Internal Linings

Fasteners (As per Specified System Above)

System Number	1 st Layer	2 nd Layer			
System Number	Self-Tapping Drywall Screws				
EFJ2DFA60-MS26	13mm	13mm			
EFJ2DFA60-M26	25 x 6g	41 x 6g			

Fastening Centres

Ceiling sheets shall be fixed at 200mm centres along each metal ceiling batten with butt edges fixed at 100mm centres.

Fasteners to be placed no closer than 12mm from sheet edge.

Avoid outer layer screws from hitting inner layer screws.

Acoustic Sealant

A bead of fire retardant Acoustic Sealant must be applied around the perimeter of the first layer and the second layer bedded on the bead.

Wall/Ceiling Junction

The internal angle between the ceilings and walls must be protected by Cornice or square stopped corners taped and filled in accordance with Elephant Plasterboard Installation Guide.

Jointing

Inner layer: Unstopped.

Outer Layer: All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped in accordance with the publication entitled Elephant Plasterboard Installation Guide.

Additional Reference Material

Refer to James Hardie Secura[™] Interior Flooring Installation Manual and the James Hardie Fire and Acoustic Floor System Installation Manual for additional information covering general and wet area installation and penetrations and control joints.


*Impact Insulation Class (IIC)

IIC of 57 is achieved with a bare floor.

IIC of 58 is achieved with loose laid Vinyl.

IIC of 75 is achieved with 40oz loop pile carpet on 8mm foam chip underlay.

IIC of 76 is achieved with 40oz loop pile carpet on waffle underlay.

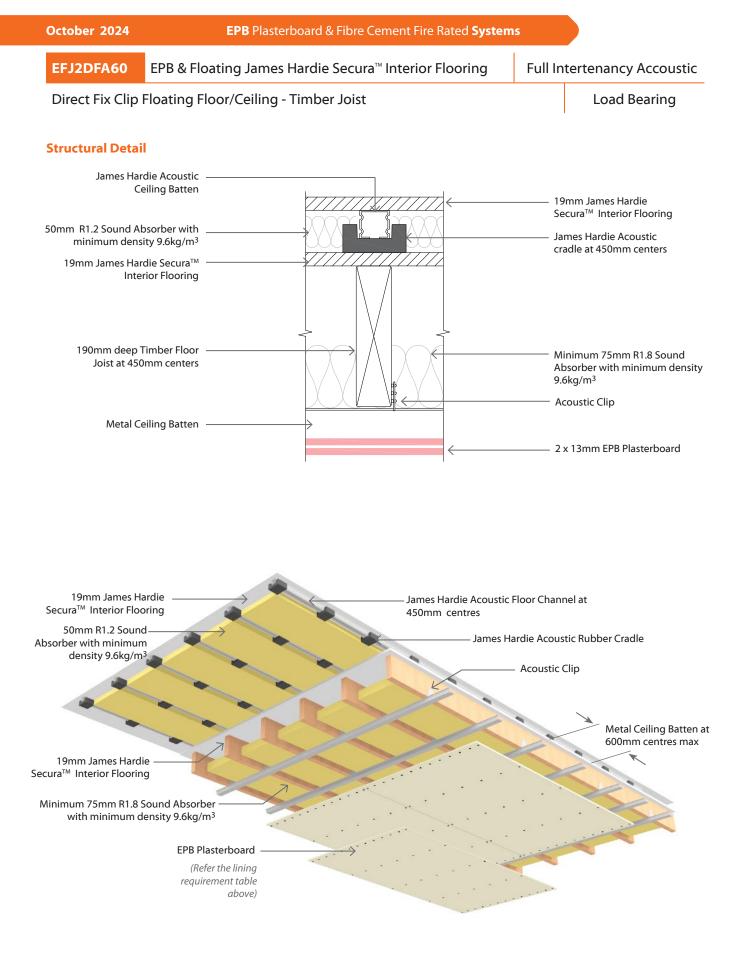



Construction Details

Boundary Wall & Post Fire Stability

Post Fire Stability

The fire rated walls built close to boundary are required to achieve post fire stability as per section 2.2.4 of B1/VM1 of the NZBC.

The bottom plate of these walls can be fixed in accordance with the table shown below using Pryda[®] Brace Anchor or any equivalent hold downs on either side of the stud. These fixings ensure that when a boundary wall is exposed to post fire face loads, it doesn't collapse in any direction. Contact the project structural engineer for an alternate design to achieve post fire stability if the published solutions are not suitable for the project.

Note: Post fire stability for steel framing must be as per SED.

Framing

The frame sizes and spacing mentioned in this manual are a minimum requirement. Bigger framing sections required to suit a proprietary cladding system or to suit higher wind pressures, will not affect the FRR, provided that the other system requirements presented in this manual are adhered to.

Higher levels of timber treatments or steel coating to enhance their durability will not alter the fire or acoustic performance of the systems. Sheet set-out must be determined by the designer including the location of all expansion and control joints to enable correct framing set-out (these must be in accordance with the relevant James Hardie product literature).

CONCRETE FOUNDATION					
Wall Height max (mm)	2400	3000	3000	3700	
Bottom Plate (mm)	90 x 45	90 x 45	140 x 45	140 x 45	
Stud Spacing max (mm)	400	300	600	400	
Nog Spacing (mm)	800	800	800	800	
Hold Down brackets	Pryda $^{ extsf{B}}$ Bracing Anchor or any equivalent hold downs to both sides of the stud				


BLOCK WALL FOUNDATION							
Wall Height max (mm)	3000	3700					
Bottom Plate (mm)	140 x 45	140 x 45					
Stud Spacing max (mm)	600	400					
Nog Spacing (mm)	800	800					
Hold Down brackets	Hold Down brackets Pryda [®] Bracing Anchor or any equivalent hold downs to both sides of the stud						

TIMBER FOUNDATION					
	Joist parallel	Joist Perpendicular			
Joist min (mm)	190	190	190		
Wall Height max (mm)	2700	2700	3700		
Bottom Plate (mm)	140 x 45	140 x 45	140 x 45		
Stud Spacing max (mm)	600	600	300		
Nog Spacing max (mm)	800	800	800		
Hold Down brackets	Pryda [®] Bracing Anchor or any equivalent hold downs to both sides of the stud				

*For higher stud heights, contact Elephant Plasterboard

Freephone 0800 353 742


Boundary Wall Bottom Plate Fixing - Concrete Foundation

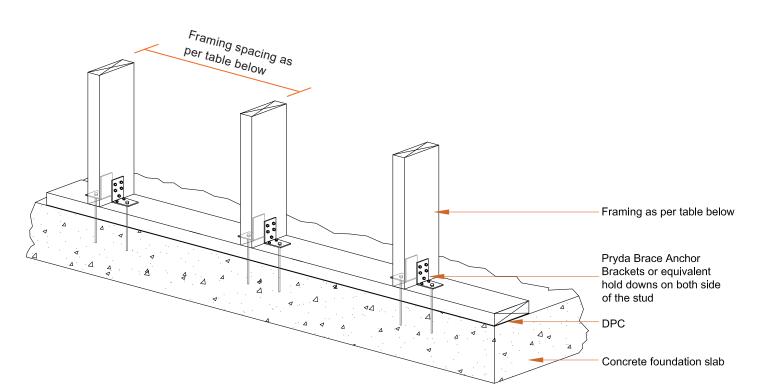

Note:

This detail is only indicative, confirmation will be required by a structural engineer for stability NZBC B1 by designer. Elephant plasterboard (NZ) Ltd accepts no liability if not verified by an engineer

Wall Height max (mm)	2400	3000	3000	3700
Bottom Plate (mm)	90 x 45	90 x 45	140 x 45	140 x 45
Stud Spacing max (mm)	400	300	600	400
Nog Spacing (mm)	800	800	800	800
Hold Down brackets	Pryda [®] Brace Anchor or equivalent hold downs to both sides of each Stud			

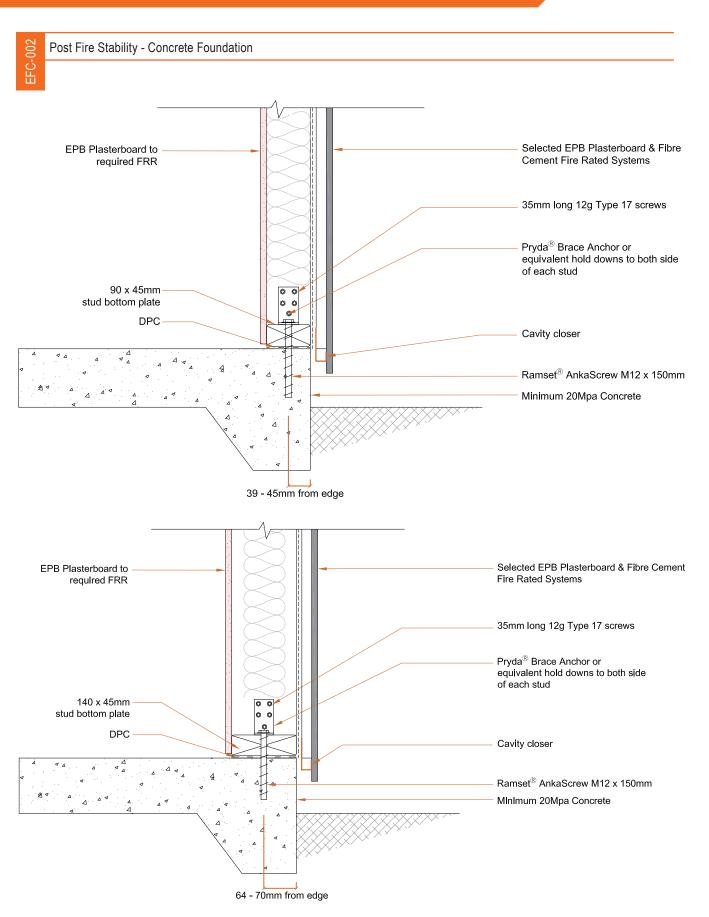


Wall Height max (mm)	2400	3000	3000	3700	
Bottom Plate (mm)	90 x 45	90 x 45	140 x 45	140 x 45	
Stud Spacing max (mm)	400	300	600	400	
Nog Spacing (mm)	800	800	800	800	
Hold Down brackets	Pryda [®] Brace Anchor or equivalent hold downs to both sides of each Stud				

Freephone 0800 353 742




Post Fire Stability - Block wall Foundation

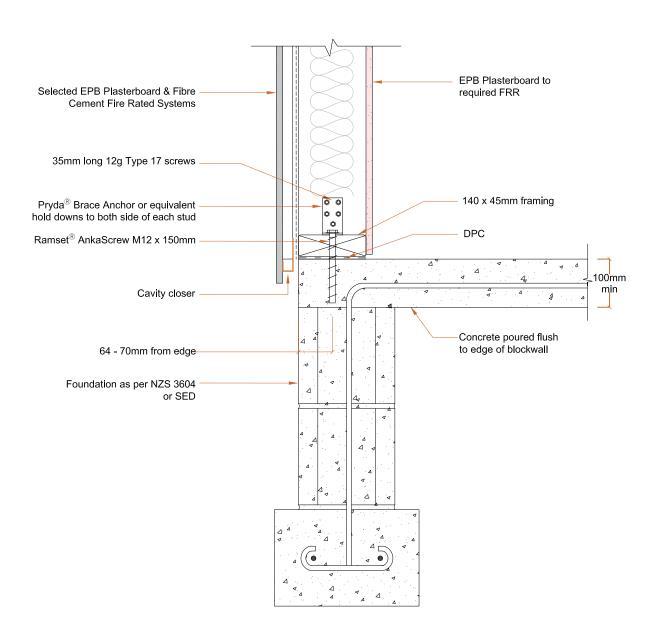


Wall Height max (mm)	3000	3700			
Bottom Plate (mm)	140 x 45	140 x 45			
Stud Spacing max (mm)	600	400			
Nog Spacing max (mm)	800	800			
Hold Down brackets	Pryda [®] Brace Anchor or equivalent hold downs to both sides of each Stud				


Freephone 0800 353 742

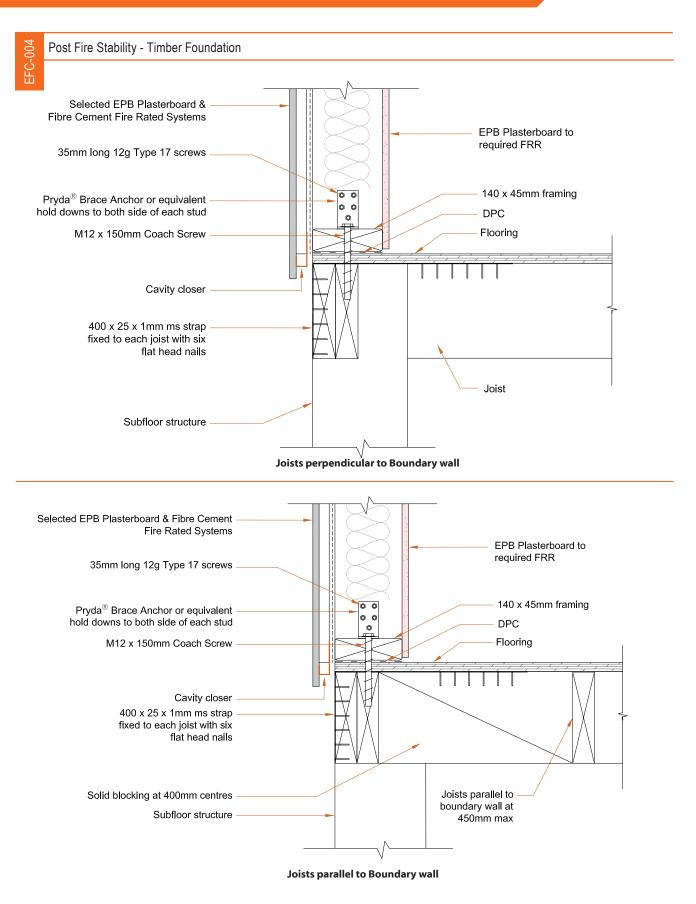



	Joist Perp	Joist Parallel				
Wall Height max (mm)	2700	3700	2700			
Bottom Plate (mm)	140 x 45	140 x 45	140 x 45			
Stud Spacing max (mm)	600	300	600			
Nog Spacing max (mm)	800	800	800			
Joist min (mm)	190	190				
Hold Down brackets	Pryda $^{\otimes}$ Brace Anchor or equivalent hold downs to both sides of each Stud					



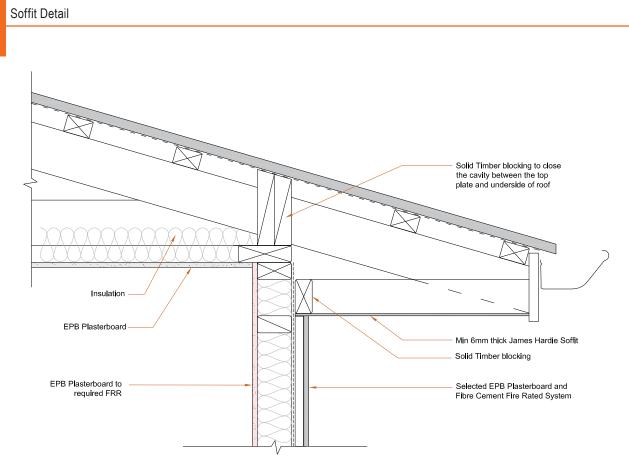

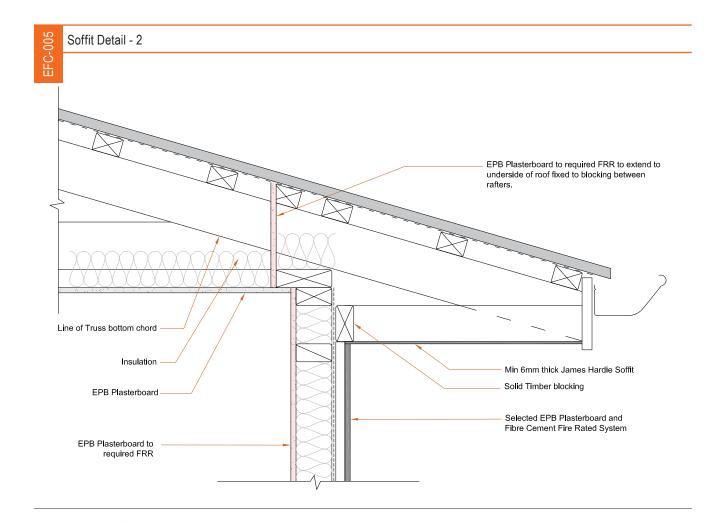


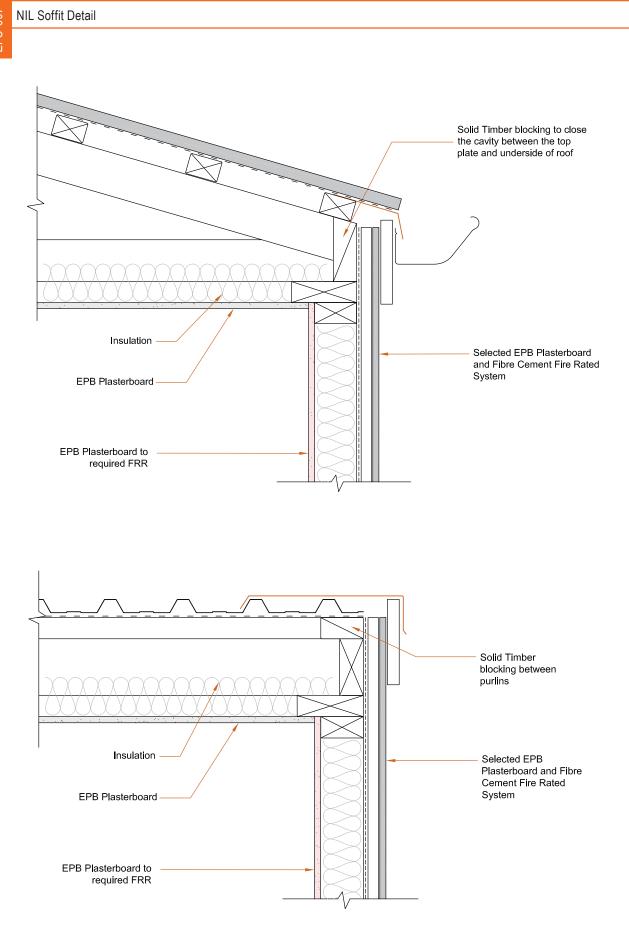

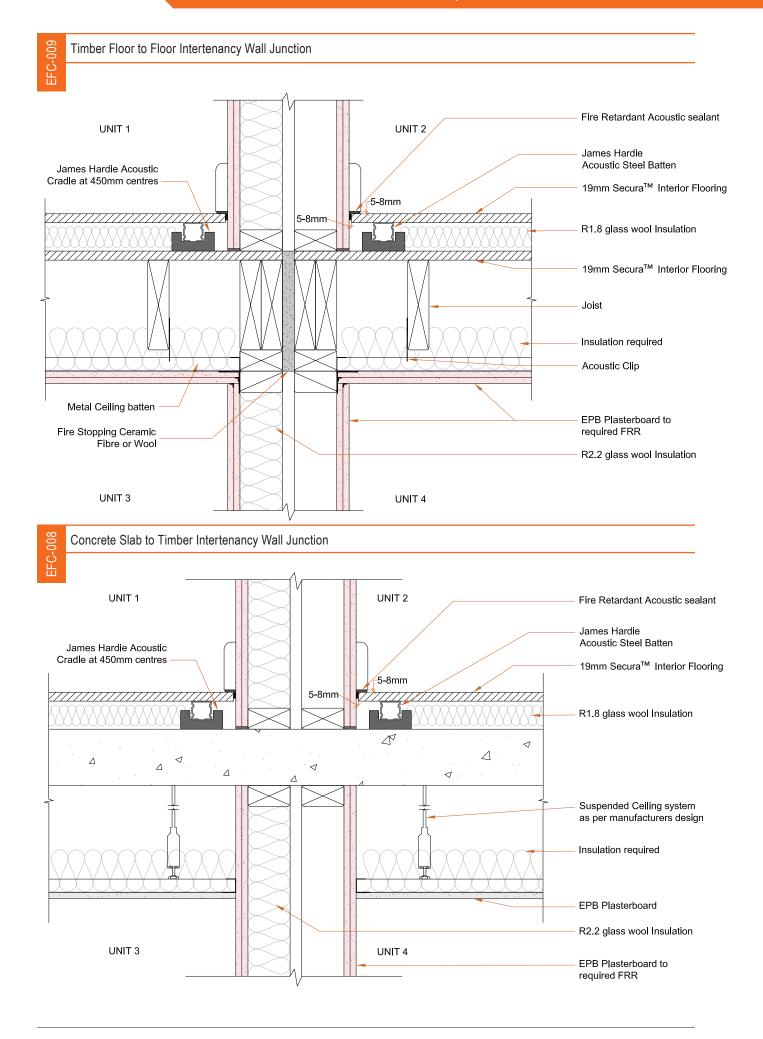




Split Level Floor to Intertenancy Wall Junction

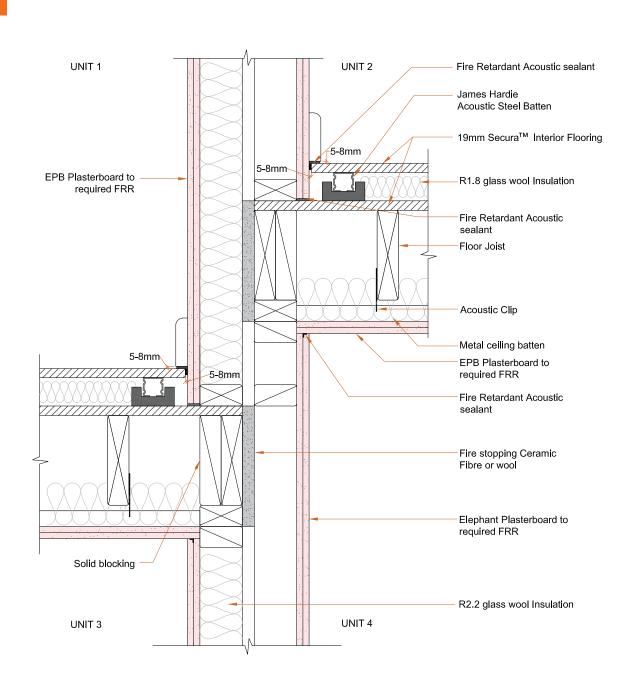

=C-01

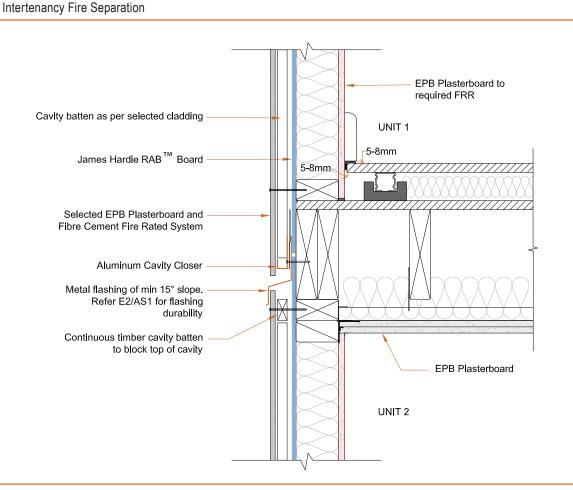


EFC-012


Intertenancy Wall to External Wall Junction

Selected EPB Plasterboard and Fibre Cement Fire UNIT 1 Rated System EPB Plasterboard as James Hardie RAB Board per required FRR or Fire retardant Flexible X Underlay Vertical joint as per R cladding system X 100mm metal flashing R 2.2 glass wool with return ends Insulation X Cavity Batten EPB Plasterboard as per required FRR UNIT 2

Single Timber Frame Wall to External Wall Junction

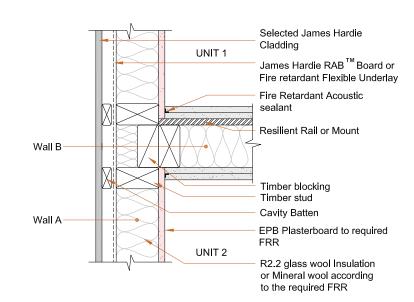


For Systems where the difference in FRR between Wall A & B is 30 minutes or less

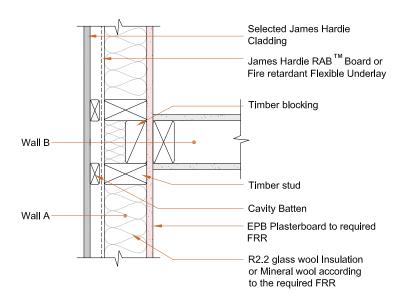

For Systems where the difference in FRR between Wall A & B is higher than 30 minutes, the lining of wall with higher FRR is continuous (Wall A in this example)

Fire Cell Extension

EFC-014

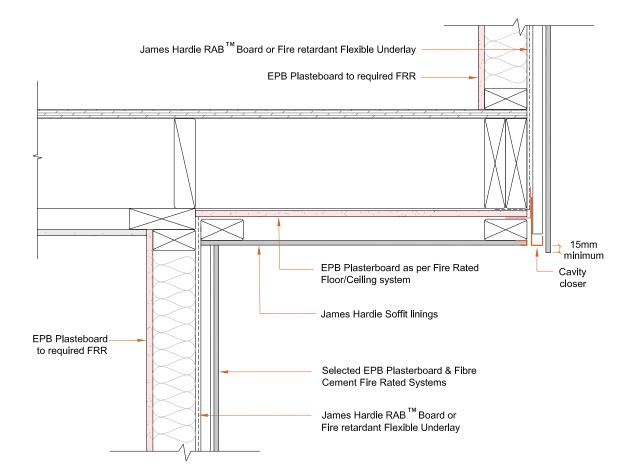

NOTES

175	Freephone 0800 353 742	www.elephant

EPB Plasterboard Product Range

THICK- NESS	ELEPHANT PLASTERBOARD PRODUCT RANGE	EDGE TYPE	WIDTH	WEIGHT	LENGTH							
mm			mm	Kg per m ²	2.4m	2.7m	3.0m	3.3m	3.6m	4.2m	4.8m	6.0m
10	Standard	TE/TE	1200	6.9	\checkmark							
10	Standard Horizontal	TE/SE	1200	6.9	\checkmark		\checkmark		\checkmark	\checkmark	\checkmark	\checkmark
10	Standard Horizontal - Wide	TE/SE	1350	7.4					\checkmark		\checkmark	\checkmark
13	Standard	TE/TE	1200	8.8	\checkmark							
10	CeilingSmart	TE/TE	1200	7.4	\checkmark	\checkmark	\checkmark		\checkmark		\checkmark	\checkmark
10	FireSmart	TE/TE	1200	7.4	\checkmark	\checkmark	\checkmark		\checkmark		\checkmark	\checkmark
13	FireSmart	TE/TE	1200	11.7	\checkmark	\checkmark	\checkmark	\checkmark	\checkmark			
16	FireSmart	TE/TE	1200	14.7	\checkmark	\checkmark	\checkmark					
10	MultiSmart	TE/TE	1200	9.0	\checkmark	\checkmark	\checkmark		\checkmark		\checkmark	
10	MultiSmart Horizontal	TE/SE	1200	9.0	\checkmark						\checkmark	
13	MultiSmart	TE/TE	1200	12.1	\checkmark	\checkmark	\checkmark	\checkmark	\checkmark			
10	AquaSmart	TE/TE	1200	8.3	\checkmark	\checkmark	\checkmark		\checkmark			
10	AquaSmart Horizontal	TE/SE	1200	8.3	\checkmark						\checkmark	
13	AquaSmart	TE/TE	1200	11.7	\checkmark	\checkmark	\checkmark		\checkmark			

TE/TE = Tapered Both Edges

TE/SE = Tapered One Edge, Square the Other

Product Primary Functions*

THICK- NESS	ELEPHANT PLASTERBOARD PRODUCT RANGE	EDGE TYPE	WIDTH	Horizontal Fixing	Span 600 Centres on Ceilings	ing	Fire Resistance	Noise Control	Impact Resistant	Water Resistant
mm			mm	Hori	Spai on C	Bracing	Fire	Nois	Impi	Wato
10	Standard	TE/TE	1200			\checkmark	\checkmark			
10	Standard Horizontal	TE/SE	1200	\checkmark		\checkmark				
10	Standard Horizontal -Wide	TE/SE	1350	\checkmark		\checkmark				
13	Standard	TE/TE	1200		\checkmark		\checkmark			
10	CeilingSmart	TE/TE	1200		\checkmark	\checkmark	\checkmark			
10	FireSmart	TE/TE	1200		\checkmark	\checkmark	\checkmark			
13	FireSmart	TE/TE	1200		\checkmark	\checkmark	\checkmark	\checkmark	\checkmark	
16	FireSmart	TE/TE	1200				\checkmark	\checkmark	\checkmark	
10	MultiSmart	TE/TE	1200		\checkmark	\checkmark	\checkmark	\checkmark		
10	MultiSmart Horizontal	TE/SE	1200	\checkmark		\checkmark				
13	MultiSmart	TE/TE	1200		\checkmark	\checkmark	\checkmark	\checkmark	\checkmark	
10	AquaSmart	TE/TE	1200				\checkmark	\checkmark		\checkmark
10	AquaSmart Horizontal	TE/SE	1200	\checkmark						\checkmark
13	AquaSmart	TE/TE	1200		\checkmark		\checkmark	\checkmark		\checkmark

* The above table details the product's <u>Primary</u> functions. Some products may perform more than the functions indicated

EPB Plasterboard Product Range

10mm EPB Standard	10mm EPB Horizontal Standard	13mm EPB Standard
10mm EPB FireSmart/CeilingSmart	13mm EPB FireSmart	16mm EPB FireSmart
10mm EPB MultiSmart	10mm EPB Horizontal MultiSmart	13mm EPB MultiSmart
10mm EPB AquaSmart	10mm EPB Horizontal AquaSmart	13mm EPB AquaSmart



FOR MORE INFORMATION

EMAIL info@elephantplasterboard.co.nz

CALL 0800 353 742