E4SQA60

Quiet Steel Frame

Non Load Bearing

Two Way FRR

4 Layers: 2 Layers of Plasterboard to each side of frame

Full Intertenancy **A**coustic

	System Number	Lining Suffix	Fire Rating	Load Bearing Ability	Noise Control		Lining Bassisament
					STC	Rw	Lining Requirement
	E4SQA60	-S52	/60/60	NLB	57	56	2 x 13mm Elephant Standard on One side 2 x 13mm Elephant Standard to Other side
		-M40	/60/60	NLB	57	56	2 x 10mm Elephant MultiSmart on One side 2 x 10mm Elephant MultiSmart to Other side

Framing

Quiet Steel Frame – Tracks to be $92 \text{mm} \times 30 \text{mm} \times 0.55 \text{ BMT}$ and are fixed to floor and ceiling. Quiet Steel studs $92 \text{mm} \times 42 \text{mm} \times 0.55 \text{ BMT}$ are friction fitted and placed at max 600 mm centres with a minimum 15 mm expansion gap at top of frame.

No fixings to the top tracks allowed.

Wall Heights

Recommended maximum height is 3.6m. Higher walls may be subject to specific engineering design or consult the framing manufacturer.

Partition Width

In order to achieve the STC ratings in the table above the partition width (excluding the board) shall be a minimum of 92mm.

Stud Depth	Lining Suffix	Plasterboard	Total Partition
02	S52	52mm	144mm
92mm	M40	40mm	132mm

Wall Sound Absorber

Install Sound Absorber between studs of the frame. Use 90mm thick R2.2 glass wool blanket.

Plasterboard Lining

Two layers of Elephant Plasterboard lining on one side and Two Layers on the other side as per specified system above.

Vertical fixing only permitted. Use full height sheets where possible. Inner layer joints on opposite side of frame should be offset. All sheet joints must be fixed over steel framing. Vertical joints of the outer layer should be offset by 600mm from those of the inner layer. Sheet end butt joints must be formed over nogs. The inner layers are fixed hard to the floor. Sheets shall be touch fitted.

Acoustic Sealant

A bead of acoustical sealant is required around the perimeter of the inner layer and the outer layer is bedded onto the bead. The perimeter junctions of the wall must be airtight.

Fixing of Linings

Fasteners (As per Specified System Above)

	Side	One	Side Two				
System Number	1st Layer	2 nd Layer	1st Layer	2 nd Layer			
	Self-Tapping Drywall Screws						
E4SOA60-S52	13mm	13mm	13mm	13mm			
E43QA00-332	25 x 6g	41 x 6g	25 x 6g	41 x 6g			
F450460 M40	10mm	10mm	10mm	10mm			
E4SQA60-M40	25 x 6g	32 x 6g	25 x 6g	32 x 6g			

Fastener Centres

Inner Layer: Fix at 300mm centres up all studs.

Outer Layer: Fix at 300mm centres up all studs.


Place fasteners no closer than 12mm to the sheet edge and 50mm from sheet ends.

Place fasteners at 200mm centres where sheet end butt joints occur. Avoid outer layer screws from hitting inner layer screws.

Jointing

Inner Layer: Unstopped

Outer Layer: All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. Wall to ceiling junctions are to be reinforced with paper tape and square stopped or finished with Cornice. All in accordance with Elephant Plasterboard Installation Guide.

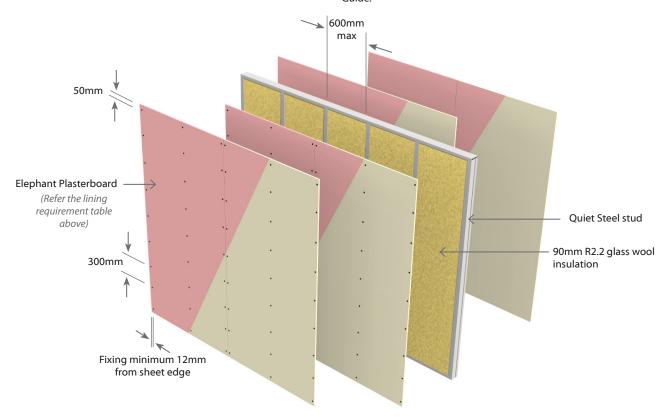



Version update: February 2023